
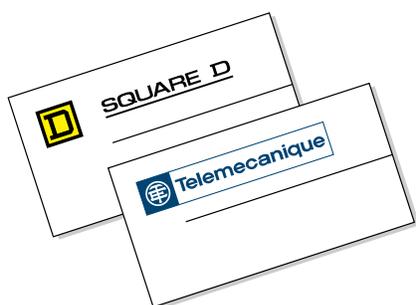


# Electromagnetic Compatibility

Practical Installation  
guidelines

«EMC»

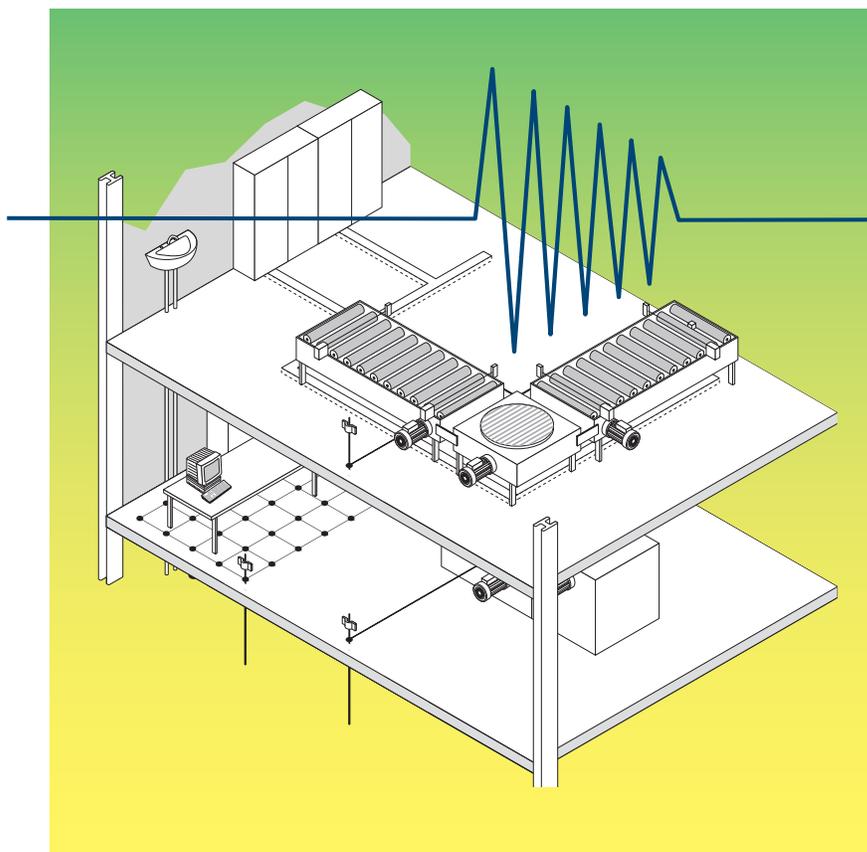

GROUPE SCHNEIDER

■ Merlin Gerin ■ Square D ■ Telemecanique





# These icons will help you find your way around the various sections in this document

## CHAPTER 1

## CHAPTER 2

	CHAPTER 1	CHAPTER 2	
Type of interference			Earthing system
Source of interference			Power supply
Transmission mode of interference			Cabinet
Earth			Cables Wiring rules
Chassis or frame connection			Cable runs
Cables			Connections
Filters			Filters Surge arresters
Ferrite cores			Ferrite cores

# Contents

## CHAPTER 1

### Understanding electromagnetic compatibility phenomena

<b>Foreword</b> .....	<b>1-2</b>
Frequency behaviour of an electric conductor .....	1-3
Frequency behaviour of an inductance or a capacitance .....	1-4
<b>Electromagnetic compatibility of a system</b> .....	<b>1-5</b>
Electromagnetic compatibility: (EMC) .....	1-5
Field of application .....	1-6
<b>Types of electromagnetic interference</b> .....	<b>1-7</b>
Definition of an electromagnetic disturbance .....	1-7
Origin of emitted electromagnetic interference .....	1-8
Low-frequency (LF) interference .....	1-9
High-frequency (HF) interference .....	1-9
Harmonics .....	1-10
Transients .....	1-14
Electrostatic discharges (ESD) .....	1-16
LV mains interference .....	1-18
<b>Sources of electromagnetic interference</b> .....	<b>1-20</b>
Switching of inductive loads by dry contacts .....	1-20
Switching of inductive loads by semiconductors .....	1-23
Electric motors .....	1-25
Fluorescent lighting .....	1-27
Spot welding .....	1-28
Spectral distribution of interference .....	1-29
<b>Transmission modes of electromagnetic interference</b> .....	<b>1-30</b>
Coupling - General information .....	1-30
Conductive coupling .....	1-32
Coupling by radiation .....	1-34
Decoupling of interference .....	1-38

# Contents

---

<b>Earth .....</b>	<b>1-40</b>
General definition .....	1-40
Roles of earth connection in electrical installations .....	1-40
Electrical earth connections .....	1-40
Typical earthing arrangement for an installation .....	1-41
Earth and electromagnetic compatibility .....	1-41
<b>Frame connections .....</b>	<b>1-42</b>
General definition .....	1-42
Specific definition for electrical installations .....	1-42
Exposed conductive parts and safety of persons and property .....	1-42
Exposed conductive parts and electromagnetic compatibility .....	1-43
Loops between exposed conductive parts .....	1-46
Frame connection loops .....	1-47
Avoid earthing exposed conductive parts in a star configuration .....	1-48
<b>Cables .....</b>	<b>1-49</b>
Frequency behaviour of a conductor .....	1-49
Length and cross-sectional area of a conductor .....	1-51
Antenna effect of a conductor .....	1-52
Green/yellow PE/PEN conductor .....	1-53
Interconnection of exposed conductive parts .....	1-53
<b>Filters .....</b>	<b>1-54</b>
Function of a filter .....	1-54
Various filter types .....	1-55
<b>Ferrite cores .....</b>	<b>1-57</b>
<b>Index at rear</b>	

# Contents

## CHAPTER 2

### Obtaining electromagnetic compatibility in an installation

<b>Foreword</b> .....	<b>2-2</b>
<b>The (EMC) procedure</b> .....	<b>2-3</b>
Designing a new installation or extending an installation .....	2-4
Maintaining or upgrading an installation - Updating installed equipment .....	2-5
Improving an existing installation .....	2-6
<b>Code of Practice</b> .....	<b>2-7</b>
Related topics: .....	2-7
<b>Earthing system</b> .....	<b>2-8</b>
Introduction .....	2-8
Building .....	2-9
Equipment/machine .....	2-11
Cabinet .....	2-12
Electrical connections .....	2-13
Daisy-chained interconnection of exposed conductive parts .....	2-14
<b>Power supply</b> .....	<b>2-18</b>
Analysis .....	2-19
Technical specifications .....	2-19
Isolation by transformer .....	2-19
Earthing arrangements .....	2-20
Earthing arrangements: (EMC) performance .....	2-21
Distribution in the installation .....	2-24
Earthing of transformer screens .....	2-25
<b>Cabinet</b> .....	<b>2-26</b>
Analysis .....	2-26
Earth reference plane .....	2-28
Cable entrances .....	2-28
Routing of cables .....	2-28

# Contents

---

Lighting .....	2-29
Layout of components .....	2-29
<b>Cables .....</b>	<b>2-32</b>
Classes* of signals .....	2-32
Choice of cables .....	2-32
Performance of cables in terms of (EMC) .....	2-34
<b>Wiring rules .....</b>	<b>2-36</b>
The 10 Commandments .....	2-36
<b>Cable runs .....</b>	<b>2-44</b>
Cable troughs .....	2-44
Connection to cabinets .....	2-45
Positioning of cables .....	2-46
Connection of ends .....	2-48
Methods of cable laying not recommended .....	2-50
Recommended methods of cable laying .....	2-51
<b>Connections .....</b>	<b>2-52</b>
Type and length of connections .....	2-52
Making a connection .....	2-53
Pitfalls to avoid .....	2-54
Connection of shielding .....	2-55
<b>Filters .....</b>	<b>2-56</b>
Layout in cabinet .....	2-56
Mounting of filters .....	2-58
Connection of filters .....	2-59
<b>Surge arresters .....</b>	<b>2-60</b>
Surge arresters or coil interference suppression modules: choice .....	2-60
<b>Ferrite cores .....</b>	<b>2-62</b>
<b>Index at rear</b>	

# Contents


---

## CHAPTER 3

### (EMC) standards, facilities and tests

<b>Standards</b> .....	<b>3-3</b>
Introduction .....	3-3
There are 3 types of (EMC) standards .....	3-3
Standardising bodies .....	3-4
CISPR Publications .....	3-4
Examples of CISPR Publications applicable to our products .....	3-5
IEC Publications .....	3-6
Examples of IEC 1000-X-X Publications applicable to our products ...	3-6
CENELEC Publications .....	3-9
<b>(EMC) facilities and tests</b> .....	<b>3-10</b>
<b>Index at rear</b>	

# CHAPTER 1

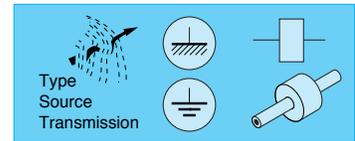


# UNDERSTANDING ELECTROMAGNETIC COMPATIBILITY PHENOMENA

1

2

3

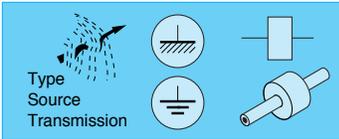

# Foreword

---

1



2



The attention of readers who are familiar with conventional electrical engineering is drawn to the fact that this chapter deals with concepts relating to phenomena associated with high-frequency (HF) voltages and currents.

3


These have the effect of significantly modifying the characteristics and hence the behaviour of our electrical installations.




«Mastering» these phenomena is essential to understanding and, above all, solving the problems that will be encountered on site.

*This is illustrated by the following examples.*

# Foreword



## Frequency behaviour of an electric conductor

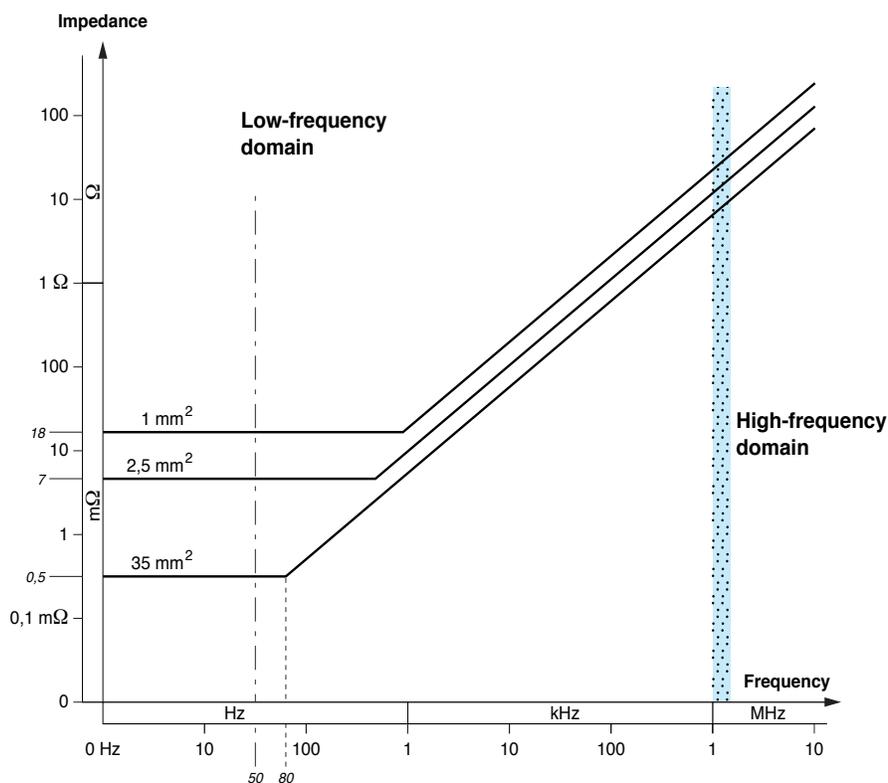

- 1
- 2
- 3


Characteristic impedance values of an electric conductor of length  $L = 1\text{ m}$

- Note that the impedance of the cable increases very sharply with the frequency of the signal that passes along it.  
(Impedance  $\Omega$ )  $Z = K$  (constant)  $\times f$  (frequency Hz)
- For low-frequency (LF) signals (e.g. 50-60 Hz)

**==> the impedance of the cable is relatively insignificant**  
**==> the cross-sectional area of the cable is of prime importance**

- For high-frequency (HF) signals ( $f > 5\text{ MHz}$ )

**==> the impedance of the cable is decisive**  
**==> the length of the cable is decisive**  
**==> the cross-sectional area of the cable is relatively insignificant**

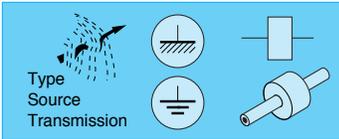

# Foreword

## Frequency behaviour of an inductance and a capacitance

1

•  $Z = 2\pi Lf$  With high frequency (HF), the **impedance** of a cable becomes very high.

- ==> The «length» of conductors becomes non negligible,
- ==> Distortion of the signal (amplitude, frequency, etc.).

2


•  $Z = \frac{1}{2\pi Cf}$  With high frequency (HF), the **impedance** of a stray capacitance becomes very small.

- ==> Capacitive coupling becomes effective,
- ==> Leakage currents flow in the installation,
- ==> The useful signal becomes easily susceptible to interference.


3

$Z = \text{Impedance}$        $L = \text{Inductance}$        $C = \text{Capacitance}$        $f = \text{Frequency of signal}$


Example : cable

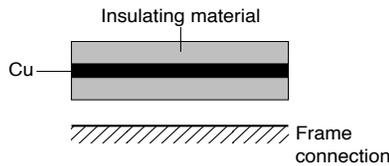


Equivalent low-frequency (LF) circuit diagram

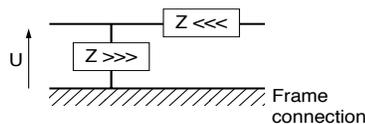

Equivalent high-frequency (HF) circuit diagram

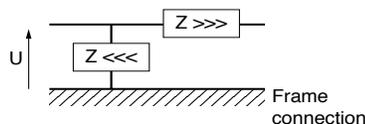


# Electromagnetic compatibility of a system

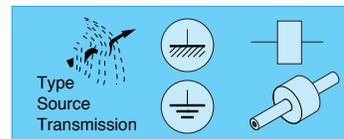


## Electromagnetic compatibility : (EMC)

The standards define electromagnetic compatibility (EMC) as «the ability of a device, equipment or a system to function satisfactorily in its electromagnetic environment without introducing intolerable disturbances to that environment or to other equipment».

- 1
- 2
- 3

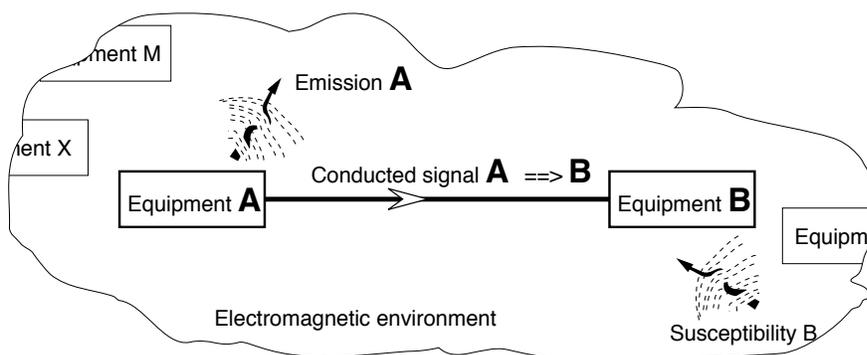

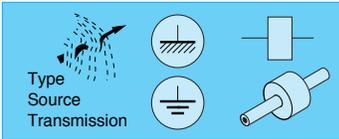

# Electromagnetic compatibility of a system

## Field of application

1


A set of equipment (actuators, motors, sensors, etc.) involved in fulfilling a defined function is referred to as a «system».

Note that, in electromagnetic terms, the system comprises all those components that interact with each other, including even mains decoupling devices.

2

Electric power supplies, connections between various equipment items, associated hardware and their electric power supplies are part of the system.

3

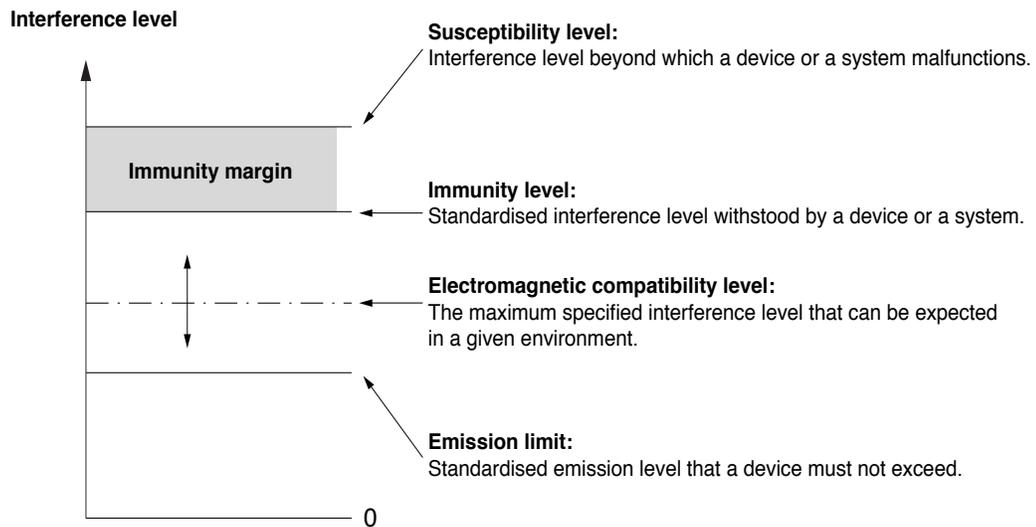

### This means that :

-  The immunity level of each device is such that it is not disturbed by its electromagnetic environment.
-  Its interference emission level must be low enough not to interfere with devices located in its electromagnetic environment.


# Types of electromagnetic interference



## Definition of an electromagnetic disturbance

Any electromagnetic phenomenon capable of impairing the performance of a device, equipment or system, etc.

An electromagnetic disturbance can be electromagnetic noise, an unwanted signal or a change in the propagation medium itself.

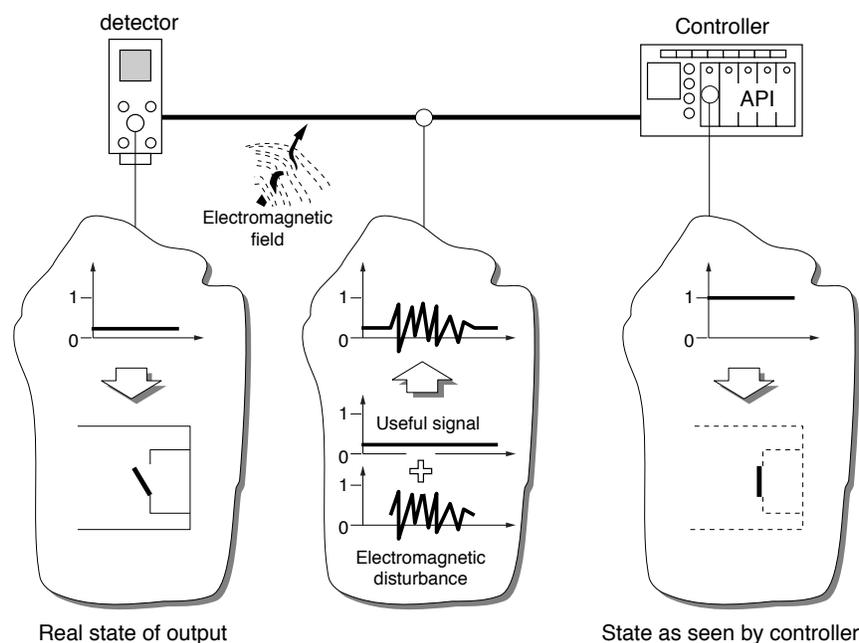

In addition, an electromagnetic disturbance, as its name suggests, consists of an electric field  $\vec{E}$  generated by a potential difference and a magnetic field  $\vec{H}$  difference caused by the flow of a current  $I$  along a conductor.



**«Unwanted» electromagnetic interference is simply an unwanted electrical signal that is added to the useful signal.**


This unwanted signal is propagated by conduction in conductors and by radiation in air, etc.



# Types of electromagnetic interference

## Origin of emitted electromagnetic interference

1

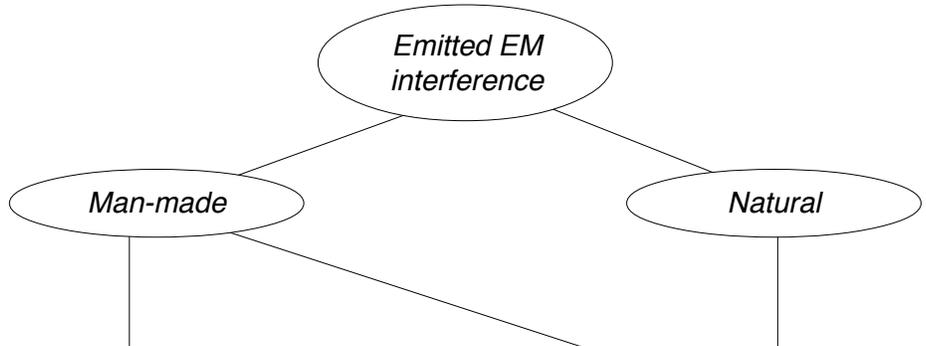


2

3

Deliberate	Unintentional
<ul style="list-style-type: none"> <li>• Broadcasting stations</li> <li>• TV transmitters</li> <li>• Walkie talkies</li> <li>• Citizen's Band</li> <li>• Portable telephones</li> <li>• Radar systems</li> <li>• etc.</li> </ul>	<p><b>Accidental</b></p> <ul style="list-style-type: none"> <li>• Short circuits</li> <li>• Sudden earthing</li> </ul> <p><b>Continuous</b> This is caused by the normal operation of apparatus.</p> <ul style="list-style-type: none"> <li>• All systems that switch an electrical signal on and off (hard contact, «power» transistor, etc.) such as :  <ul style="list-style-type: none"> <li>Contacts, relays, inverters, switching power supplies, ignition systems of combustion engines, commutator motors, dimmers, etc.</li> </ul> </li> <li>• Gas discharge and fluorescent lamps</li> <li>• Equipment that uses clocks (PC, PLC)</li> <li>• etc.</li> </ul>
<ul style="list-style-type: none"> <li>• Equipment for the processing of materials :               <ul style="list-style-type: none"> <li>-&gt; Melting, welding, soldering, etc.</li> <li>-&gt; Induction ovens (drying timber, etc.)</li> <li>-&gt; Electron torches</li> <li>-&gt; etc.</li> </ul> </li> </ul>	

# Types of electromagnetic interference



## Low-frequency (LF) interference

Frequency range :  $0 \leq \text{frequency} \leq 1 \text{ to } 5 \text{ MHz}$ .

Low-frequency (LF) interference is encountered in installations chiefly in CONDUCTED form (cables, etc.)

Duration : Often long duration (several dozen ms)

In some cases this phenomenon may be continuous (harmonic).

Energy : The conducted energy may be high and result in malfunction or even the destruction of connected devices.

- 1
- 2
- 3

$$(\text{Energy}) W_{(j)} = U_{(V)} I_{(A)} t \text{ (s)}$$

## High-frequency (HF) interference

Frequency range : Frequency  $\geq 30 \text{ MHz}$ .

High-frequency (HF) interference is encountered in installations chiefly in RADIATED form (air, etc.)

Duration : HF pulses. Pulse rise time  $< 10 \text{ ns}$ .

This phenomenon may occur continuously (rectifiers, clocks, etc.).

Energy : The radiated energy is generally low and results in malfunction of nearby equipment.



# Types of electromagnetic interference

## Harmonics

1


A periodic signal of any shape can be mathematically resolved into a number of sinusoidal signals of various amplitudes and phases of which the frequency is a whole multiple of the fundamental frequency.

fundamental frequency : lowest useful frequency of the signal.

Breakdown of a signal into a FOURIER series.


2

**Time representation**

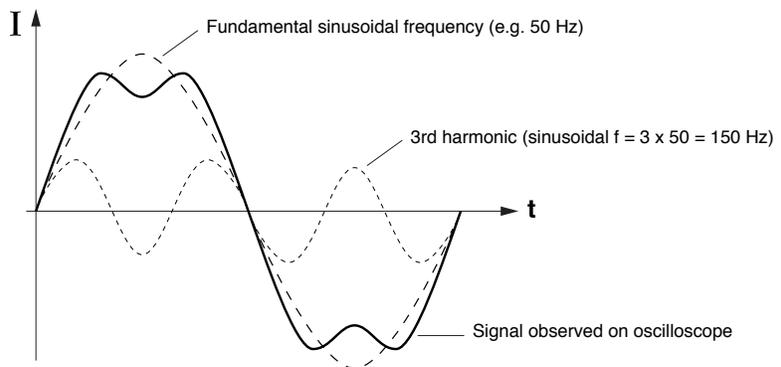


3

**Spectral representation**

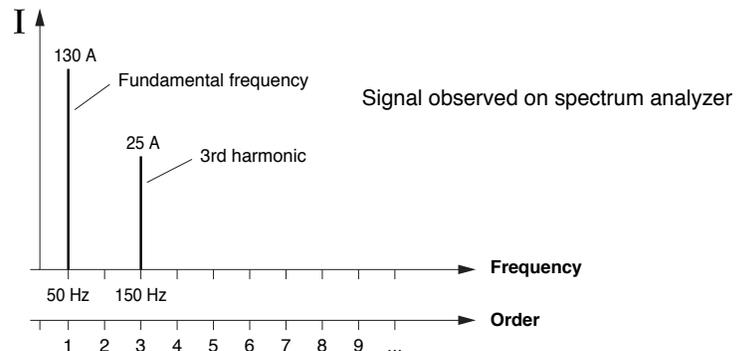

*Harmonic interference is low-frequency (LF) type interference and is therefore mainly «conducted».*

# Types of electromagnetic interference



## Harmonic distortion

The total harmonic distortion percentage is used to work out the deformation of any signal compared with the fundamental (first-order) sinusoidal signal.

$$TDH \% = \sqrt{\sum_2^n \left(\frac{H_i}{H_1}\right)^2}$$

$H_i$  = amplitude of harmonic of order  $i$   
 $H_1$  = amplitude of fundamental (first-order) frequency

1

This can be simplified :  $TDH \approx \frac{\sum \text{Amplitudes of all harmonics of order } > 2}{\text{Amplitude of fundamental frequency or 1st order harmonic}}$


2

Harmonics of order higher than 40 have a negligible effect on harmonic distortion (but not on installations).

3

## Origin

*All non-linear (fluorescent lighting, rectifier, etc.) loads (sinks) consume non-sinusoidal current and therefore generate harmonic currents.*

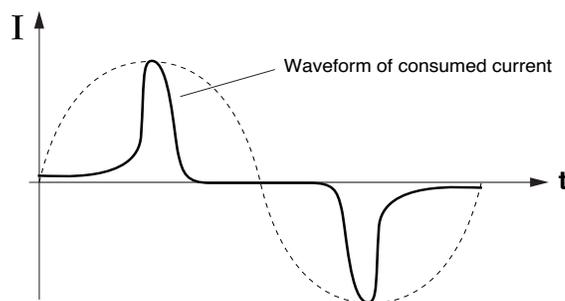

Current consumed by a fluorescent tube

The power source converts these harmonic currents into harmonic voltages through its internal impedance (Z).

$$U = ZI$$

*It is this mains-borne harmonic voltage that can interfere with other loads.*



## Types of electromagnetic interference

### Harmonics (continued)

1

#### *Main sources of harmonics*

- Inverters, choppers,
  - bridge rectifiers: electrolysis, welding machines, etc.
- 2
- arc furnaces,
  - induction ovens,
  - electronic starters,
  - electronic speed controllers for d.c. motors,
  - frequency converters for induction and synchronous motors,
- 3
- domestic appliances such as TVs, gas discharge lamps, fluorescent tubes, etc.,
  - saturable magnetic circuits (transformers, etc.).

It is evident that these types of sinks are in increasingly widespread use and the «power» that they handle is becoming increasingly higher, hence the growing importance of the associated interference.

# Types of electromagnetic interference




## Main loads affected by harmonics

<i>Load</i>	<i>Problems</i>
Synchronous machines : .....	Additional temperature rises
Transformers : .....	Additional losses and temperature rises. Risk of saturation if even-order harmonics are present.
Asynchronous machines : .....	Additional temperature rises, especially in the case of squirrel-cage motors or motors with a deeply slotted armature Pulsating torques
Cables : .....	Increased ohmic and dielectric losses
Computers : .....	Functional problems due to pulsating torque of drive motors for example
«Power» electronics : .....	Problems associated with waveform: switching, synchronisation, etc.
Capacitors : .....	Temperature rises, ageing, unwanted circuit resonance, etc.
Regulators, relays, counters : .....	Falsified measurements, untimely operation, impaired accuracy, etc.

1

2

3

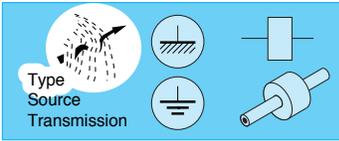

# Types of electromagnetic interference

## Transients

1

The term «transient» denotes impulsive spikes picked up by electric circuits and encountered in conducted form on power supply cables and at control and signal inputs of electrical or electronic equipment.

2


### Characteristics of standardised transients (IEC 1000-4-4 type)

The significant features of these disturbances are as follows:

3


- Very short duration of pulse rise time  $\approx 5 \text{ ns}$
- Pulse duration  $\approx 50 \text{ ns}$
- Repetitive phenomenon: pulse bursts for roughly  $\approx 15 \text{ ms}$
- Repetition frequency : successive bursts roughly every  $\approx 300 \text{ ms}$
- Low energy pulses  $\approx 1 \cdot 10^{-3} \text{ joule}$
- High amplitude of overvoltage  $\leq 4 \text{ kV}$

Example :

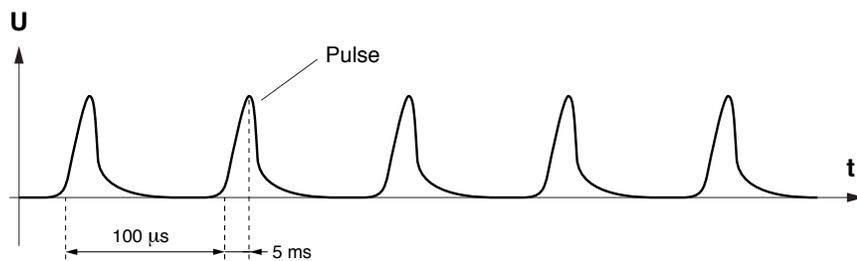

**Time representation**


Repetition period depends on the level of the test voltage

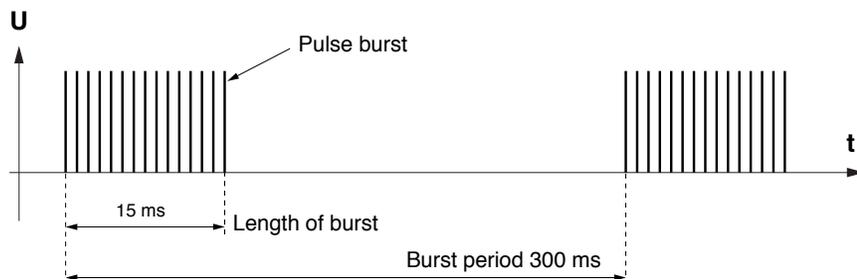

# Types of electromagnetic interference



## Spectral representation

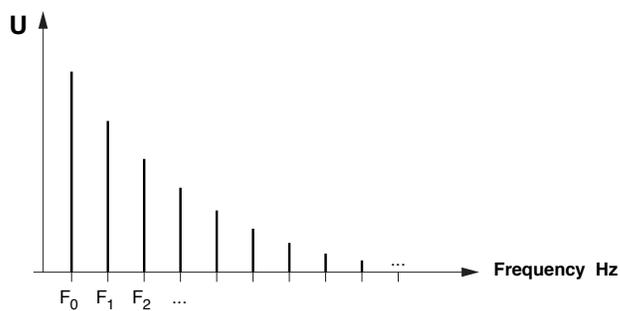

1

Depending on the nature of the transient in question, the spectrum may be wide-band (0 to 100 MHz or more).

2

## Origin

Transients are caused by the high-speed switching of mechanical and, in particular, electronic «switches».

When a «switch» operates, the voltage across its terminals changes very rapidly from its nominal value to zero and vice versa. This produces sudden high variations in voltage ( $dv/dt$ ) that are carried along cables.

3

## Main sources

 Lightning, faults to earth, commutation failures in inductive circuits (contactor coils, solenoid valves, etc.)

 Transients are high-frequency (HF) type disturbances.

They are conducted along conductors but are easily injected into other conductors by radiation.



# Types of electromagnetic interference

## Electrostatic discharges (ESD)

The term «electrostatic discharge» denotes impulsive currents that flow through any object connected to earth if it comes into (direct or indirect) contact with another object having a potential that is high relative to earth.

1

### Characteristics of standardised electrostatic discharges (IEC 1000-4-2 type)

The significant features of these disturbances are as follows :


2

- Very short duration of pulse rise time  $\approx 1$  ns
- Pulse duration  $\approx 60$  ns
- The isolated nature of the phenomenon : 1 discharge
- The very high voltage at the start of the discharge (2 to 15 kV or more)

3


Example :

**Time representation**

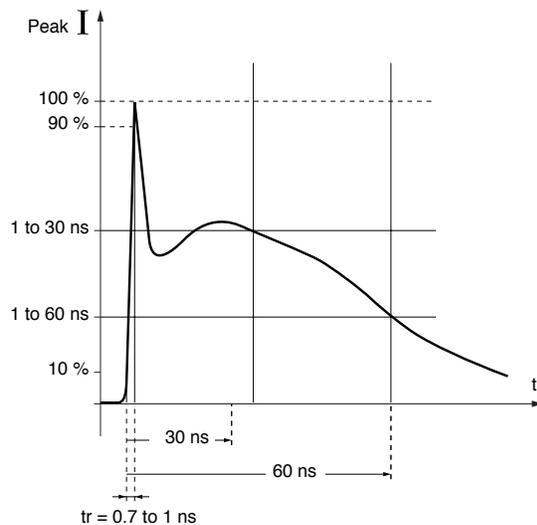

**Spectral representation**

Wide-band spectrum (0 to 1000 MHz or more)

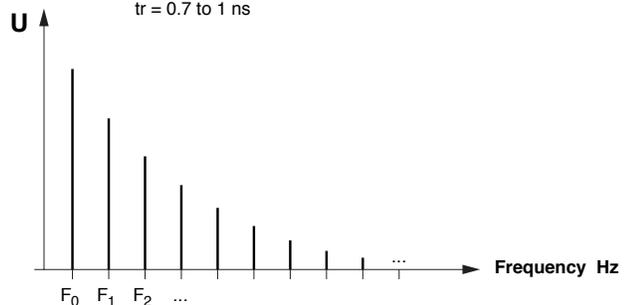

# Types of electromagnetic interference




## Origin

Electrostatic charges are the result of exchanges of electrons between materials or between the human body and materials. This phenomenon is encouraged by the combination of synthetic materials (plastics, fabric, etc.) and a dry atmosphere.

## Main sources

The process may be the result, for instance, of a person accumulating a charge as he/she walks over a carpet (exchange of electrons between the body and the fabric), or of clothes worn by an operator sitting on a chair. Discharges may also occur between a person and an object or between electrostatically charged objects.

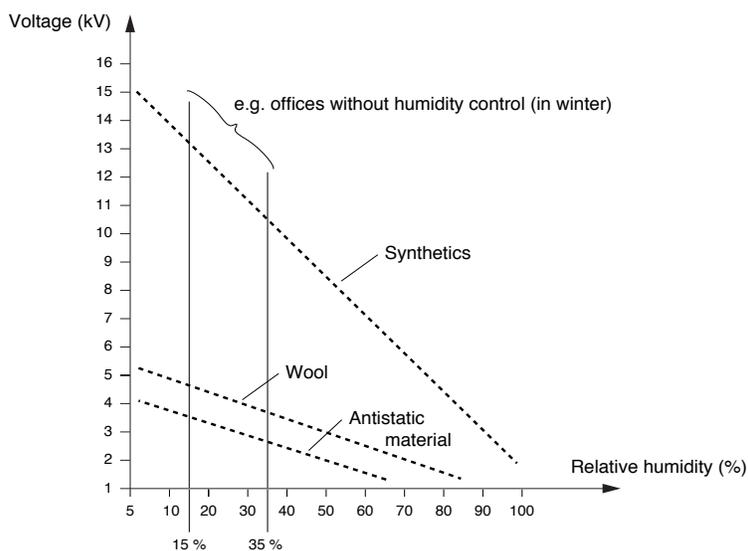

Maximum values of electrostatic voltages that may be accumulated by an operator

## Effects

The effect of electrostatic discharge from an operator to equipment can range from a simple malfunction through to destruction of the equipment.

 Electrostatic discharge type disturbances are high-frequency (HF) type interference that is encountered in conducted form but which is easily injected into other conductors by radiation.

- 1
- 2
- 3



# Types of electromagnetic interference

## LV mains interference

1

Voltage : fluctuations, power failures, voltage dip, surge voltages

Frequency : variations

Waveform : harmonics, transients, carrier currents


Phases : unbalanced

2

Power : short circuits, overloads (effects on voltage)

3


These are chiefly low-frequency (LF) type disturbances.

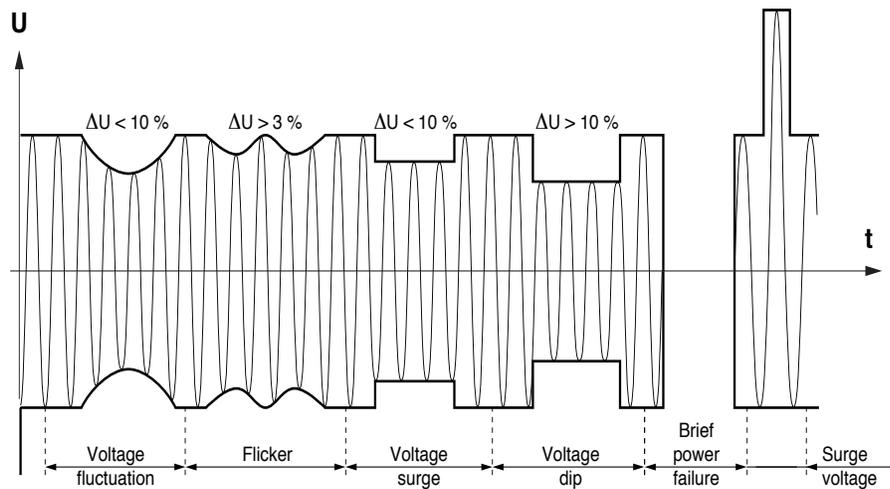

Examples of low-voltage (LV) mains interference



# Types of electromagnetic interference

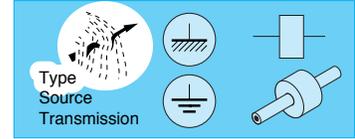

Usual name	Amplitude of variation	Duration of fault	Origin	Consequences
Voltage fluctuation	$\Delta U < 10\%$ (slow variation) CEI 38 IEC 1000-3-3 IEC 1000-3-5		<ul style="list-style-type: none"> <li>Arc furnaces</li> <li>Welding machines</li> <li>Large loads involving frequent starting (compressors, lifts, etc.)</li> </ul>	<ul style="list-style-type: none"> <li>No effect on equipment</li> <li>Flickering of lighting systems</li> </ul>
Flicker	$\Delta U > 3\%$		<ul style="list-style-type: none"> <li>Switching of large loads (starting of big motors, electric boilers, electric furnaces, etc.)</li> </ul>	
Voltage surge	$\Delta U < 10\%$ (fast variation)			
Voltage dip	$10\% \leq \Delta U \leq 100$ IEC 1000-2-2	<p>10 ... 500 ms</p> <p>Power failure and voltage dips are Impulsive : &lt; 10 ms Brief : 10 ms to 300 ms</p>	<p>Powering-up (inrush current in 8 to 20 A) :</p> <ul style="list-style-type: none"> <li>Large motors and «on-the-fly restarting»</li> <li>Large transformers</li> <li>Large capacitors at start of network</li> </ul> <p>Short circuit on main LV distribution (wind, storm, fault on neighbouring customer's premises) (power failure due to protective device with reclosing)</p>	<ul style="list-style-type: none"> <li>Dropout of high-speed relays; can cause serious problems in process control</li> <li>Loss of power supply (if DU &gt; 30%)</li> <li>Loss of braking in motors</li> <li>Make sure of adequate immunity, especially for controller, sensors, etc.</li> <li>Slipping of asynchronous motors</li> </ul>
Brief power failure	$\Delta U = 100\%$	<p>Brief : 10 ms à 1 mn long : 0,3 s à 1 mn permanent : &gt; 1 mn</p>	<p>Powering-up (inrush current in 8 to 20 A) :</p> <ul style="list-style-type: none"> <li>Large motors and «on-the-fly restarting»</li> <li>Large transformers</li> <li>Large capacitors at start of network if <math>t \leq 10</math> ms --&gt; transient phenomenon</li> </ul>	<ul style="list-style-type: none"> <li>Loss of power supply</li> </ul>
Surge voltage	$\Delta U > 10\%$	Impulsive	<ul style="list-style-type: none"> <li>Accidental (connection mistakes)</li> <li>MV system</li> </ul>	<ul style="list-style-type: none"> <li>Destruction of electronic hardware</li> <li>Absolutely must be taken into account in the design and implementation of electronic apparatus</li> <li>Generally of no consequence for electrical equipment</li> </ul>

1

2

3



# Sources of electromagnetic interference


## Switching of inductive loads by dry contacts

1

### Switching devices with dry contacts

This term is taken to mean all the devices designed to make or break one or more electrical circuits by means of contacts that can be separated.

2



3


### Origin of disturbances

The behaviour of the electric contact and the disturbances generated depend on the nature of the controlled load.

#### Behaviour when connected to a resistive load


Switching a resistive load by means of a dry contact generates no or little disturbance

#### Behaviour when connected to an inductive load

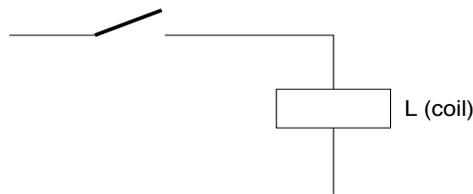

Example of inductive loads :  
Electromagnet of contactor, solenoid valves, brake, etc

# Sources of electromagnetic interference





## Steady state conditions

Under steady-state conditions, a contact that «powers» an inductive load does not generate any disturbance.

## Switching an inductive circuit

Opening an inductive circuit produces the following across the contact terminals :

- A significant overvoltage resulting in a series of breakdowns of the dielectric, possibly followed by arcing.
- Damped oscillation of the voltage at the natural frequency of the circuit consisting of the inductive load and its control line.

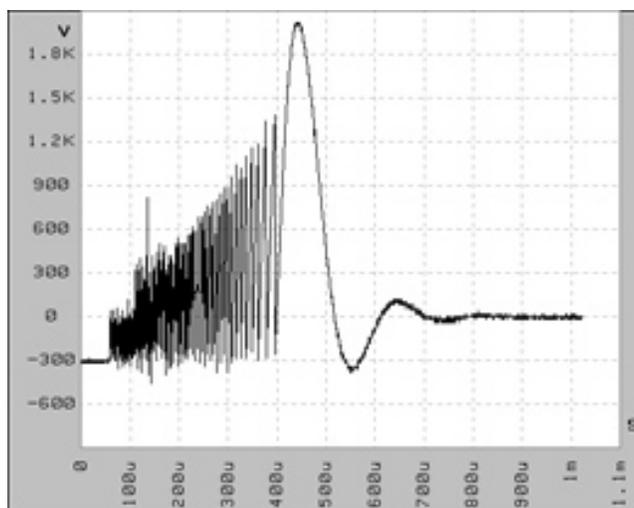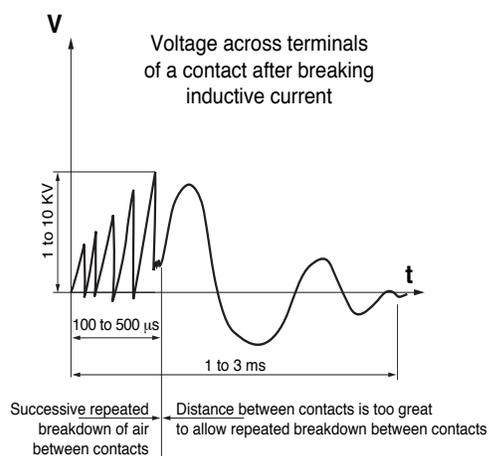

Contactor cutoff, 9A $\sim$  without peak limiting

## Application to power circuits

The operation of switches, contactors, circuit breakers, etc. in power circuits generates transient disturbances.

Example: closing when connected to capacitors (power-factor compensation battery), tripping of circuit-breaker in the event of short circuit, etc.

Despite the amplitude of the switched currents, the phenomena caused by such operations often cause little interference. The energies involved are high but are characterised by gently-sloping wave fronts (filtering effect of cables, high time constant of loads, etc.)



# Sources of electromagnetic interference

## Emitted disturbances

Voltage surges vary from 1 to 10 kV and increase the faster the contact is opened. They depend on the energy stored in the controlled circuit.

Example :  
50 mJ for a small a.c. contactor  
0.2 J for a small d.c. contactor  
10 J for a large d.c. contactor

1

The frequency spectrum of the emitted disturbances (breakdown wave-front) ranges from several kilohertz (kHz) to several megahertz (MHz).

2

## Effects on installations

These disturbances have no effect on conventional electrical equipment.


**They can cause interference in certain electronic circuits :**

3

### In conducted form

Succession of transients superimposed on the power supply current. This can cause inopportune triggering of thyristors, triacs, etc. and switching of or damage to sensitive inputs.


Contacteur cutoff 9A~ mains rejection

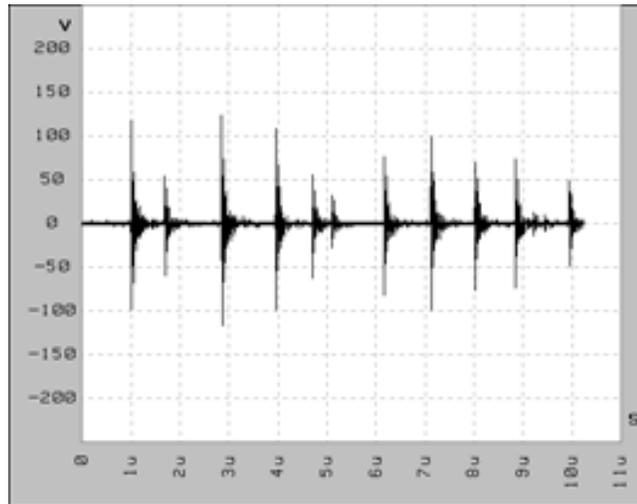

### In radiated form


These high-frequency (HF) disturbances can, when radiated, interfere with separate neighbouring circuits (cables in the same trough, printed conductors on PCs, etc.). Finally, they may interfere with nearby telecommunication equipment (television, radio, measuring circuit, etc.).

# Sources of electromagnetic interference

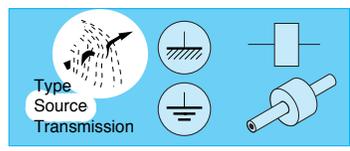

## Switching of inductive loads by semiconductors

This term is taken to mean all the electronic components designed to make and/or break current flowing through a semiconductor in an electrical circuit.

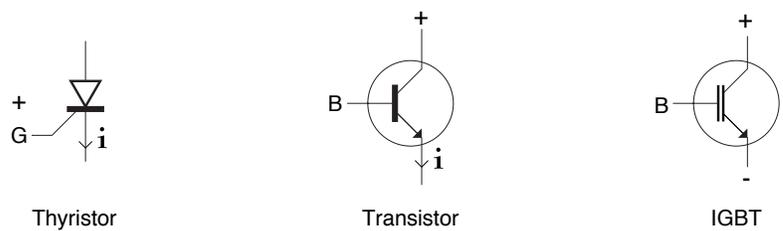

IGBT = Insulated Gate Bipolar Transistor

In some respects, these are extremely high-speed «switches» that will be «open» or «closed» depending on the reference variable applied to the control of the switch, namely the base (B) or the gate (G), depending on the component.

- 1
- 2
- 3

### Typical performance of such components

Typical values	Thyristor	Transistor	IGBT
Insulation withstand capability (max)	1,6 kV	1,2 kV	1,2 kV
Max. on state current	1,5 kA	500 A (switched)	400 A (switched)
Switching frequency	3 kHz	5 kHz	10-20 kHz





# Sources of electromagnetic interference

## Switching of inductive loads by semiconductors (continued)

1

### Case study


#### Observed phenomenon

Making and breaking an electrical circuit results in a sudden variation in the current or voltage across the terminals of the control circuit.

2

This therefore results in steep potential gradients ( $dv/dt$ ) across the terminals of the circuit which will produce interference.

3

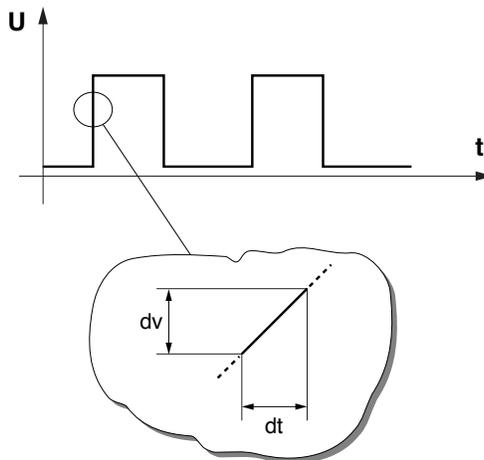

#### Emitted signals :

- Two types of disturbances are generated :
- Low-frequency (LF) harmonics: 10 kHz ...
  - Low- and high-frequency (HF) transients: up to 30 MHz...
- They are encountered in conducted and radiated form.

#### Effects

Interference in sensitive apparatus such as: measuring systems, radio receivers, telephones, sensors, regulators, etc.

# Sources of electromagnetic interference




## Electric motors

### Rotating machines

Rotating machinery (electric motors) are an important source of conducted and/or radiated interference.

Example: commutator d.c. motor


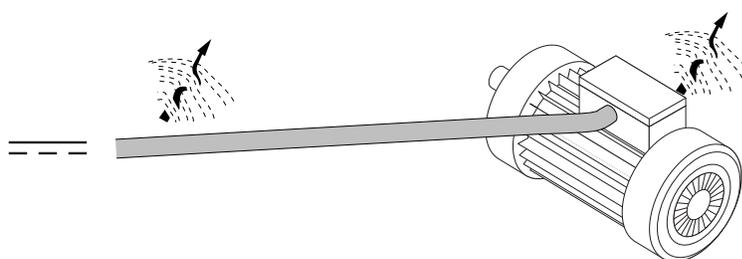


- 1
- 2
- 3

### Observed phenomena

During normal operation (continuous running), interference will depend on the type of motor used.

- Induction motors (asynchronous, etc.) cause relatively little interference.
- Motors with brushes and commutators generate «transient» type interference with a steeply-sloping wave front (high dv/dt) produced during the brush commutation phase.

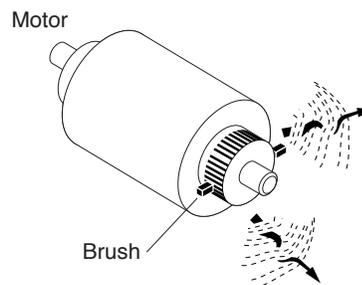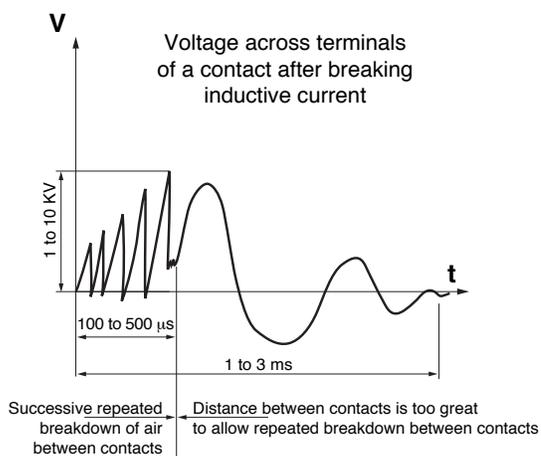

d.c. commutation



## Sources of electromagnetic interference

### Electric motors (continued)

1

Nevertheless, asynchronous motors can generate interference :

- Magnetic saturation of motors.

The load then becomes non linear and this produces harmonics.

- Switch-on or powering-up of motor (starting).

The resulting high inrush current (6 to 10 I nominal) can produce a power supply voltage dip.

2

3

#### *Emitted signals :*


- Low-frequency harmonics
- Power supply interference (voltage dips, etc.)
- Low- and high-frequency (HF) transient disturbances, possibly higher than 100 MHz
- Electrostatic discharges caused by the build-up of electrostatic energy resulting from friction between materials of different types.

# Sources of electromagnetic interference



## Fluorescent lighting

This term is taken to mean all lighting sources that operate on the principle of an electric arc that alternately switches on and off.

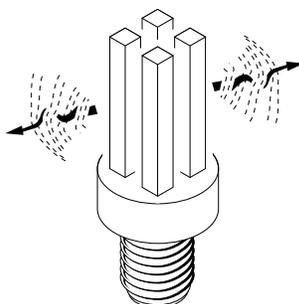

### Origin

Even when they are compensated and installed in pairs, the current drawn by fluorescent tubes is not sinusoidal.


### Generated interference

This current is therefore particularly rich in harmonics, especially third harmonics (3 x 50 Hz or 3 x 60 Hz etc.)

Interference will be generated over a wide frequency range (0 to 100 kHz or even 5 MHz).

 These disturbances of the low-frequency (LF) type are encountered in the installation in conducted form.

Waveform of absorbed current

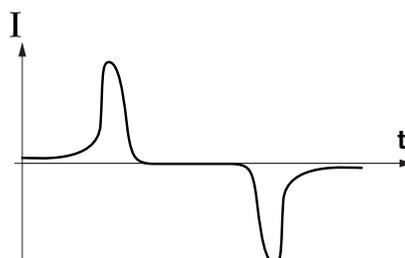

- 1
- 2
- 3



# Sources of electromagnetic interference

## Spot welding


1

This includes all electric welding machines or soldering tongs.

### *Principle*

2

Spot welding is obtained by passing a high current ( $\approx 30,000$  A) through the two parts to be welded. The temperature rise is high enough to achieve welding by fusion.

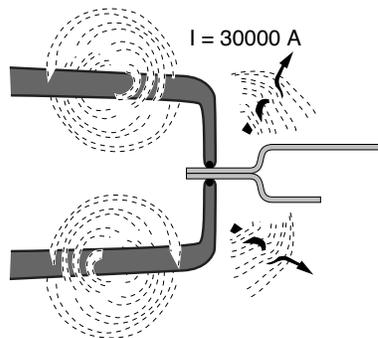


3


### *Generated interference*

- Harmonic voltages 200 ... 20 kHz
- Strong radiated magnetic field that can cause malfunctioning of inductive proximity switches.


# Sources of electromagnetic interference

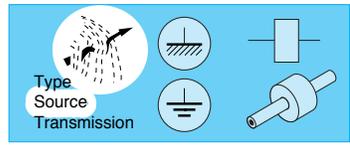

## Spectral distribution of interference

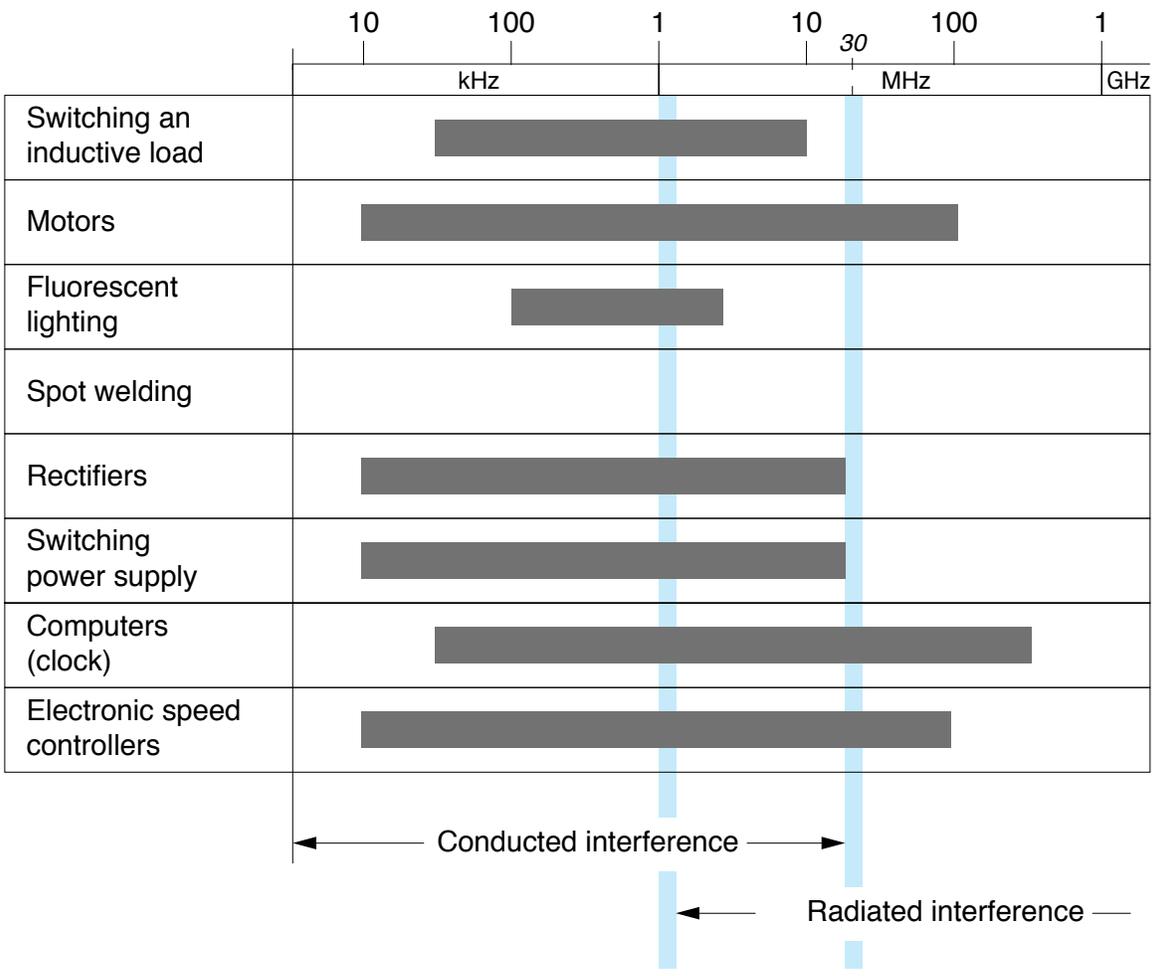

- 1
- 2
- 3

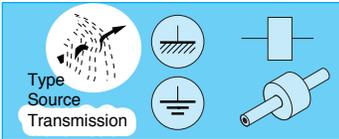

# Transmission modes of electromagnetic interference


*Identifying the transmission mode of interference is an essential aspect of correct analysis of (EMC) phenomena*

## Coupling : general information

1


Coupling is the way in which EM disturbances act on susceptible equipment.

2

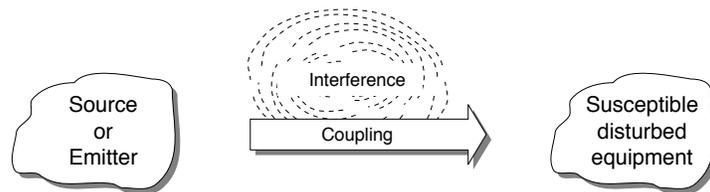


3

Typical installation :

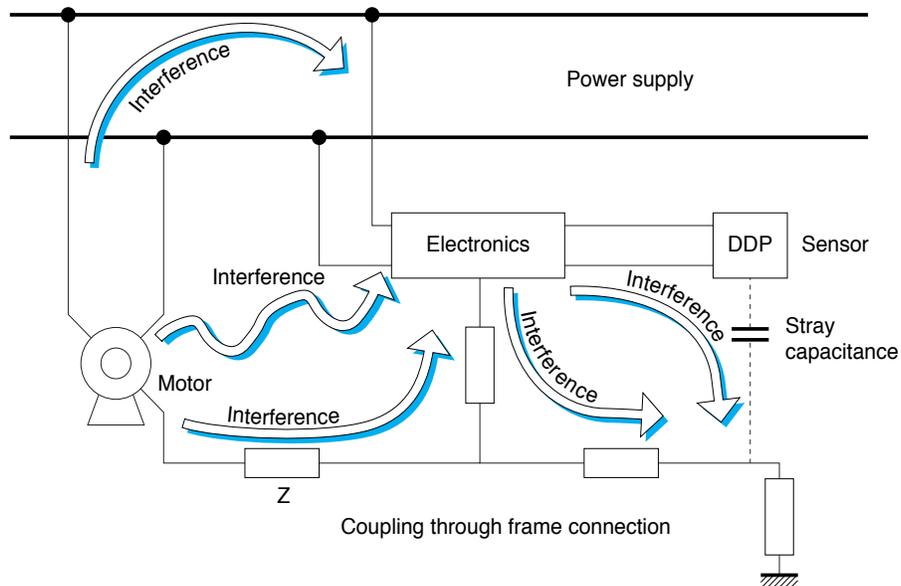

# Transmission modes of electromagnetic interference

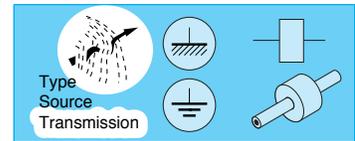

1

When «sensitive» (low immunity level) equipment is fed by an electric power source that is shared by several equipment items (distribution system, etc.), the interference generated by «power» equipment (motors, furnaces, etc.) is transmitted to the sensitive equipment over common power supply lines.

2

There is another type of coupling by conduction that occurs in frame and earth circuits.


Frame earth conductors (PCB, etc.) are all linked to the frame connection of the installation and ultimately to earth by «conductors» having non-zero impedance ( $Z$ ).

3

This results in a potential difference between the earth and frame connections as well as between frame connections.

These potential differences cause parasitic currents to flow through the various circuits.

Coupling due to radiated interference in air may also cause malfunctioning of nearby devices.

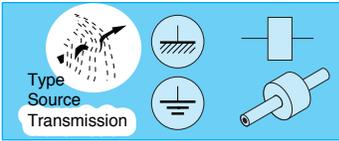

# Transmission modes of electromagnetic interference

## Conductive coupling


1

Conducted interference is carried by an electric «conductor». It can therefore be transmitted via :

- Internal power supply lines or the distribution system,
- Control wires,
- Data transmission lines, buses, etc.
- Earth cables (PE, PEN, etc.),
- Earth,
- Stray capacitance, etc.

2

3

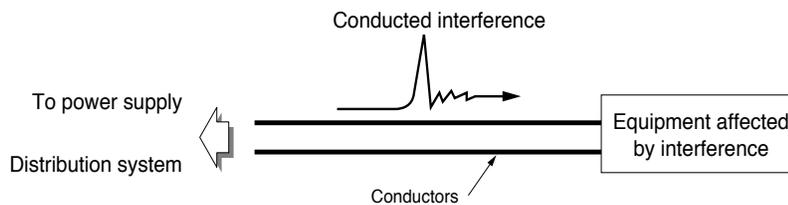

### ***Principle***

A (wanted or unwanted) signal can travel along a 2-wire connection in two ways :


- Differential mode
- Common mode

# Transmission modes of electromagnetic interference



## Differential mode

Differential-mode (or series-mode) current travels along one of the conductors, flows through the equipment, may or may not cause malfunctions in it and returns via another conductor.

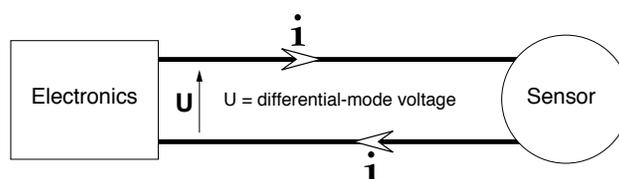


1

2


## Common mode

Common-mode current flows along all the conductors in the same direction and returns via the frame connection through stray capacitance.

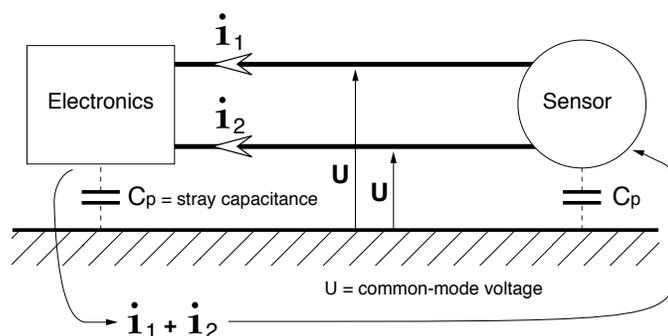

3

*Common-mode interference is the major problem in (EMC) because its propagation path is difficult to identify.*

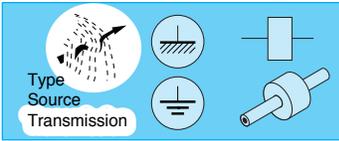

# Transmission modes of electromagnetic interference

## Coupling by radiation


1

Radiated interference travels through the ambient medium (air, etc.).

Typical case :

2

3

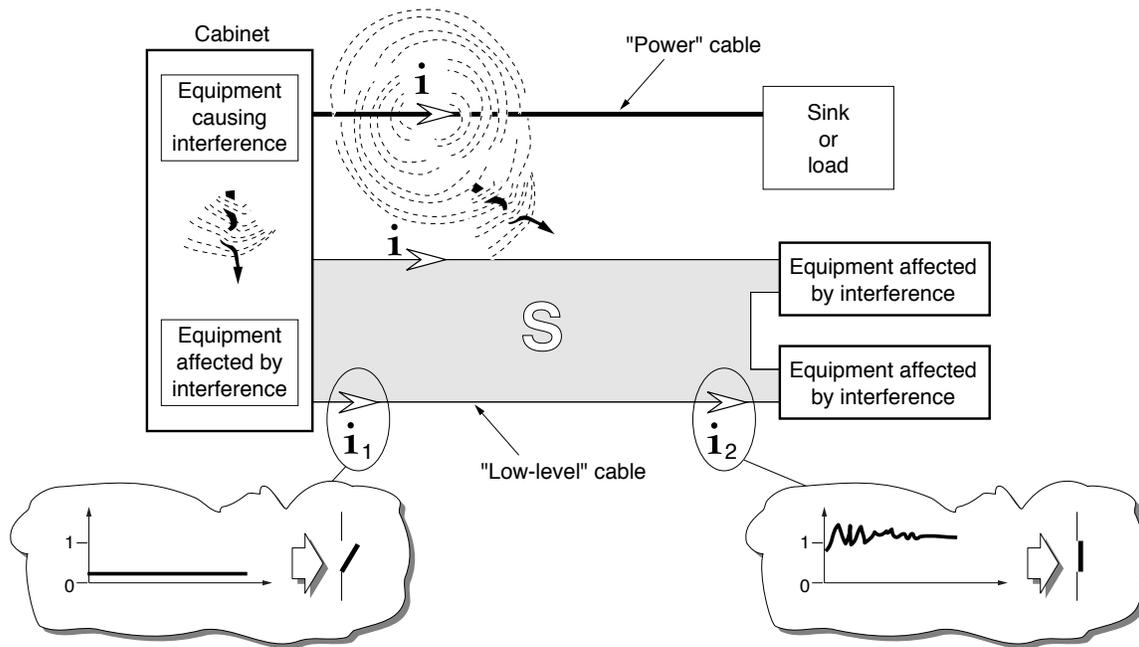

### Principle

Depending on the nature of the emitted interference, there are two types of possible coupling :

- Inductive coupling
- Capacitive coupling

# Transmission modes of electromagnetic interference




## Inductive coupling

A current  $I$  flowing through an electric conductor creates a magnetic field that is radiated around the conductor. It is clear that the current which flows must be high; it is usually generated by «power» circuits (which carry high current  $> 10$  A).

Any loop formed by an electric conductor having a surface area  $S$  and surrounded by a variable magnetic field will have an alternating voltage  $U$  across its terminals.

- 1
- 2
- 3

### Schematic diagram

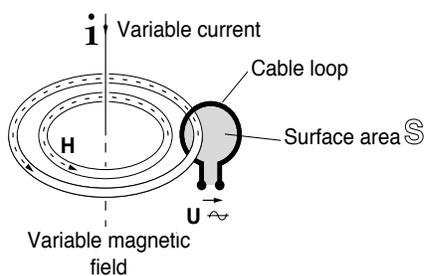

## Capacitive coupling


There is always a non-zero capacitance between an electrical circuit (cable, component, etc.) and another nearby circuit (conductor, frame connection, etc.).

The variable potential difference between these two circuits will cause the flow of an electric current from one to the other through the insulating material (air, etc.), thus forming a capacitor or stray capacitance.

This parasitic current increases as the frequency of the voltage across the terminals of the stray capacitance rises.

$$I = \frac{U}{Z} \quad Z = \frac{1}{C\omega} \quad I = \underbrace{UC 2\pi f}_k$$

$$I = kf$$

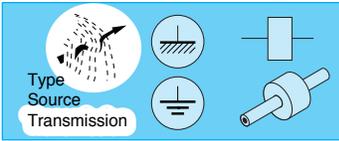


# Transmission modes of electromagnetic interference

## Coupling by radiation (continued)

- 1
- 2
- 3

This phenomenon is also referred to as «hand capacitance».

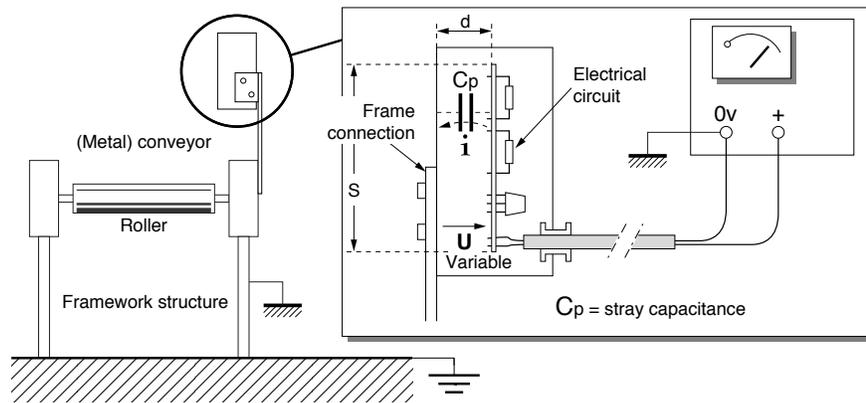


In addition, the value of the stray capacitance formed by both parts of the circuit is :

- Proportional to the opposite-facing surface areas of the two circuits (S),
- Inversely proportional to the distance between the two circuits (d).




*Although the stray capacitance between circuits may be completely negligible at 50 Hz, it becomes significantly important at high frequency (HF) and causes the installation to malfunction.*


# Transmission modes of electromagnetic interference

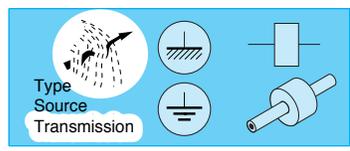

*A few sources of electromagnetic interference :*

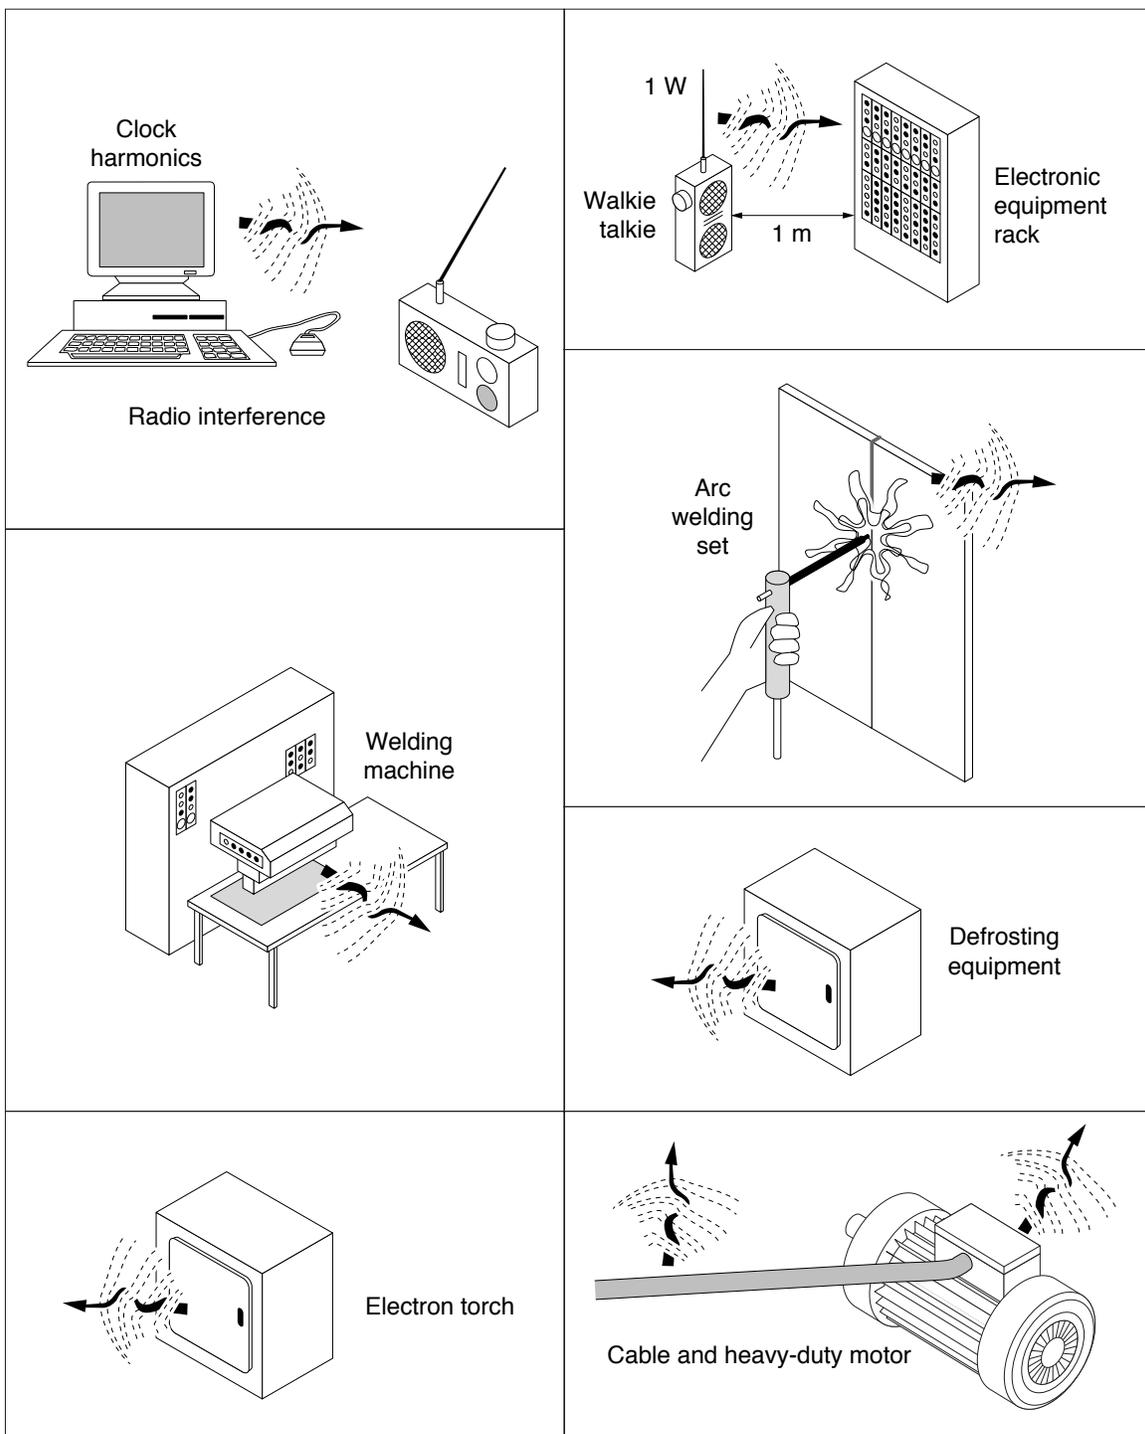

- 1
- 2
- 3



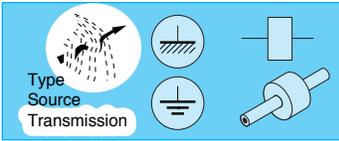


# Transmission modes of electromagnetic interference

## Decoupling of interference

### Isolating transformers


- 1
- 2
- 3

Transformer	Symbol	Isolation	
		LF	HF
Standard		OK	Ineffective
Single screen		OK	Average
Double screen		OK	Good

### Transformers

-  Can be used to change the earthing arrangement anywhere in the installation,
-  Only ensure satisfactory electrical isolation at low frequency (LF),
-  A double-screen transformer is required if appropriate electrical isolation has to be ensured at HF,
-  Block and divert common-mode currents to exposed conductive parts
-  Can be used to break frame connection loops,

### Explanation of phenomena

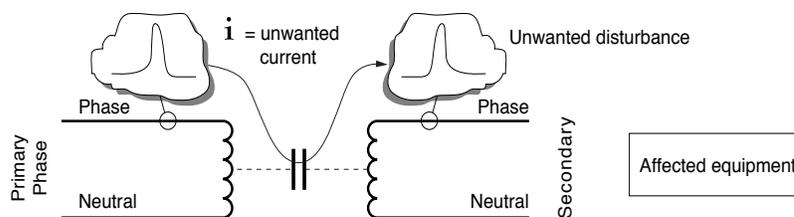

# Transmission modes of electromagnetic interference



## Direct current or low frequency (LF) (50 Hz etc.)

Primary/secondary insulation resistance  $\geq 10 \text{ M}\Omega$   
 Stray capacitance is negligible.

## High frequency (HF)

The primary/secondary insulation resistance is bypassed by the stray capacitance caused by the primary and secondary windings.


Stray capacitance  $\leq 50 \text{ pF}$  for small transformers,  $> 1 \text{ nF}$  for large transformers  $> 500 \text{ VA}$ .

1 nF only represents an impedance of  $100 \Omega$  at a frequency of 2 MHz.


- 1
- 2
- 3

## Consequences

As a result, there is risk of any disturbances, e.g. of the transient type with steep wave fronts, in the supply system which originate, for example, from switching surges being transferred to the secondary of the transformer and interfering with equipment that is connected to it.

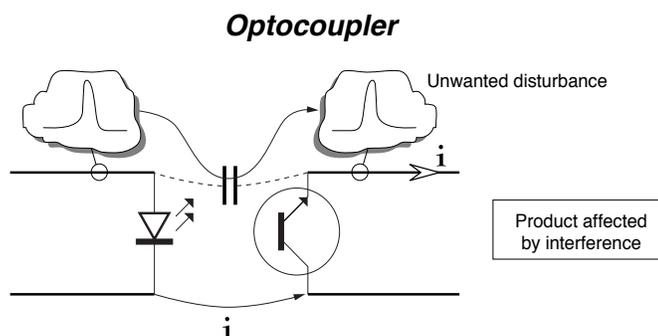

The phenomenon is the same with optocouplers although their low-frequency (LF) impedance and high-frequency (HF) performance are generally better than those of signal transformers.

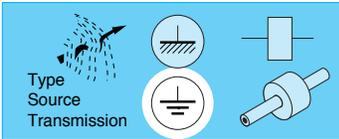

# Earth

Symbol : 

For the purposes of this document, the term «earth» denotes all conductive, inaccessible or buried parts or structures.

Although this definition is not official, it will enable us to identify the earth and frame connections in an installation more clearly.

## General definition

1

The earth of our planet is used in certain electrical engineering applications as a conventional «0 V» reference potential and its electrical conductivity (which is highly variable) naturally conducts - or is used by humans to conduct - certain electric currents.

2

## Roles of earth connection in electrical installations

### *Reminder*

***Any current that flows in the earth entered it and will leave it to return to its source***

3

### Applications :

- Distribution of direct lightning-stroke current in the earth «electrode» (disruptive electrostatic discharge from atmosphere to earth).
- Flow of currents induced by lightning in the soil between two points of an overhead power transmission line.
- In the T-T system, the part of the earth between the earth connection of the distribution system and the earth connection of the installation causes the flow of (low) leakage or fault currents produced by the installation.
- Frame connections of installations are also connected to earth (equipotential bonding between earth/soil relative to exposed conductive parts and metal structures) in order to protect persons (and animals) against shock hazards associated with indirect contact.

## Electrical earth connections


The provisions concerning these connections in the context of distribution systems of buildings that are relevant to us relate to the following applications (protection of persons and property) and are restated in Standards IEC 364 and IEC 1024.

***There must be a single satisfactory earth connection for a given electrical insulation***

Satisfactory because the downloads of lightning arresters occasionally have to handle currents of the order of 20 to 30 kA in soil of highly variable resistivity ( $\approx 5$  to 10 000 W.m) without causing excessive damage to the soil/earth connection interface.


Single because the highly variable resistance of the soil may involve extremely high, destructive potential differences under these extreme conditions between the various earth electrodes and that of the installation itself under normal operating conditions (leakage, fault currents, etc.) and this may cause unacceptable interference.

# Earth



## Typical earthing arrangement for an installation


- (A) Lightning arrester downloads.
- (B) Meshed, buried earthing system with special reinforcement at the bottom of lightning arrester downloads.
- (C) Earth electrode conductor of installation connected to earth bus at origin of PE (or PEN) conductors of the installation.
- (D) Interconnected exposed conductive parts of part of the installation connected to metal structures or additional meshed elements (E).
- (E) Shunt connections between lightning arrester downloads, interconnected exposed conductive parts and nearby metal structure in order to prevent any flashover (fire risk).

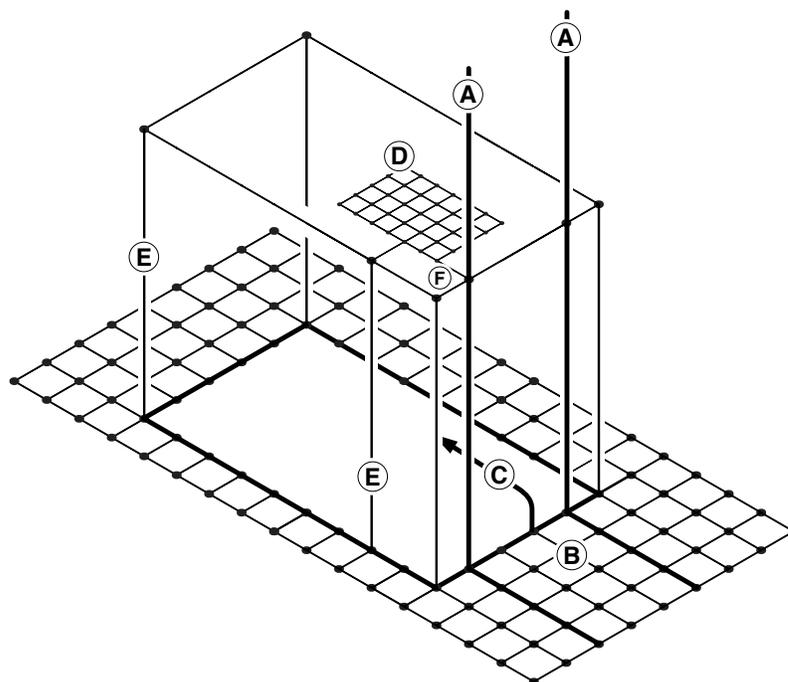

## Earth and electromagnetic compatibility

As we have seen, the earth plays a quite specific role in relation to lightning discharges but residual currents conducted by power lines to the site still have to be eliminated.

For most other (EMC) phenomena that have to be dealt with (*transients, high-frequency (HF) currents or radiated fields*), **earthing conductors** of which the length and topology (*star network or in parallel with live conductors*) present extremely high impedances at high frequency (HF) **will be of no use without the help of a system of interconnected exposed conductive parts.**

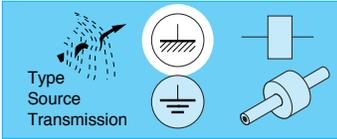

# Frame connections

Symbol : 

## General definition

A frame connection is an equipotential connection point or plane that may or may not be connected to earth and which is used as a reference for a circuit or system.

1

Note: a frame connection having a potential that is deliberately specific or variable must be the subject of special insulation and, if applicable, connection measures.

## Specific definition for electrical installations

2

A frame connection is any exposed conductive part of apparatus, equipment or an installation that is not live during normal operation but which may become so in the event of a fault.

3

Examples of frame connections (exposed conductive parts) :

- metal structure of a building (framework, piping, etc.),
- machine bed plates,
- metal cabinets, unpainted cabinet bottoms,
- metal cable troughs,
- transformer casing, Programmable Logic Controller backplate, etc.
- green/yellow wires (PE/PEN) of earthing conductor.


## Exposed conductive parts and safety of persons and property

Basic Specification IEC 364 and national texts that are specific to certain installations describe the constructional arrangements that guarantee compliance with adequate safety levels.


Regardless of the installation's earthing arrangement, green/yellow so-called «PE» or «protective earth» conductors having a defined impedance are provided for connecting exposed conductive parts to earth and to the origin of the installation so that :

- During normal operation or if there is a fault to an exposed conductive part :
  - high fault currents are eliminated (safety of property),
  - no hazardous voltage can occur between two exposed conductive parts, an exposed conductive part and the soil or metal structure (safety of persons),
- Since the safety of installations takes precedence over every other aspect, subsequent work on the connection of exposed conductive parts shall, under any circumstances, involve :
  - disconnecting a «PE» (green/yellow) conductor from an exposed conductive part,
  - increasing the impedance of any «PE» connection.

# Frame connections

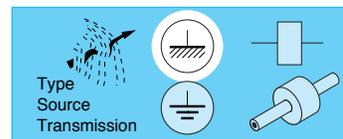

## Exposed conductive parts and electromagnetic compatibility

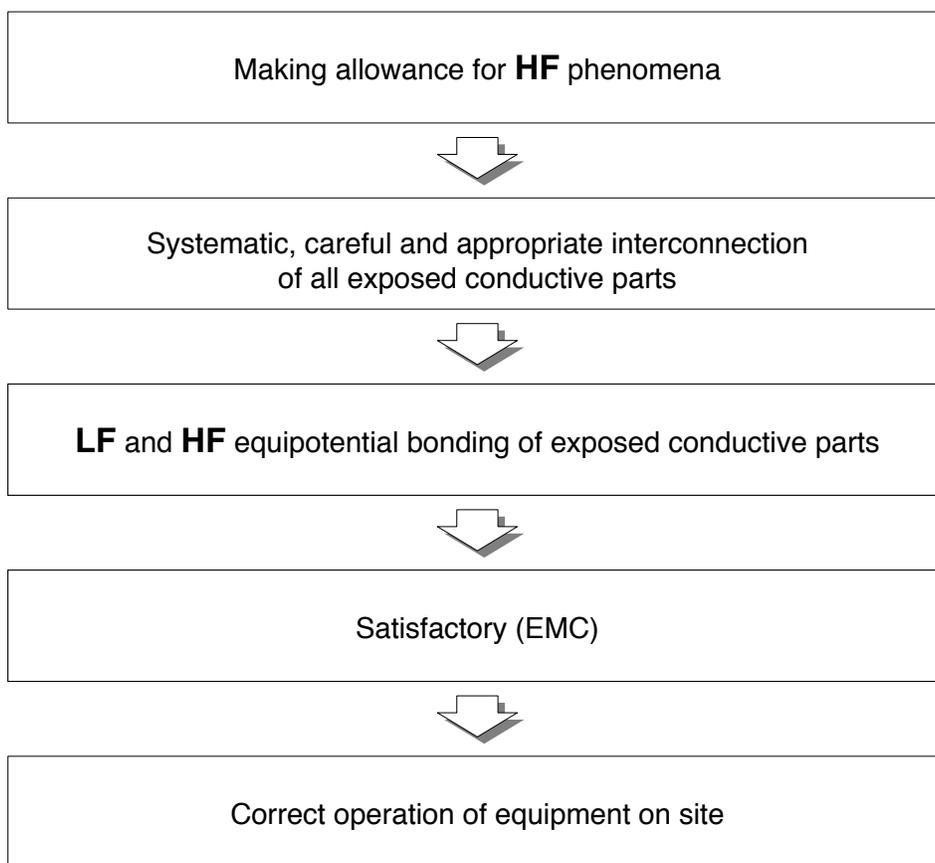

1


2

3

### *Low-frequency (LF) performance*

Example: at mains frequency (50 or 60 Hz).

Equipotential bonding of exposed conductive parts at low frequency (LF) (50 Hz-60 Hz) is always correctly obtained using green/yellow (PE/PEN) conductors.

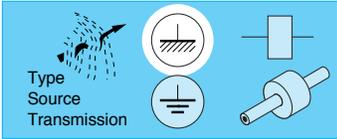

# Frame connections

## High-frequency (HF) performance

As stated in the paragraph dealing with earthing, the earth plays a relatively limited role in terms of (EMC) phenomena.

*In contrast, exposed conductive parts located in the immediate vicinity of electronic devices act as a reference «plane» or system for high-frequency (HF) phenomena (as well as for certain aspects at a frequency of 50/60 Hz) provided that the problem of their equipotential bonding is first solved.*

1

The interconnection of exposed conductive parts by protective conductors in a star configuration sometimes creates extremely high HF impedances between two points. In addition, high fault currents cause potential differences between two points and (in the TN-C system) the continuous flow of high currents in the PEN conductor.

2

It therefore appears necessary (without downgrading the role of PE conductors), to provide as many possible additional interconnections as possible (cables not coloured green/yellow) having a cross-sectional area that is not less than the smallest cross-sectional area of the PE conductors connected to the exposed conductive parts in question. These connections must be made close to the exposed conductive parts of switchgear, cable runs, existing or deliberately added metal structures, etc.

3

Screens, shielding, common-mode return circuits of filtering devices, etc. will be connected to them.

*This will create finely meshed equipotential bonding of exposed conductive parts that meets (EMC) requirements*

In some exceptional cases (currents induced at mains frequency, potential differences, etc.) connection to the frame earth system will have to be obtained appropriately (e.g. at one end for each «HF»/»LF» capacitor, etc.



## Leakage current in the installation

Because of their proximity to the electrical circuits of the installation, exposed conductive parts will, in conjunction with these circuits, create stray capacitance that will cause the flow of undesired currents through equipment and exposed conductive parts.

In some cases this may result in the malfunctioning of installations (tripping of differential protection devices, etc.).

[The reader should refer to the various transmission modes \(radiated interference, capacitive coupling\).](#)

# Frame connections

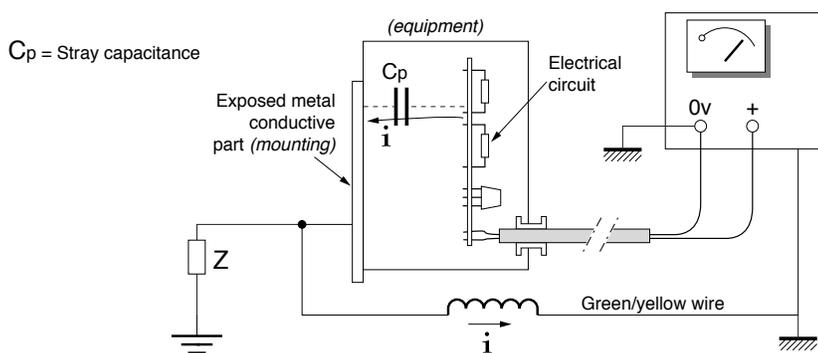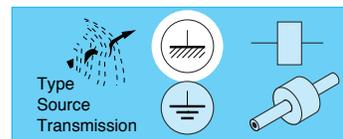


- 1
- 2
- 3

 Exposed conductive parts must therefore be connected by appropriate means at low frequency (LF) (safety of persons, etc.) and at high frequency (HF) (satisfactory EMC).

 This will only be effectively feasible in technical and economic terms if :

- the problem is taken into account at the **DESIGN** stage,
- the **HF** aspects of an installation are mastered

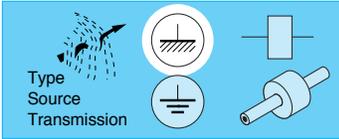


# Frame connections

## Loops between exposed conductive parts

- 1
- 2
- 3


A loop between exposed conductive parts is the surface area enclosed between two frame-connection wires.

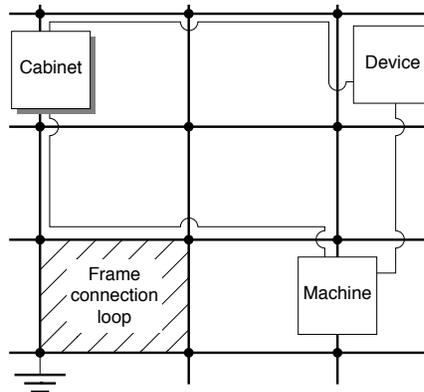

***Loops between exposed conductive parts are the result of systematic, careful interconnection to ensure equipotential bonding at a site***


***It is vitally necessary to have a large number of connections between all exposed conductive parts.***

# Frame connections



## Frame connection loops

A frame connection loop is the surface area enclosed between a functional cable (power supply cables, control lines, communication network, etc.) and the nearest conductor or frame earth.

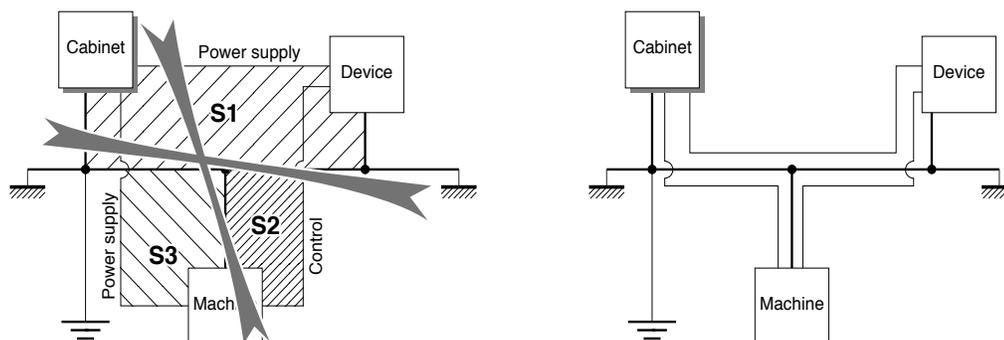

1

2

3




The number of frame connection loops is the same as the number of functional cables.

**It is crucial to minimise the surface area of frame connection loops** by running the entire length of functional cables as close as possible to exposed conductive parts




Frame connection loops are the main source of (EMC) problems, coupling of radiated interference is especially effective in them.

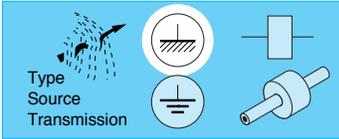

# Frame connections


## Avoid earthing exposed conductive parts in a star configuration

1


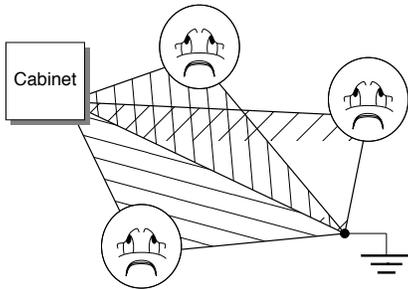


Large surface-area frame connection loops

2

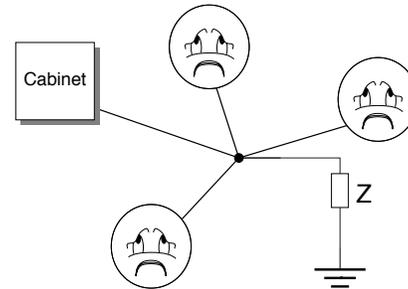


3

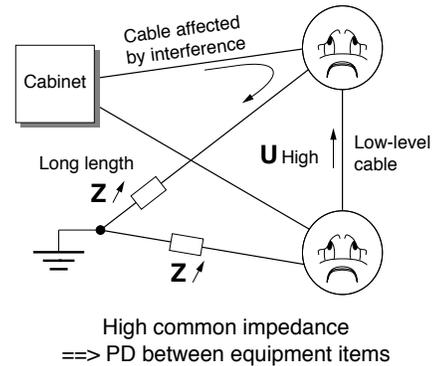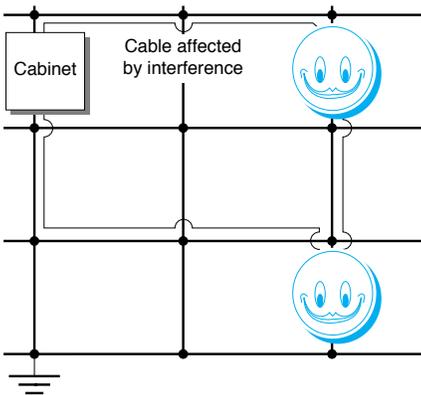

It is crucial not to earth exposed conductive parts in a star configuration.

**Only systematic, careful interconnection of exposed conductive parts makes it possible to achieve satisfactory high-frequency (HF) equipotential bonding on the site.**

# Cables

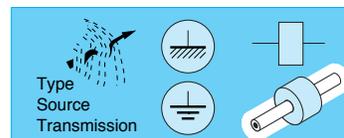


## Frequency behaviour of a conductor

The level of electromagnetic compatibility (EMC) in equipment is linked to the coupling between its circuits and this coupling itself depends directly on the impedances between these circuits.


 The conductors used and their mounting arrangement therefore have a decisive influence on the electromagnetic behaviour of the installation.

- 1
- 2
- 3

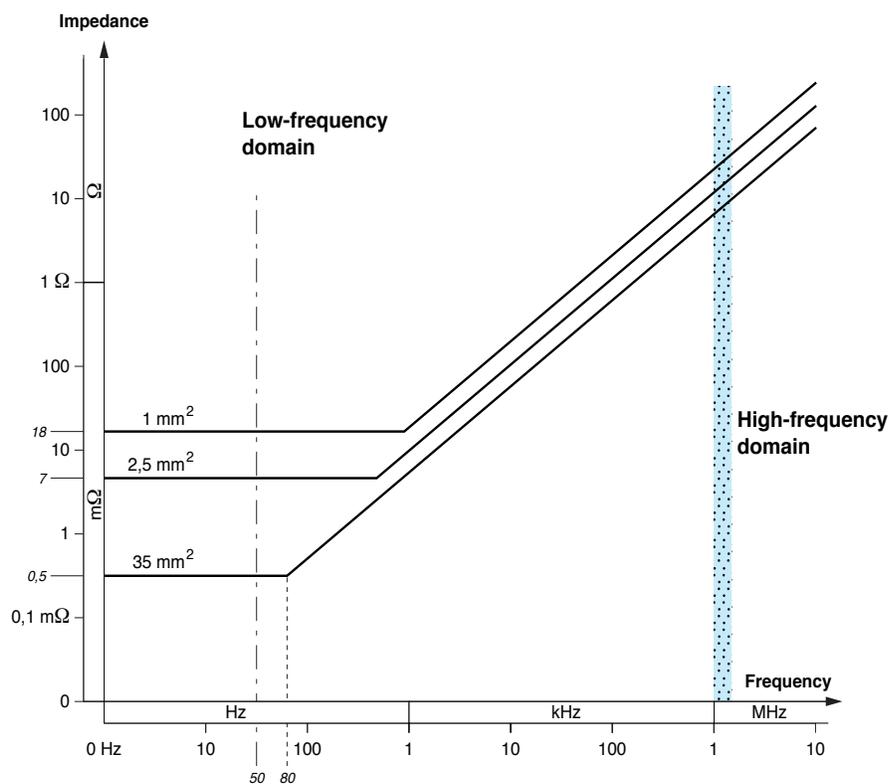

Typical impedance values of an electrical conductor of length  $L = 1$  m

At 100 kHz, two 1 mm<sup>2</sup> cables laid parallel have less impedance than a 35 mm<sup>2</sup> cable ==> hence the benefit of meshed connection.

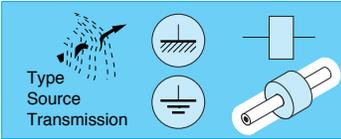

# Cables

## Low-frequency (LF) performance

At low frequency (LF), current flows through the conductor whereas the skin effect is dominant at high frequency (HF). Current then flows at the surface of the conductor.

 At low frequency (LF) (50 Hz-60 Hz), the cross-sectional area of the wire plays a leading part


1

## High-frequency (HF) performance

-  At high frequency (HF) ( $f \approx > 1 \dots 5 \text{ MHz} \dots$ )
- The circumference of the cross section of the conductor plays a leading part (skin effect)
  - The cross-sectional area of the conductor is relatively insignificant
  - The length of the cable is decisive

2

3

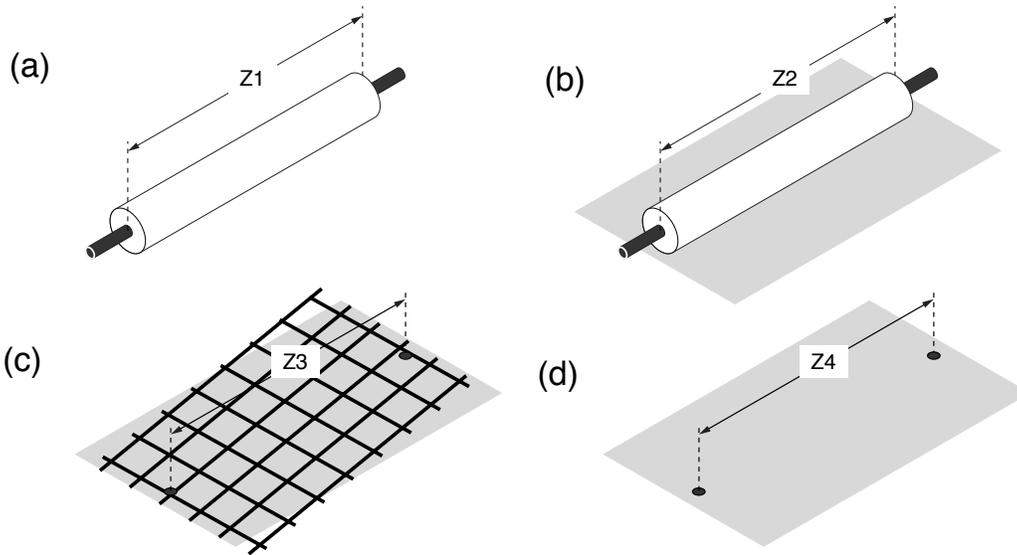


In each case :

- a :  $Z_1$ , cable in air (inductance per unit length :  $l \approx 1 \mu\text{H/m}$ ).
- b :  $Z_2$ , cable mounted on a metal surface.
- c :  $Z_3$ , metal grid with contact at each intersection (e.g. welded concrete reinforcing rods).
- d :  $Z_4$ , metal plane.

For a given length of cable, the impedances per unit length are of the order  $Z_1 > Z_2 > Z_3 > Z_4$

# Cables

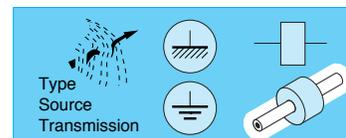

## Length and cross-sectional area of a conductor

The impedance of a conductor depends primarily on its inductance per unit length which is proportional to the length of the cable.

This inductance begins to play a decisive role above 1 kHz in the case of a standard cable.

This means that, with a conductor that is just a few metres long, the impedance of the cable is as follows :

- several milliohms with direct current or at low frequency (LF)
- several ohms at around 1 MHz
- several hundred ohms at high frequency (HF) ( $\approx 100$  MHz ...)

1

2

3



**If the length of a conductor exceeds 1/30 of the wavelength of the signal it carries the impedance of the cable becomes «infinite».**

==> the installation then behaves as if there was no conductor.

$$L_{(m)} > \frac{\lambda}{30}$$

$\lambda$  : wavelength of signal on conductor


$$\lambda > \frac{300}{f_{(MHz)}} \implies$$

f : frequency of signal on conductor in MHz

$$L > \frac{10}{f_{(MHz)}}$$

L : length of conductor in metres

 A conductor is useless if  $L > \frac{10}{f_{(MHz)}}$ . Example : pigtail

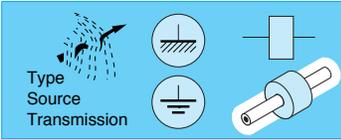


# Cables

## Antenna effect of a conductor

Conductors act like antennas and the field which they radiate can be picked up. Such conductors can cause emission when a high-frequency (HF) current flows through them.

- 1
- 2
- 3

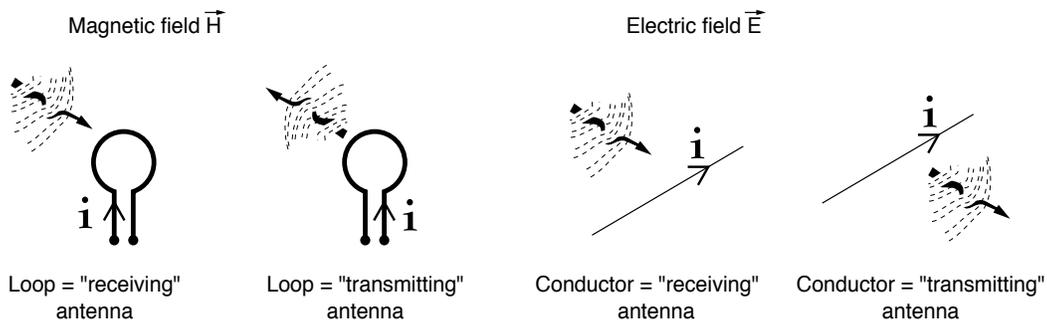

### Length of antennas

The antenna effect becomes highly significant for conductors of specific length in relation to the wavelength of the radiated signal.

①  $L = \frac{\lambda}{4}$  So-called "quarter-wavelength" antenna

$L_{(m)} > \frac{75}{f_{(MHz)}} \implies$  Tuned antenna


Example :  $f = 100\text{MHz}$        $L > \frac{75}{100} = 0.75 \text{ m}$

**At this frequency (100 MHz) a conductor of length  $L > 0.75 \text{ m}$  becomes an effective antenna.**

②  $L = \frac{\lambda}{2}$  So-called "quarter-wavelength" antenna



# Cables

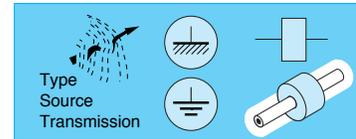

## Green/yellow PE/PEN conductor

In old installations that were built without making allowance for HF phenomena, the length of the green/yellow (PE/PEN) conductors ( $L > 1$  to 2 m) is such that they :


- ==> *effectively contribute towards LF (50 Hz-60 Hz) equipotential bonding of the site and therefore to the safety of persons and property (IEC 364, NF C 15 100 etc.).*
- ==> *play practically no role in HF equipotential bonding and therefore the (EMC) of the site.*

**1****2****3**

## Interconnection of exposed conductive parts

***It is crucial to obtain careful, systematic interconnection of all exposed parts in order to achieve HF equipotential bonding.***

- ==> *If the length of the frame earth cable is too long ( $L > 10/F$  (MHz)), the installation then becomes «floating», potential differences between equipment items inevitably occur and these cause the flow of undesirable currents.*

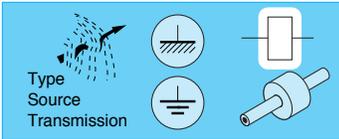


# Filters

## Function of a filter

- 1
- 2
- 3

The function of filters is to allow useful signals through and eliminate the unwanted portion of the transmitted signal.

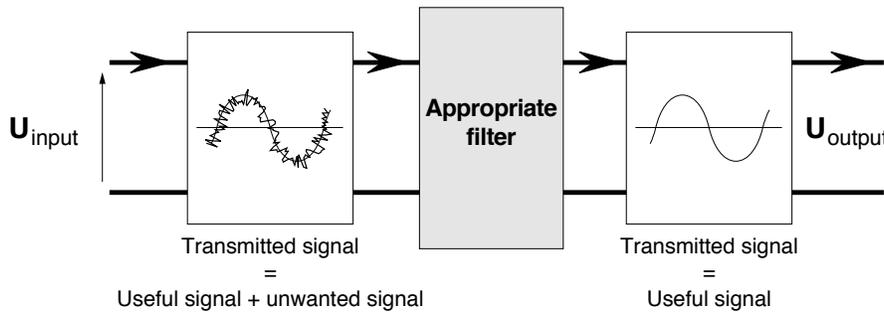


### Field of application :

- Harmonic filters,  $F \leq 2,5 \text{ kHz}$
- RFI filters (conducted radiofrequency interference)  $F \leq 30 \text{ MHz}$


### Direction of action :

- Input filters
- Example : harmonic filters, RFI filters


These protect the supply system against disturbances generated by the powered equipment.

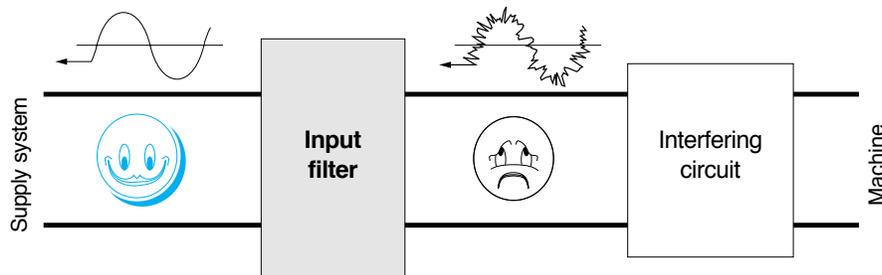

# Filters

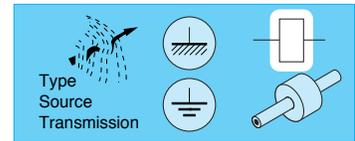

Filters also protect equipment from disturbances originating from the supply system.

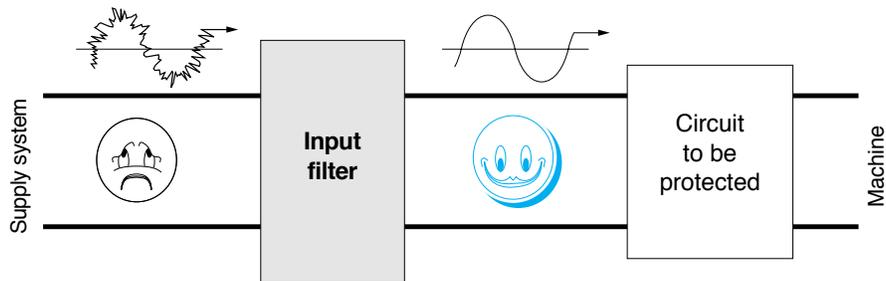


1

- Output filters
- Examples: «sine-wave» filters

2

These protect the load against disturbances originating from the equipment.

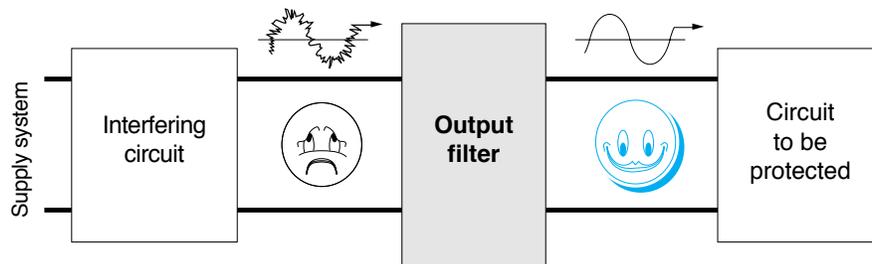

3


## Various filter types

### Types of filtering :

- Differential-mode filters
- Common-mode filters
- Combined filters that provide both common-mode and differential mode filtering.

### Technology


- Passive filters
- Active equalizers

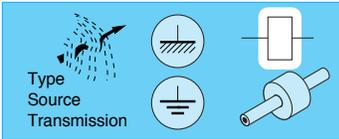

# Filters


## Passive filtering principle = impedance mismatching

- Blocking of disturbances: series inductance ( $Z = L\omega$ )
- Channelling of disturbances: parallel capacitance ( $Z = \frac{1}{C\omega}$ )
- Combining both the above

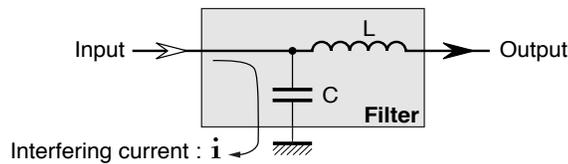


- Dissipating the energy of the disturbances: ferrite cores

### Passive filtering in «differential mode»

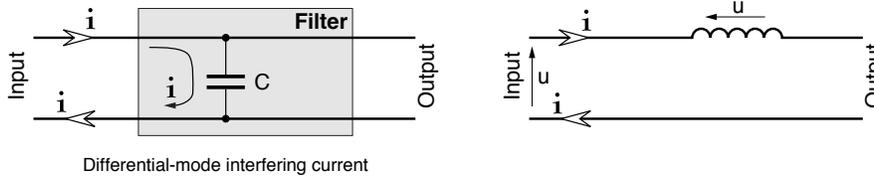

Differential-mode interfering current

### Passive filtering in «common mode»

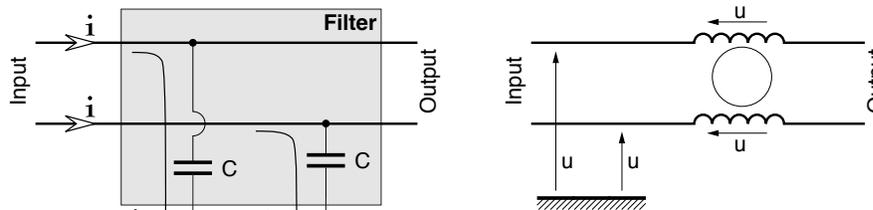

Common-mode interfering current


In differential mode the 2 chokes cancel each other out because they are wound in the opposite direction on the same core.

### Principle of active equalizer

- Only used for filtering out harmonic currents,
- Generates a signal that is the complement of the interfering signal in order to restore a sinusoidal signal.


- 1
- 2
- 3

# Ferrite cores

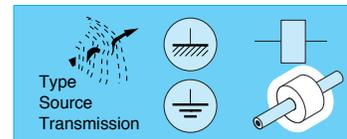

These are common-mode high-frequency (HF) filters.

Ferrite cores consist of a material having a high magnetic permeability ( $\mu r$ ).

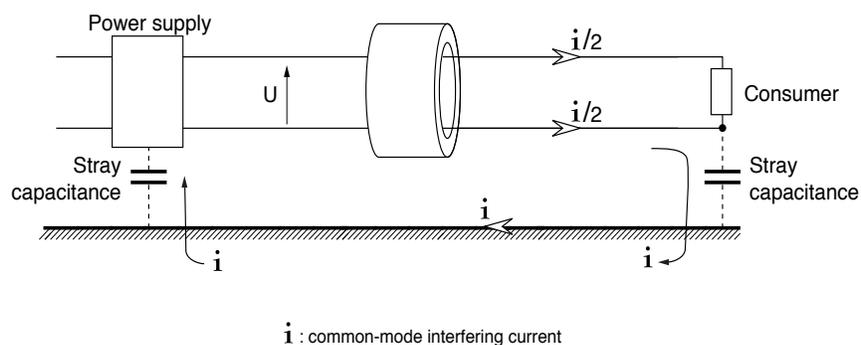


- 1
- 2
- 3

Ferrite cores make use of two principles :

- common-mode inductance (see Filters paragraph)
- absorption of resistance losses (temperature rise) induced by common-mode HF interference.

Both these principles result in a common-mode impedance of which the effectiveness depends on its relationship to the impedance of the circuit to be protected.

# CHAPTER 2

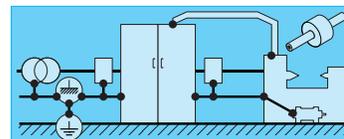


# OBTAINING ELECTROMAGNETIC COMPATIBILITY IN AN INSTALLATION

1

2

3

-- *CODE OF PRACTICE* --



# Foreword

---

The design, production, modification or maintenance of equipment always begin with an analysis intended to define the:

- characteristics of materials and components capable of fulfilling the required function,
- mechanical and electrical design rules making it possible to fulfill the desired function.

1

2

Such analysis is carried out taking into account both engineering and economic constraints.

From this point of view, it is advisable to bear in mind **the importance of ensuring the electromagnetic compatibility of an installation right from the start of the design stage.**


3

This is the best guarantee against malfunctions and cost escalation.

Neglecting (EMC) during analysis of a product may produce an immediate cost saving of several percent of the total cost of the plant ((EMC) specialists agree that the extra cost is 3 to 5%).

However, modifications then often have to be made at the time the installation is commissioned. The overall cost of such modifications, given low operating margins, often exceed several or even twenty percent. This causes additional delivery delays as well as problems in customer relations.

# The (EMC) procedure

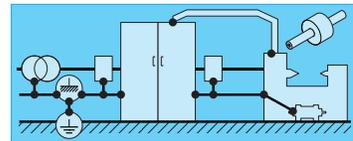


## The (EMC) procedure must be comprehensive

Correct operation relies on the good design, correct selection and proper workmanship of all the links in the chain of the installation.


*Regardless of the life cycle of the installation, the CODE OF PRACTICE defined below must be applied seriously and methodically.*

- 1
- 2
- 3

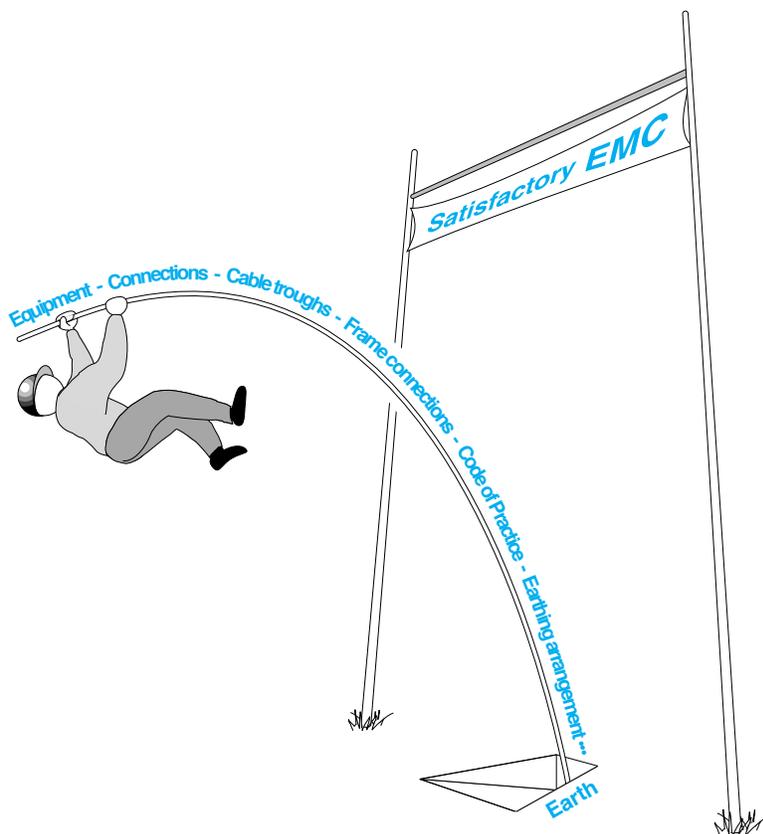

The interpretation of (EMC) and HF phenomena in particular is complicated. A cautious attitude is therefore called for and one must not forget that there are no miracle answers or universal truths in (EMC).

Nevertheless, even though the constraints and therefore the action that can be taken are specific to each installation, applying this Code of Practice will create the greatest possible likelihood of achieving correct operation of the installation.



# The (EMC) procedure

## Designing a new installation or extending an installation

1

*DEFINITION OF (EMC)  
NORMATIVE SCOPE*

- Generic (EMC) standards
- Product standards

2

*ANALYSE*

- The environment
- External (public, private network, site, surroundings, etc.)
  - Internal (building, machine, nearby plant, etc.)

3

*DEFINE*

The constraints associated with the site and the application.

*DETERMINE*

Those (EMC) products and accessories that are compatible with the constraints (installations, specification sheet, etc.).

*ESTABLISH*

The installation rules needed to obtain satisfactory (EMC) (wiring rules, precautions, etc.).

*ERECT*

The installation, adhere scrupulously to the defined rules.

*CHECK*

Correct erection of the installation, correct operation of the equipment.


*IF APPLICABLE, MAKE ANY  
MEASUREMENTS*

If the standard requires this.

*CORRECT*


If applicable.

# The (EMC) procedure

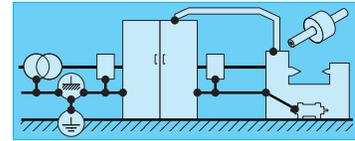

## Maintaining an installation or Upgrading - Updating installed equipment

(EMC) maintenance is a simple activity but it must be well organised, planned and carefully supervised.

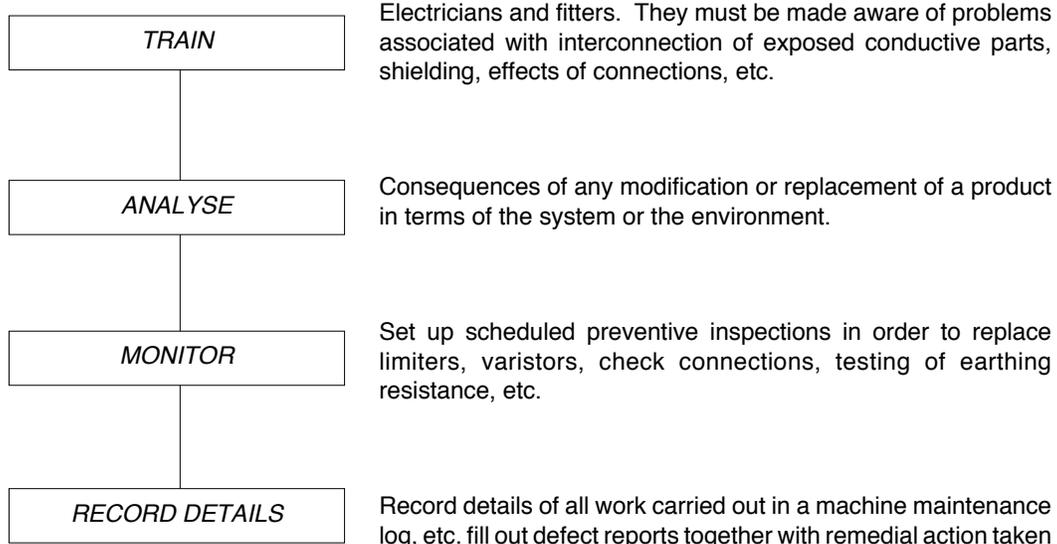

- 1
- 2
- 3


Compliance with these four rules always brings benefits to the company which extend beyond (EMC).

***Bear in mind that simple deterioration of an electrical connection (corrosion, forgetting to refit shielding, bolts missing from cable trough) is enough to seriously impair the (EMC) performance of an installation.***

### ***Upgrading installed equipment, extending a machine etc.***

The approach adopted must be the same as that during the design phase. It is vital to keep comprehensive documentation describing any modifications made in order to facilitate commissioning and future actions.

*Regardless of the life cycle of the installation, the CODE OF PRACTICE defined below must be applied thoroughly and methodically.*




# The (EMC) procedure

## Improving an existing installation


The causes of any malfunctions must be found and analysed.

- 1
- 2
- 3

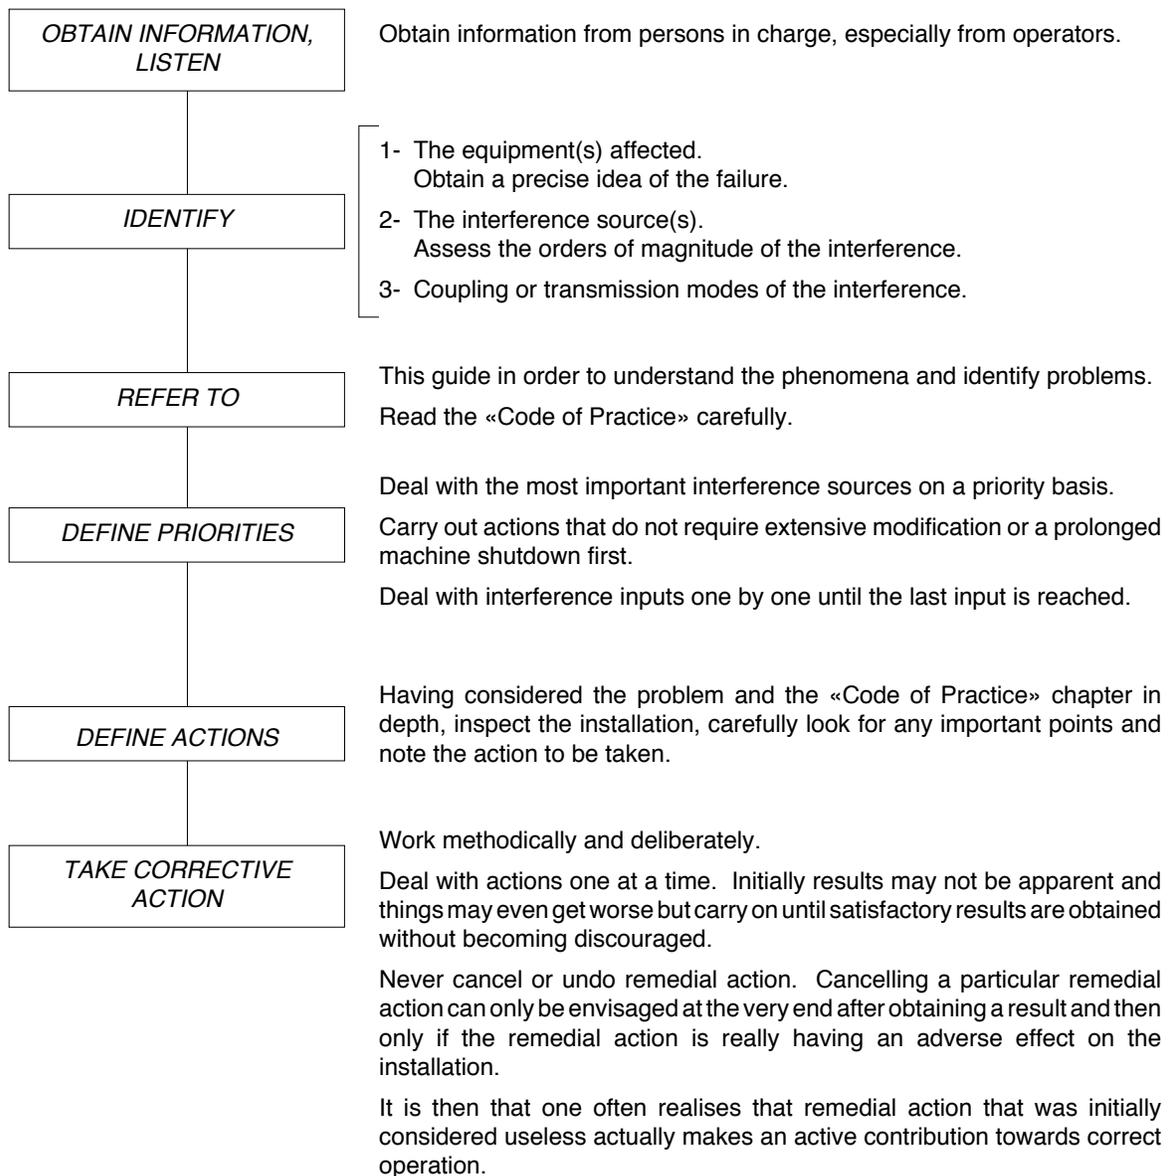

*If a fault cannot be reproduced or if there is a serious problem, the assistance of or action by an (EMC) specialist having in-depth knowledge of the products suspected of causing the problem may be required.*

# Code of practice

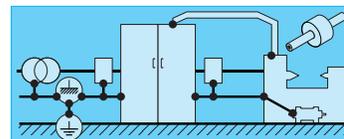

Changes in technology and techniques are making it possible to design and produce increasingly high-performance products, machines, etc.

It goes without saying that this also involves changes in constraints and that these entail changes in codes of practice for the design of installations.

***The Code of Practice consists of all the concepts that have to be taken into account in order to install equipment and electrical installations satisfactorily.***

1

Adhering to the Code of Practice produces a significant reduction in the constraints and costs associated with most common (EMC) problems.


2

<b>CHOICE OF COMPONENTS</b>	
Low-frequency (LF) phenomena	High-frequency (HF) phenomena
<ul style="list-style-type: none"> <li>• Protective systems</li> <li>• Filtering</li> <li>• Length of cables</li> </ul>	<ul style="list-style-type: none"> <li>• EQUIPOTENTIAL bonding of exposed conductive parts (interconnection)</li> <li>• Careful routing of cables</li> <li>• Selection of cables</li> <li>• Proper connections suitable for HF purposes</li> <li>• Shielding of cables</li> <li>• Cable troughs and cable runs</li> <li>• Length of cables</li> </ul>
<b>Protective systems more important</b>	<b>Installation more important</b>

3

## Related topics :

- [Earthing system](#) ..... page 8
- [Power supply](#) ..... page 18
- [Cabinet](#) ..... page 26
- [Cables](#) ..... page 32
- [Wiring rules](#) ..... page 36
- [Cable runs](#) ..... page 44
- [Connections](#) ..... page 52
- [Filters](#) ..... page 56
- [Surge arresters](#) ..... page 60
- [Ferrite cores](#) ..... page 62

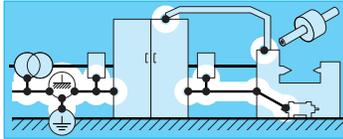

# Earthing system

## Introduction

1

**Low and high-frequency EQUIPOTENTIAL BONDING of exposed conductive parts is the golden rule in (EMC)**

2

 **LF and HF equipotential bonding of the site**  
==> *by appropriate specific interconnection, etc.*

 **Local LF and HF equipotential bonding**  
==> *by interconnecting all exposed conductive parts and, if necessary, providing a specific appropriate earth plane, etc.*

3

*Systematically interconnect all metal structures, racks, chassis, earth conductors.*

 **Connections**

(see paragraph entitled «Connections» later on in this chapter.

==> *Take special care to ensure that connections are properly made to obtain LF and HF quality and long service life.*


==> *Direct metal-to-metal bonding (no conductor) by bolted fastening.*

==> *Connection by braided metal strap or any other short, wide connection.*




**Do not overlook paintwork  
and coatings made of insulating materials**


# Earthing system

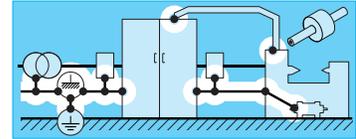

## Building

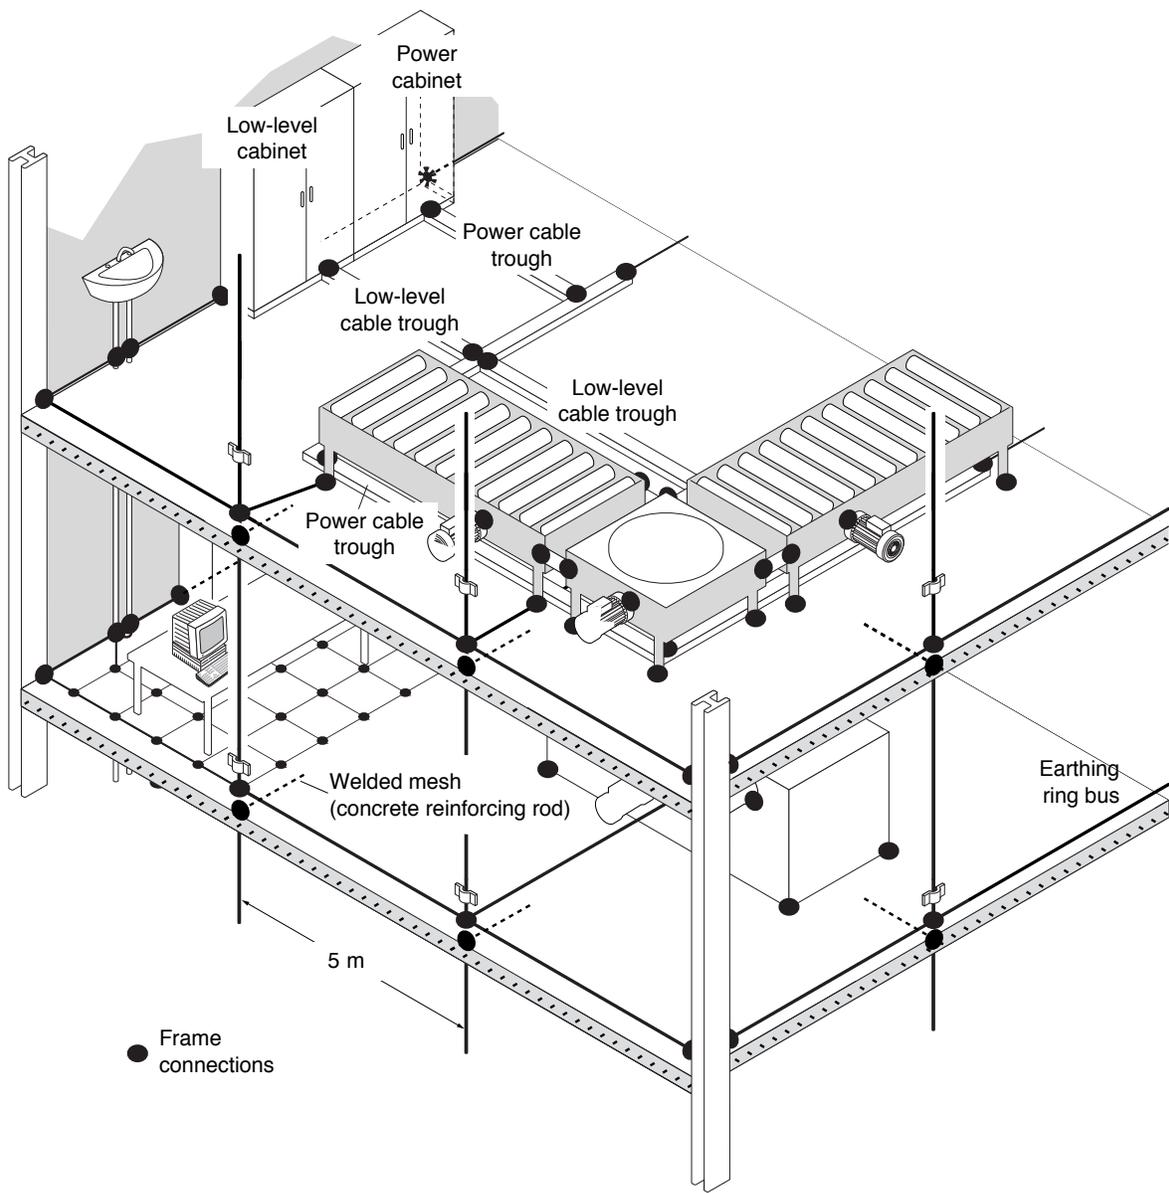

- 1
- 2
- 3



# Earthing system


## Building (continued)

1

### LF and HF equipotential bonding of the site

==> Provide an earth plane plus an earthing ring bus for each storey (mesh made of welded concrete reinforcing rods cast into the concrete slab, false floor with grid made of copper conductor, etc).

2

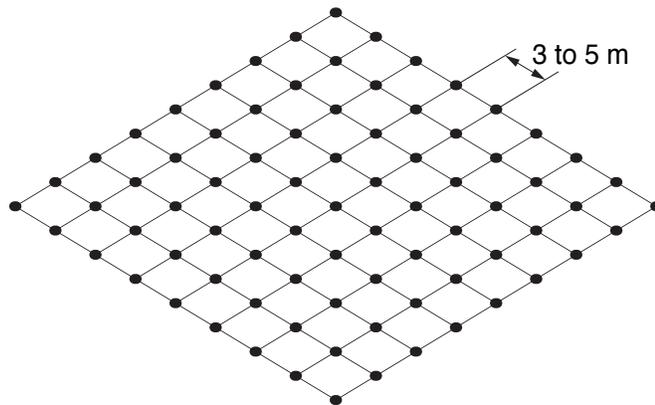


3

==> Interconnect all the metal structures of the building to the earthing system (metal steel structural work, welded concrete reinforcement, metal pipes and ducts, cable troughs, conveyors, metal door and window frames, gratings, etc.)

==> It is advisable to design and produce a special finely-meshed earth plane in areas intended to accommodate sensitive hardware (data processing, measuring system, etc.).

==> etc.

# Earthing system

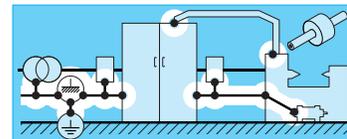

## Equipment / machine


### Local LF and HF equipotential bonding of the equipment or machine

- ==> *Interconnect all the metal structures of a single equipment item (cabinet, earth plane plate at bottom of cabinet, cable troughs, pipes and ducts, metal structures and frames of machine, etc.).*
- ==> *If necessary, add earth conductors intended to enhance the interconnection of exposed conductive parts (both ends of any conductor in a cable that are not used must be connected to frame earth).*
- ==> *Connect this local frame earthing system to the earthing system of the site by providing the maximum number of distributed connections.*

1

2

3

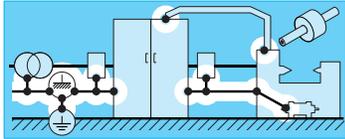

# Earthing system

---

## Cabinet

1

[See paragraph entitled «Component layout» later on in this chapter.](#)

 **LF and HF equipotential bonding of cabinet and its components.**

==> *Every cabinet must have an earth plane plate at the bottom of the cabinet.*

2




**Watch out for cabinet bottom plates coated in paint or any other insulating covering.**

3

==> *All the exposed metal parts of components and units fitted in the cabinet must be bolted directly onto the earth plane plate in order to ensure high-quality, durable metal-to-metal contact.*




==> *Because of its excessive length, the green/yellow earth conductor cannot generally provide HF quality earthing.*

# Earthing system

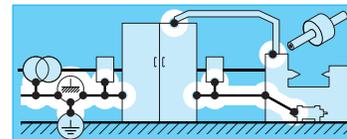


## Electrical connections

PE - PEN

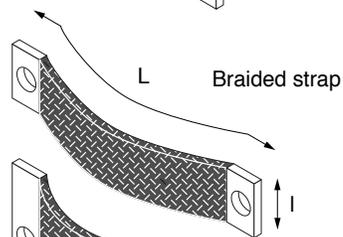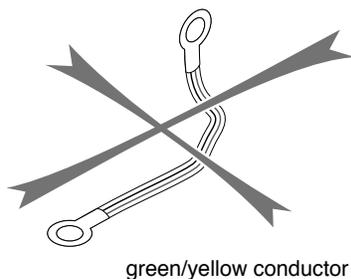


$$\frac{L}{I} < 3$$



- 1
- 2
- 3



**Equipotential bonding - Interconnection - Continuity - IEC 364 safety**



# Earthing system


## Daisychained interconnection of exposed conductive parts

— CABINET —

1


2

3

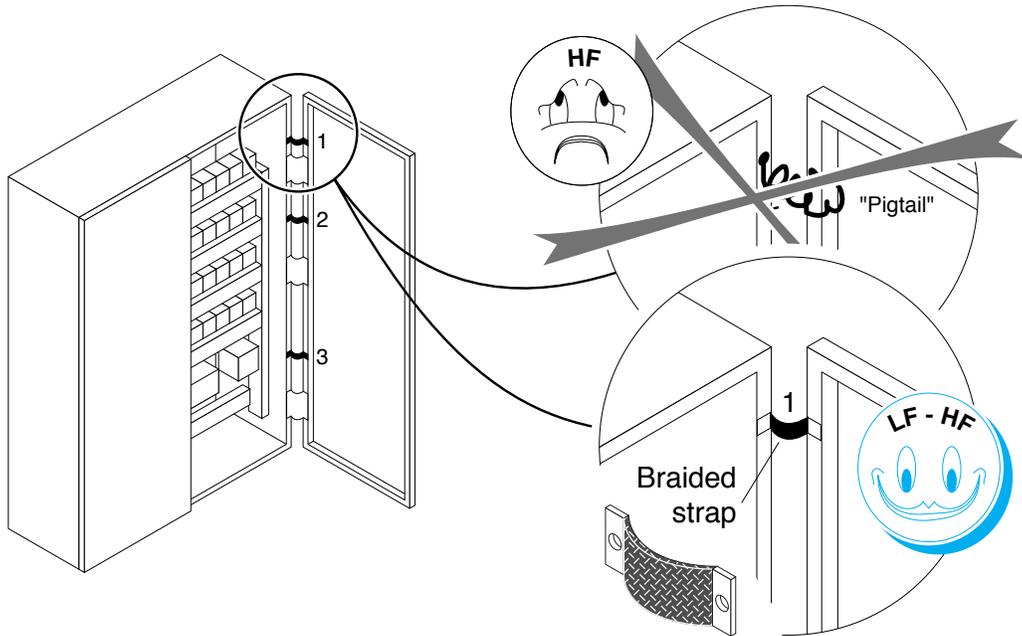


**Equipotential bonding - Interconnection - Continuity - IEC 364 safety**

# Earthing system

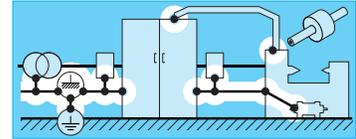


## Daisychained interconnection of exposed conductive parts

— CABINET —

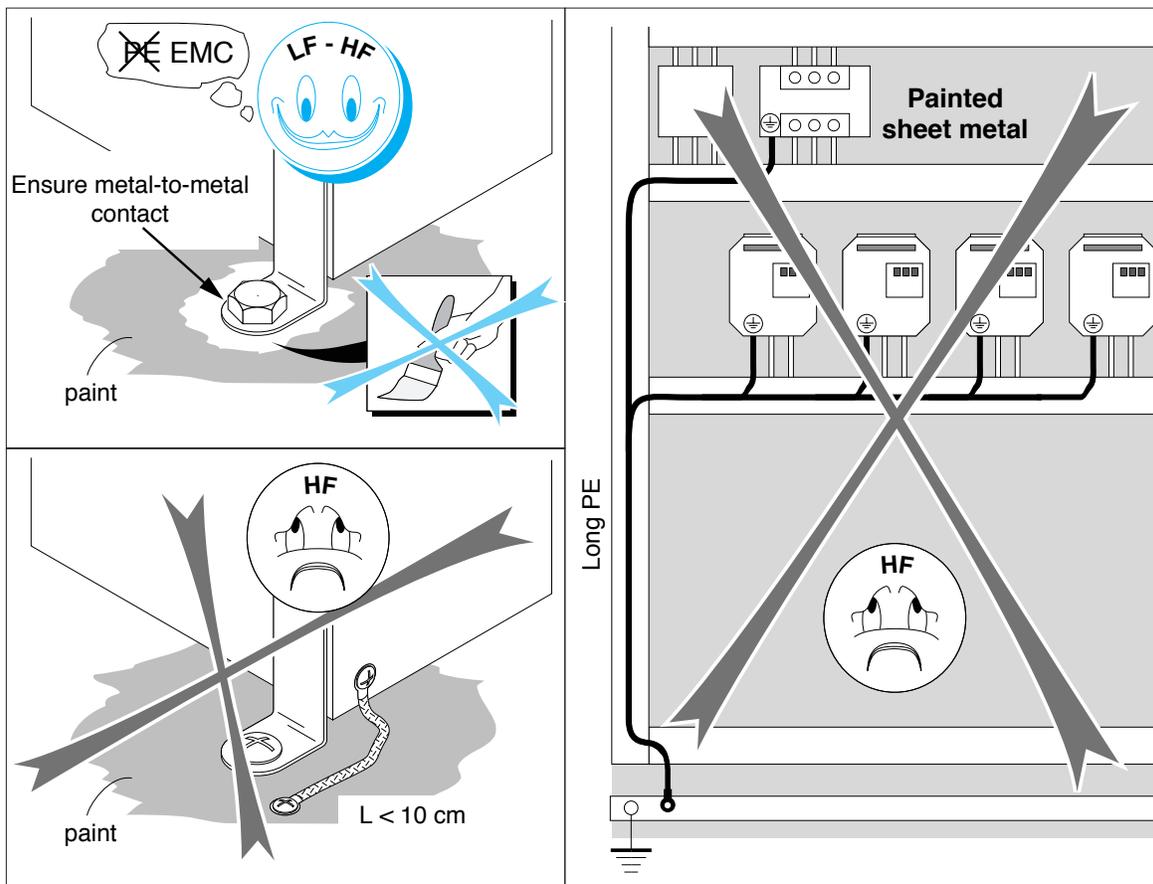

**Equipotential bonding - Interconnection - Continuity - IEC 364 safety**





# Earthing system

## Daisychained interconnection of exposed conductive parts


— INSTALLATION —

- 1
- 2
- 3

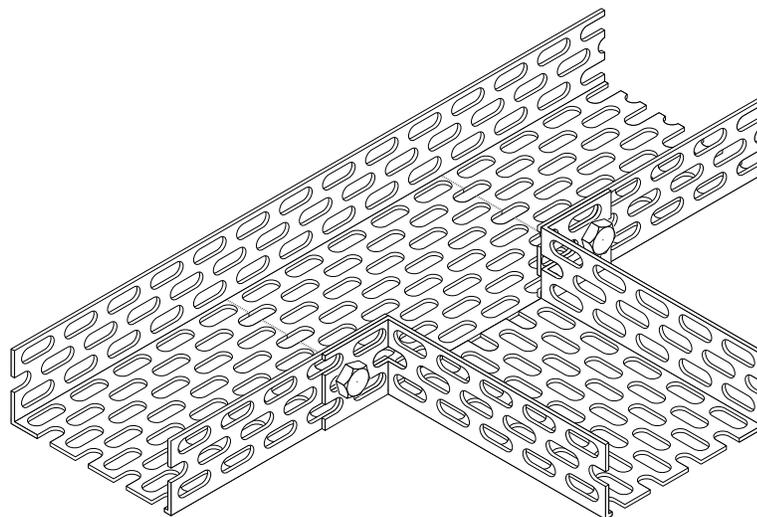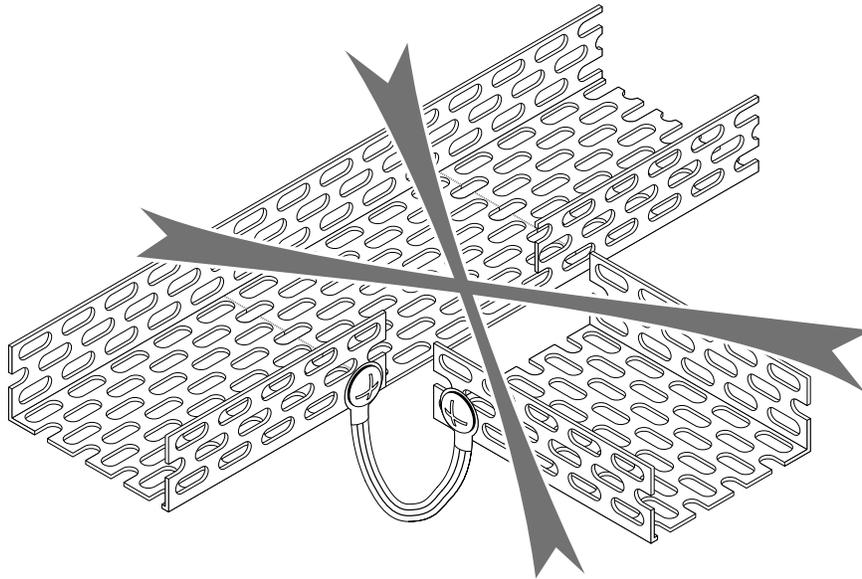


**Equipotential bonding - Interconnection -  
Continuity - IEC 364 safety**


# Earthing system

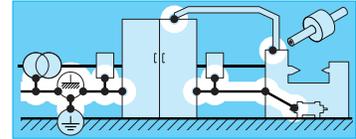

## Daisychained interconnection of exposed conductive parts

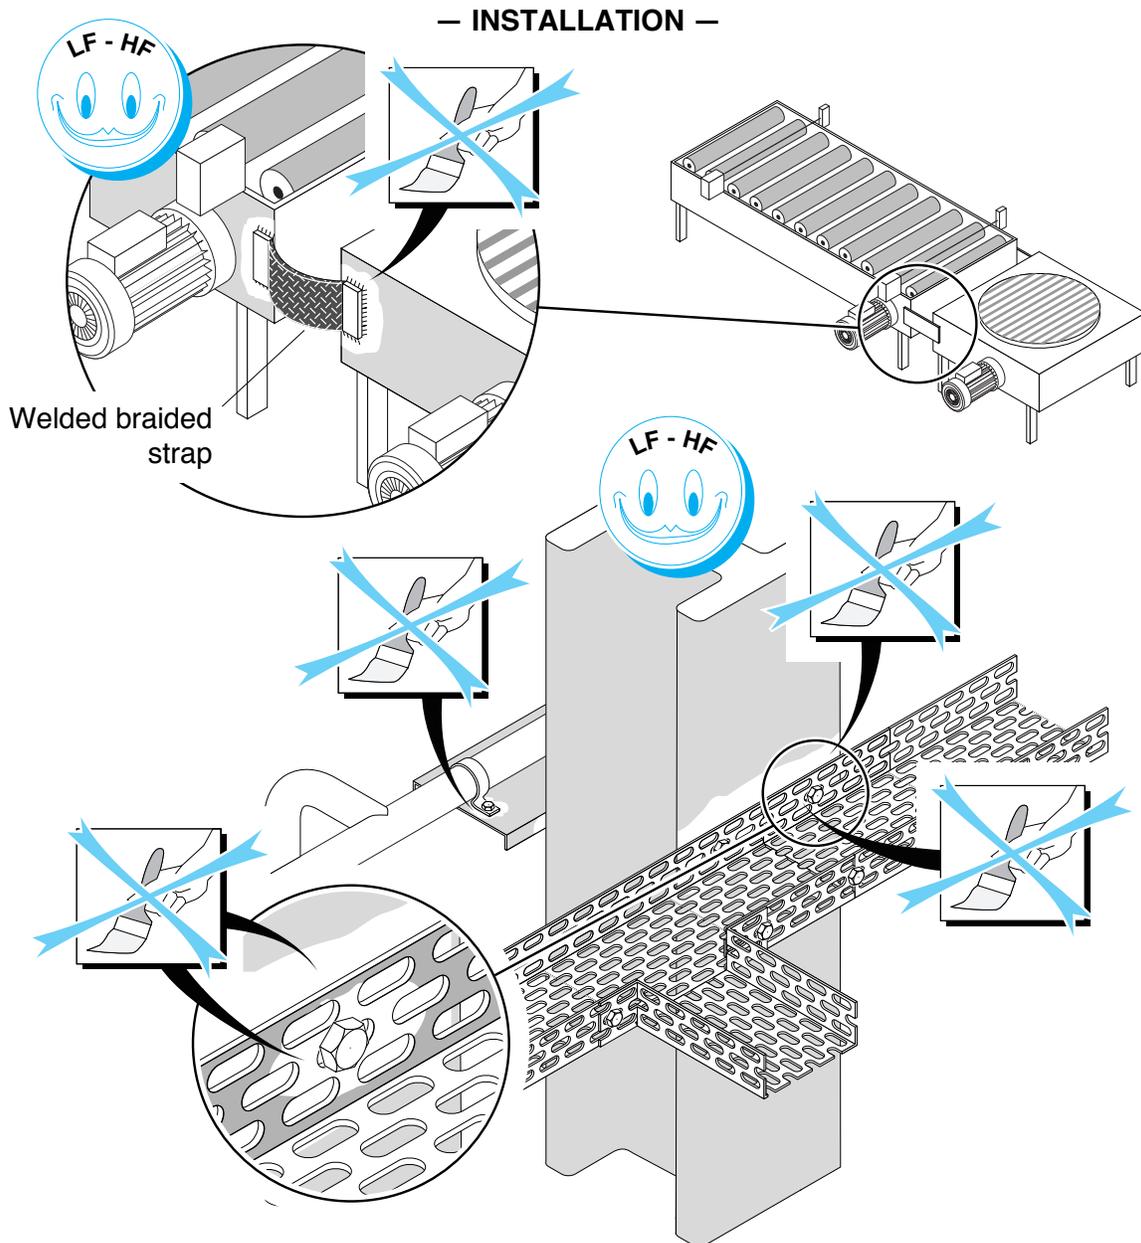

**Equipotential bonding - Interconnection - Continuity - IEC 364 safety**



# Power supply

## Purpose

**To provide high-quality power supply and a degree of availability making it possible to achieve correct operation of the installation.**

1

The power supply is an interface between various electrical supplies :

- Public (LV) mains and customers,
- (MV) mains and industrial customers,
- Within a single installation, between general circuits and outgoing feeders.

2

3




### General rule :

- Filter the power supply  
*A properly adjusted industrial mains filter is suitable.*
- Fit limiters, spark gaps on the power source.  
*Site these components which cause interference during operation away from sensitive equipment.*



# Power supply

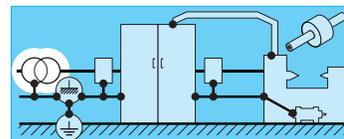

## Analysis

### Upstream circuit

Identify potential interference sources and the type of disturbance (nature, intensity, frequency, etc.) that might affect the power supply.

### Downstream circuit

Identify the various equipment items powered and the type of disturbance they generate which might affect the power supply.

Assess the effects and possible consequences of such disturbances on the installation to be powered.

- Acceptable or unacceptable consequences (continuous, intermittent, etc.)
- Seriousness and cost of impact of interference
- Cost of installation
- Expected availability and reliability, etc.

1

2

3


## Technical specifications

Having defined the technical specifications for the power supply :

- 1 - Take into consideration the manufacturer's technical data in the case of «off-the-shelf» power supplies, immunity, emission, common-mode attenuation, filtering characteristics etc.
- 2 - Confirm, in the case of customised power supplies, the performance of the power supply at the time of delivery (transformer, special power supply, backed-up power supply, uninterruptable, etc.).
- 3 - Define the technical data of the electric power supply equipment to be constructed and check its characteristics before commissioning.

## Isolation by transformer

[\(See paragraph entitled «Isolating transformers» in Chapter 1 under the heading «Transmission modes of EM interference»\).](#)



# Power supply

## Earthing arrangements

1

The earthing arrangement defines the electrical connection of the neutral point and exposed conductive parts in relation to earth.

For low-voltage (LV) installations, it is identified by :

**First letter** : state of the neutral point in relation to earth

2

**T** = neutral point directly earthed

**I** = earthed through a high impedance

3

**Second letter** : state of the exposed conductive parts in relation to earth

**T** = exposed conductive parts connected directly to a separate earth

**N** = exposed conductive parts connected to earth of the neutral point

### **TN system :**


This system is divided into two groups : TN-C, TN-S

**TN-C** : the earth (PE) and neutral (N) conductors are combined and form a single PEN conductor.

**TN-S** : the earth (PE) and neutral (N) conductors are separate and each earthed.

*When choosing an earthing arrangement, **the safety of persons always takes precedence** over functional aspects*


# Power supply



## Earthing arrangements : (EMC) performance

	TT	TN-C	TN-S	IT
<b>Safety of persons</b>	<b>Good</b> Earth leakage circuit breaker is mandatory	<b>Good</b> Exercise caution and check the continuity of the PE conductor when extending the installation		
<b>Safety of property</b>  Fire risks  Risks to equipment	<b>Good</b>	<b>Bad</b>  Extremely high currents in PEN conductor, may exceed kA  Prohibited in hazardous areas	<b>Bad</b>  Differential protection 500 mA	<b>Good</b>  Recommended for inherent safety because of absence of arcing
<b>Power availability</b>	<b>Good</b>	<b>Good</b>	<b>Good</b>	<b>Very good</b>
<b>(EMC) performance</b>	<b>Good</b>  PE conductor is no longer a unique potential reference for the installation  - Generally provide lightning arresters (overhead transmission lines)  - Need to manage equipment with high leakage current located downstream from differential protective devices	<b>Bad</b>  Flow of interfering current in exposed conductive parts.  Radiation of (EMC) interference by PE. Not recommended if installation contains apparatus that generates harmonics.	<b>Very good</b>  - Need to manage equipment with high leakage current located downstream from differential protective devices.  - High fault currents in PE (induced interference)  - A single earth	<b>Bad</b>  Not compatible with use of common-mode filter.  - It may be necessary to split the installation in order to reduce the length of cables and limit leakage currents.  - the TN system to the 2nd fault.






# Power supply

## Earthing arrangements : (EMC) performance (continued)

- 1
- 2
- 3


		First letter (defines state of neutral point)		Power supply		
		Neutral point directly earthed	Neutral point earthed through an impedance or no connection	Direct, LV system	Through transformer, private HV/LV	
State of exposed conductive parts of the installation	Exposed conductive parts interconnected and connected to earth at one point	<b>T</b>	<b>I</b>	YES	YES	
		<b>TT</b>	<b>IT</b>			
	Exposed conductive parts connected to neutral point	<b>N</b>	<p><b>Caution</b></p> <p><b>NOTE 1 :</b> In the TN-C system, the PEN conductor (combined neutral and PE), must never be cut. In the TN-S system, as in the other systems, the PE conductor must never be cut.</p> <p><b>NOTE 2 :</b> In the TN-C system, the "protective conductor" function takes precedence over the "neutral" function. In particular, a PEN conductor must always be connected to the "earth" terminal of a consumer and a strap must be fitted between this terminal and the neutral terminal.</p> <p><b>NOTE 3 :</b> The TN-C and TN-S systems may be used in the same installation. It is mandatory that the TN-C system is upstream from the TN-S system. The TN-S system is mandatory for cable cross-sectional areas &lt; 10 mm<sup>2</sup> Cu or &lt; 16 mm<sup>2</sup> Al or for flexible cables.</p>		YES	YES
		<b>TN-C</b>			<b>TN-S</b>	With the distributor's consent

# Power supply

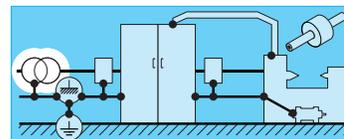

Disconnection	Protective device	Need for maintenance service	Remarks
1st fault	Earth leakage circuit-breaker • At origin And/or • on each outgoing feeder (horizontal selectivity)	NO  Periodic inspection	<ul style="list-style-type: none"> <li>Intensity of insulation fault current is limited by earthing resistors (a few dozen amperes).</li> <li>Interconnection of exposed conductive parts and earthing by PE conductor that is separate from the neutral conductor.</li> <li>No requirement imposed on continuity of the neutral conductor.</li> <li>Extension without calculation of conductor lengths.</li> <li>Simplest solution when designing an installation.</li> </ul>
2nd fault  Continued service ensured	NO Need for tester for continuous insulation monitoring   Temperature rise in cables in event of 2nd fault	YES  Need for intervention to clear 1st fault   After 1st fault => TN configuration	<ul style="list-style-type: none"> <li>Intensity of the 1st insulation fault current cannot create a hazardous situation (tens of mA).</li> <li>Intensity of double insulation fault current is high.</li> <li>Operational exposed conductive parts are earthed through PE conductor which is separate from neutral conductor.</li> <li>First insulation fault does not create any hazard or interference.</li> <li>Signalling is mandatory on the first insulation fault, followed by fault finding and clearance obtained by a Continuous Insulation Tester (CPI) installed between neutral and earth.</li> <li>Tripping is mandatory on the second insulation fault by using overcurrent protective devices.</li> <li>Verification of tripping on 2nd fault must be performed.</li> <li>This solution ensures optimum continuity of operational service.</li> <li>Need to install consumers having a phase/earth insulation voltage in excess of the phase-to-phase voltage (1st fault case).</li> <li>Voltage limiters are indispensable.</li> </ul>
1st fault	Prohibited	NO  • Verification of tripping must be carried out: - at design stage by calculation - mandatory at the time of commissioning - periodically (every year) by measurements • Verification of tripping must be repeated if the installation is extended or reconditioned.	<ul style="list-style-type: none"> <li>Operational exposed conductive parts connected to PEN conductor, latter is earthed.</li> <li>High intensity of insulation fault currents (increased interference and fire risks) (Ishort circuit kA).</li> <li>Combined neutral conductor and protective conductor (PEN).</li> <li>Flow of neutral currents in conductive parts of building and exposed conductive parts is cause of fires and voltage drops that cause interference to sensitive medical, data processing or telecommunication equipment.</li> <li>Tripping is mandatory on first insulation fault, cleared by overcurrent protective devices.</li> </ul>
1st fault	NO  But, an earth leakage circuit-breaker is required for long circuits	NO  • Verification of tripping must be carried out: - at design stage by calculation - mandatory at the time of commissioning - periodically (every year) by measurements • Verification of tripping must be repeated if the installation is extended or reconditioned.	<ul style="list-style-type: none"> <li>Operational exposed conductive parts connected to PEN conductor, latter is earthed.</li> <li>High intensity of insulation fault currents (increased interference and fire risks) (Ishort circuit kA).</li> <li>Separate neutral conductor and protective conductor.</li> <li>Tripping mandatory on first insulation fault, cleared by overcurrent protective devices. Use of ELCBs is always recommended to protect persons against indirect contact, especially in final distribution circuit where loop impedance may not be controllable.</li> <li>It is tricky to test the correct operation of protective devices. Use of ELCBs helps overcome this problem.</li> </ul>

- 1
- 2
- 3





# Power supply

## Distribution in the installation


Wire the power supplies of devices in a STAR configuration starting from the power source.

- 1
- 2
- 3

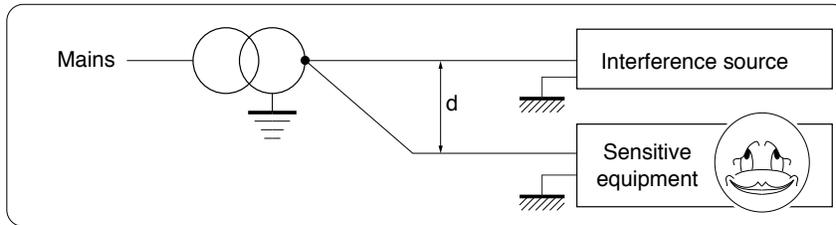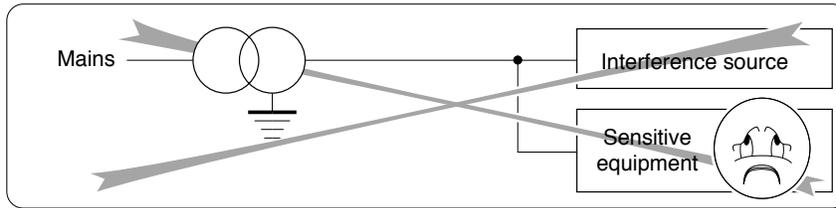


d = distance between cable: [see Wiring rules later on in this chapter.](#)


If equipment that is highly sensitive or that generates significant interference is used, power supplies must be separated.

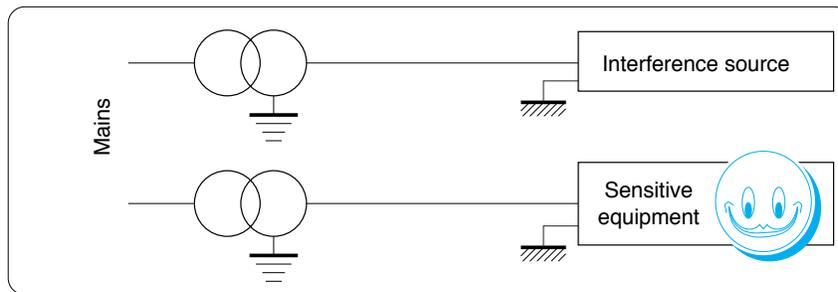

Wire the supply circuits by placing interfering equipment as close as possible to the power source and the most sensitive equipment farthest from the power source.

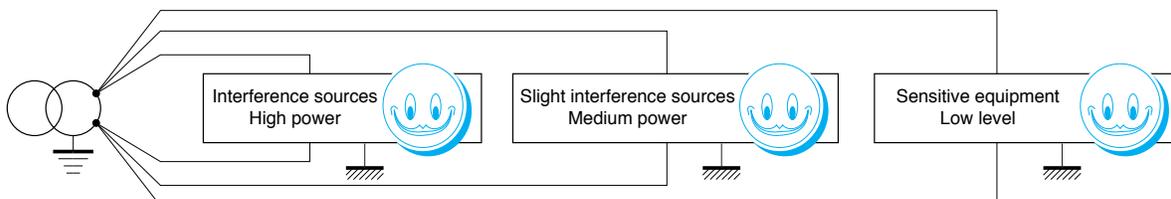


# Power supply

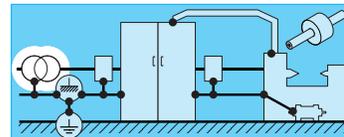


## Earthing of transformer screens

- Length of frame connections must be as short as possible.
- The case of the transformer must be mounted metal-to-metal on a conductive earth plane.

- 1
- 2
- 3

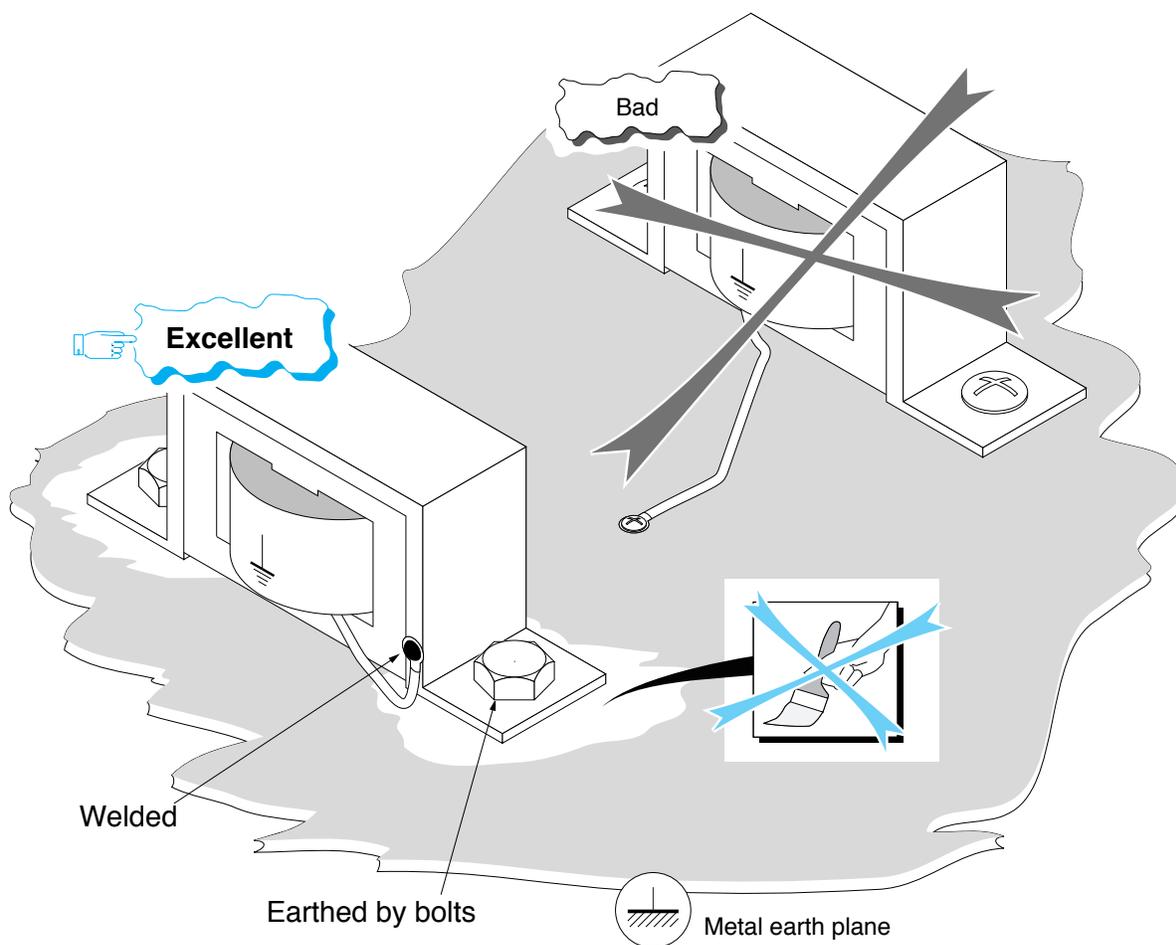



# Cabinet

---

## Analysis

1

### Components

- Identify potential interference sources and determine the type of interference emitted (nature, intensity, frequency, etc.).
- Identify sensitive equipment and determine its immunity level.

2

Use manufacturers' documentation, note characteristics such as :

- power, power supply voltage (380 V, 500 V etc.), type of signals ( $\sim$  ; ==), frequency of signals (50 Hz, 60 Hz, 10 kHz ...),
- type of circuit (switching with dry contact, etc.)
- type of load controlled (inductor or coil, etc.).

3


### Signals carried by cables

- Identify the «input» cables (signal originating from outside the cabinet) and «output» cables.
- Determine the type of signal on these cables and divide them up into classes\*, namely: sensitive, slightly sensitive, slightly interfering, interfering.

[\(See paragraph entitled «Cables» later on in this chapter\).](#)

— \*Non-standardised term adopted for the purposes of this document. —

# Cabinet

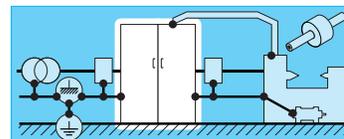


## Analysis (continued)

### Example of typical classification

Sensitive	Interfering
<ul style="list-style-type: none"> <li>• Programmable logic controllers (PLC)</li> <li>• PCBs</li> <li>• Regulators</li> <li>• Cables connected to such components, namely inputs and outputs such as (detectors, sensors, probes, etc.) --&gt; class* 1 or 2</li> <li>• Cables carrying analogue signals --&gt; class* 1</li> </ul>	<ul style="list-style-type: none"> <li>• Transformers in cabinet</li> <li>• Contactors, circuit-breakers, etc.</li> <li>• Fuses</li> <li>• Switching power supplies</li> <li>• Frequency converters</li> <li>• Variable speed drives</li> <li>• d.c. --- power supplies</li> <li>• Microprocessor clocks</li> <li>• Cables connected to such components</li> <li>• Power supply lines</li> <li>• «Power» cables in general --&gt; class* 3 or 4</li> </ul> <p><a href="#">(See paragraph entitled «Cables» later on in this chapter).</a></p>



— \*Non-standardised term adopted for the purposes of this document. —



# Cabinet

## Earth reference plane

*Before doing anything else, define and provide a non-painted earth reference plane in the bottom of the cabinet*

1

 This metal sheet or grid will be connected at several points to the rack in the metal cabinet which is itself connected to the equipment's earth system.

2

 All components (filters, etc.) are directly bolted onto this earth plane.

 All cables are laid on the earth plane.

 360° shielding is obtained by locknuts directly bolted onto the earth plane.

3

Special care must be taken when making any connection ([see paragraph later on in this chapter](#)).

## Cable entrances

Fit filters for cables that cause interference at the point where they enter the cabinet.


Take special care when selecting cable glands intended to connect shielding to earth (wall).

## Routing of cables

([See paragraphs entitled «Cables», «Wiring» and «Cable runs - Cable troughs» later on in this chapter](#)).

Divide the cables up according to class and lay them in separate metal cable troughs separated by an adequate clearance.

# Cabinet

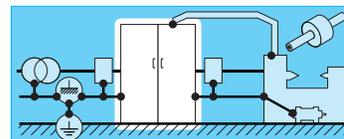

## Lighting

Do not use fluorescent lamps, gas discharge tubes etc. to illuminate control panel cabinets internally (they generate harmonics, etc.).

 Use incandescent bulbs.

1

## Layout of components

*Separate and segregate «interfering» and «sensitive» components, cables, etc. in different cabinets.*

### Small cabinets

Partitioning by means of sheet metal panels earthed at several points reduces the influence of disturbances.

2

### Large cabinets


Allocate one cabinet for each class of components.

«Interfering» and «sensitive» cabinets must be different and separated from each other.

3



**Failure to comply with these instructions may negate all the efforts made at the time of assembly and commissioning.**




# Cabinet


## Example of structural layout of a small cabinet

 In small cabinets, partitioning by sheet metal panels bolted to the chassis may be sufficient.

- 1
- 2
- 3

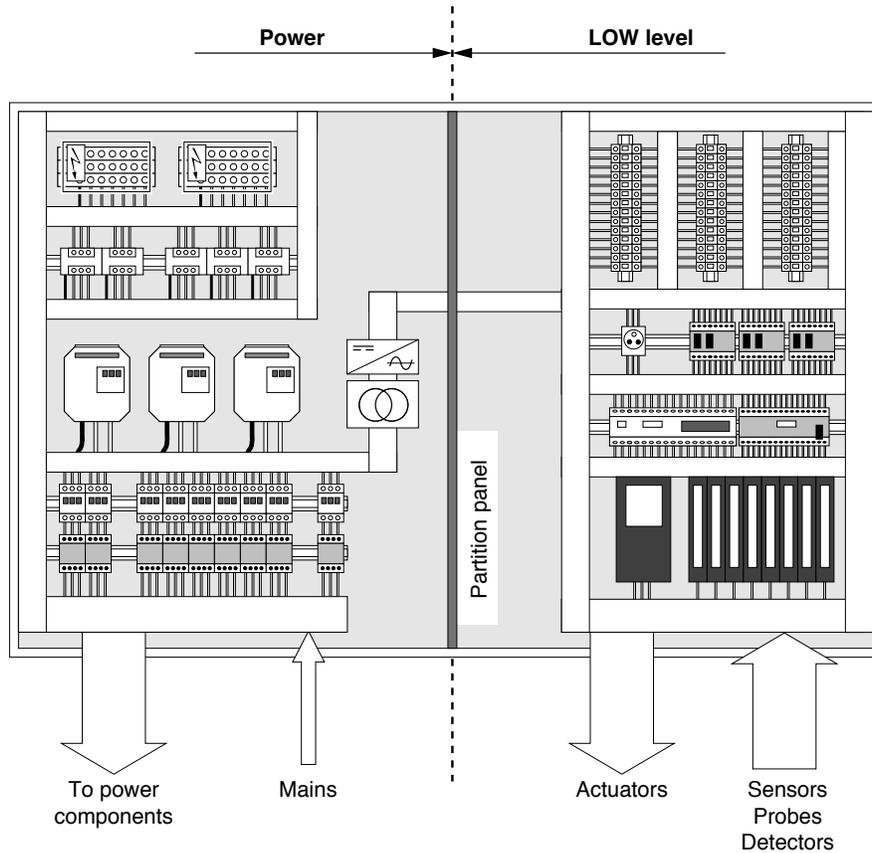


# Cabinet

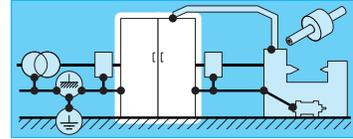



Example of structural layout of a large cabinet

*Never mix cables or loop excess cable in coils.*

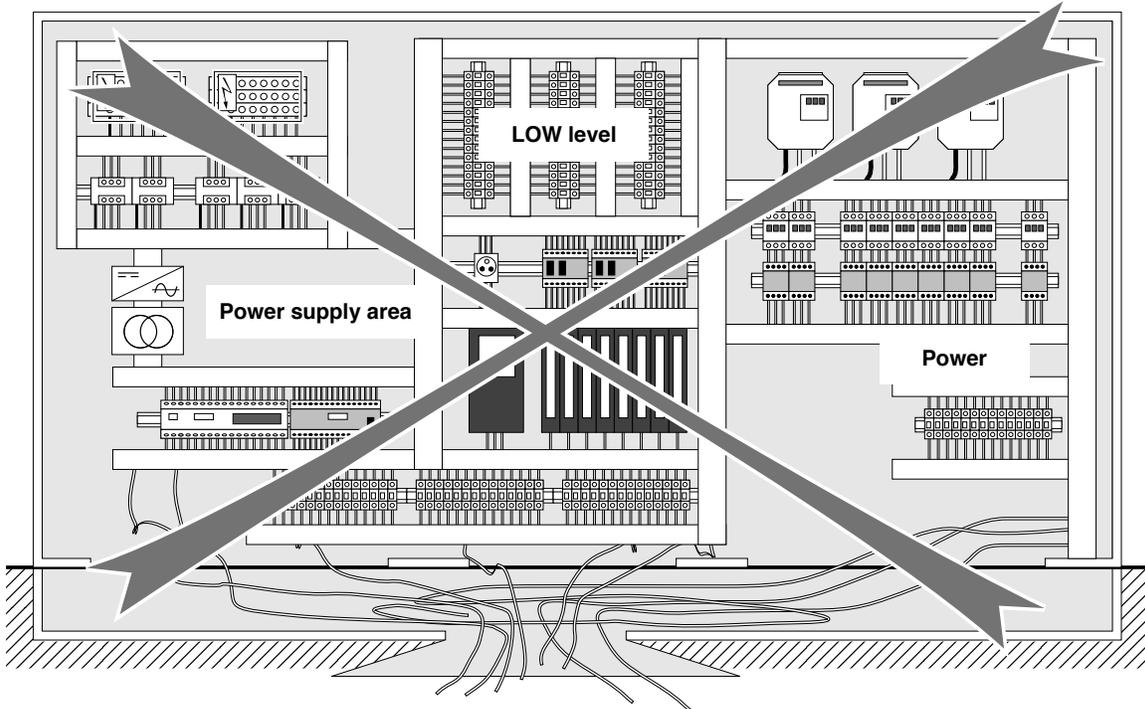

- 1
- 2
- 3

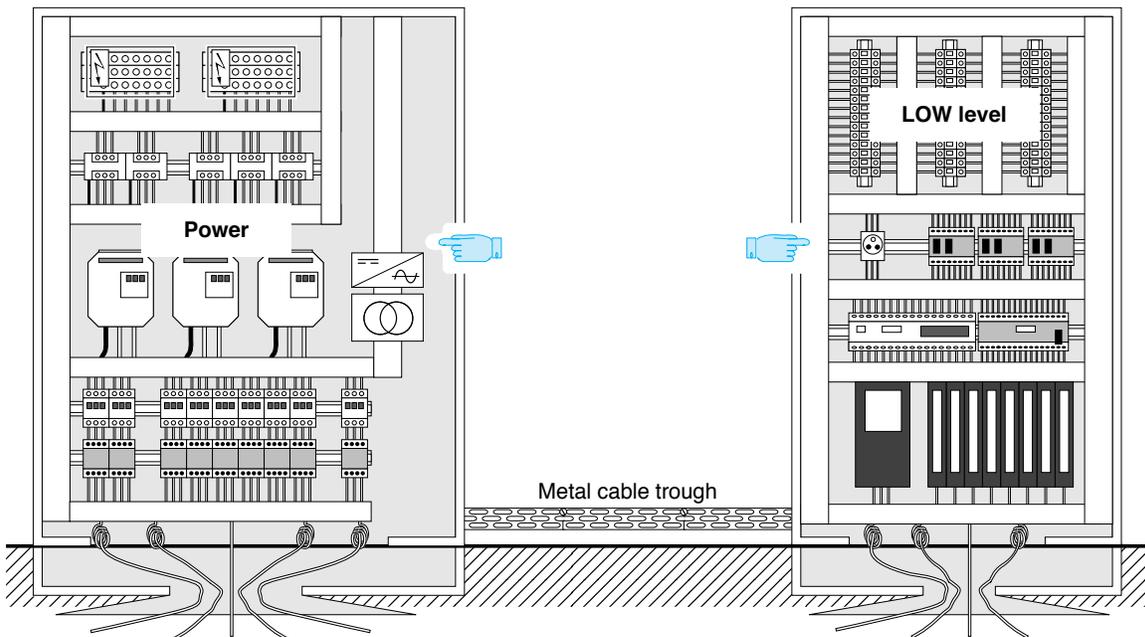

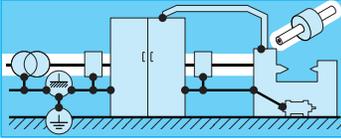

# Cables

## Classes\* of signals

### Classification of signals according to level of interference

- 1
- 2
- 3

Class*	Interfering	Sensitive	Example of carried signals or connected equipment
<b>1 Sensitive</b>		<b>++</b>	<ul style="list-style-type: none"> <li>Low-level circuits with analogue output, Sensors etc.</li> <li>Measuring circuits (probes, sensors, etc.)</li> </ul>
<b>2 Slightly sensitive</b>		<b>+</b>	<ul style="list-style-type: none"> <li>Control circuits connected to resistive load</li> <li>Low-level digital circuits (bus, etc.)</li> <li>Low-level circuits with all-or-nothing output (sensors, etc.)</li> <li>Low-level d.c. power supplies</li> </ul>
<b>3 Slightly interfering</b>	<b>+</b>		<ul style="list-style-type: none"> <li>Control circuits with inductive load (relays, contactors, coils, inverters, etc.) with suitable protection</li> <li>Clean a.c. power supplies</li> <li>Main power supplies connected to power devices</li> </ul>
<b>4 interfering</b>	<b>++</b>		<ul style="list-style-type: none"> <li>Welding machines</li> <li>Power circuits in general</li> <li>Electronic speed controllers, switching power supplies, etc.</li> </ul>

## Choice of cables


### Recommended cable types depending on class\* of signal

Class*	Type	Single-wire	Twisted pairs	Shielded twisted pairs	Shielded (braids)	Hybrid shielding (screen + braid)
1	Sensitive					
2	Slightly sensitive					
3	Slightly interfering					
4	Interfering					

 Not recommended     
  Recommended, reasonable cost     
  Inadvisable, high cost for this class of signal

— \*Non-standardised term adopted for the purposes of this document. —


# Cables

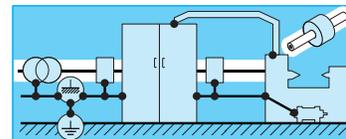

Example of cables used for various classes\* of signals

## Class\* 1


Sensitive signals

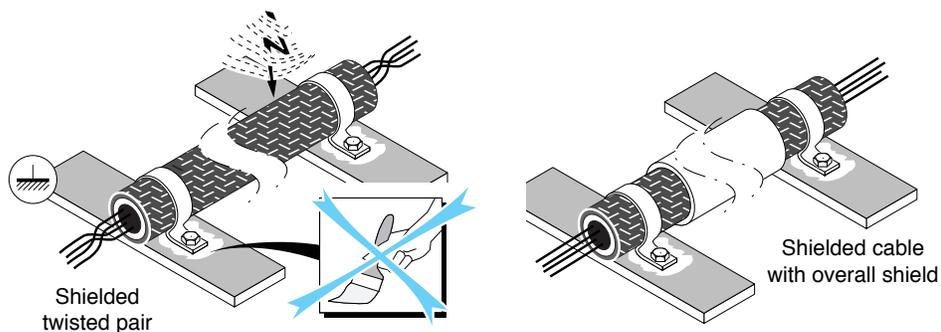

1

## Class\* 2

Slightly sensitive signals

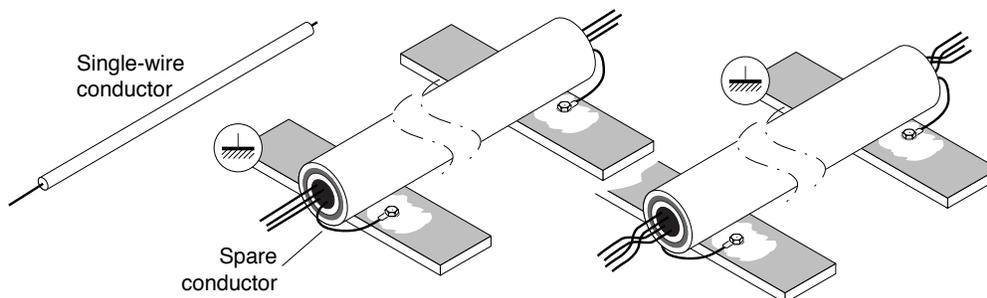


2

3


## Class\* 3


Slightly interfering signals

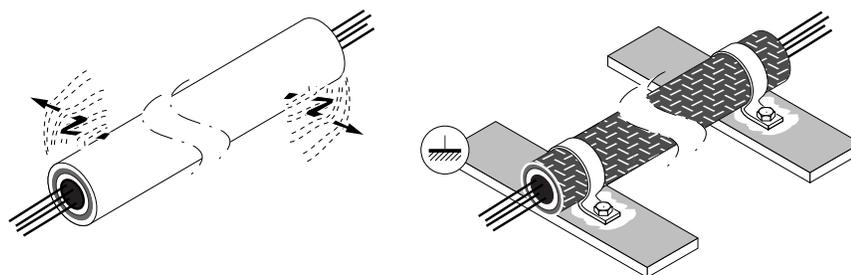

## Class\* 4

Interfering signals

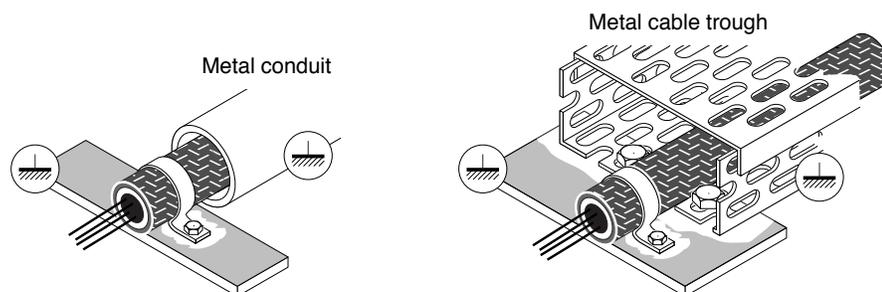



# Cables


## Performance of cables in terms of (EMC)

- 1
- 2
- 3

Cable	Conducted	Radiated			Common mode
		LF : 0 - 50 Hz	LF < 5 MHz	LF > 5-30 MHz	
Single-wire cable	No effect	Average <sup>1</sup>	Acceptable <sup>1</sup>	Inadequate <sup>1</sup>	Bad
<i>1 : If outgoing and incoming cables are very close together</i>					
2-wire parallel		Average	Acceptable	Inadequate	
2-wire twisted parallel		Good <sup>2</sup>	Good up to 100 kHz	Passable	Bad
<i>2 : Depends on the number of twists/m</i>					
Shielded twisted pair		Good	Good	Average	Good
Aluminium tape shielding		Average	Passable	Inadequate	
Braid		Excellent	Excellent	Good	
Shielding + braid	Excellent	Excellent	Excellent		



# Cables

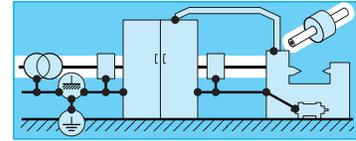


Coupling		Interference level	Application areas
Differential mode	Crosstalk, capacitive, inductive coupling		
Bad	Bad		Non-sensitive equipment only, low-frequency (LF) applications, 50 Hz-60 Hz
Good	Bad	Equipment causing slight interference	Tertiary industry, slightly noisy industrial environments
Excellent	Good	Low man-made interference	Tertiary industry, slightly noisy industrial environments, signals < 10 MHz
	Average	Low man-made interference (radio transmitters, fluorescent lighting)	Slightly noisy industrial premises, local area networks Tertiary data processing hardware
	Good	Typical man-made interference	Typical industrial sector Data processing, measuring, control Local area networks Motor control, etc.
	Good	High man-made interference (heavy industry)	Very sensitive products in a highly noisy environment

1

2

3



# Wiring rules

## The 10 Commandments

1

### Golden rule in (EMC)




Ensure high-frequency (HF) and low-frequency (LF) **EQUIPOTENTIAL BONDING** of exposed conductive parts :

- ① - locally (installation, machine, etc.)
- at site level

2

3

② Never route sensitive class\* (1-2) signals and interfering class\* (3-4) signals in the same cable or bunch of conductors.

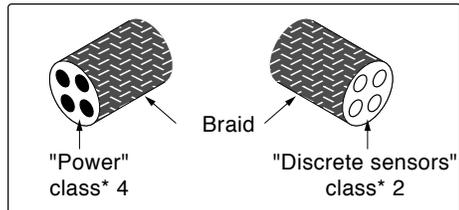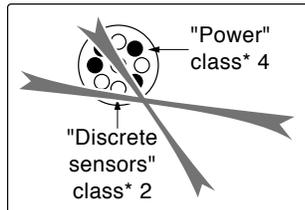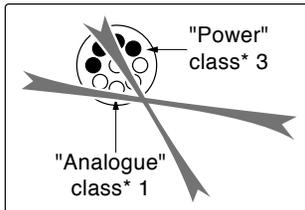


Braid : aluminium tapes, metal armouring, etc. does not constitute a shield

③ Minimise the length of parallel runs of cables carrying signals of different classes\*: sensitive (class\* 1-2) and interfering (class\* 3-4).

Minimise the length of cables.


— \*Non-standardised term adopted for the purposes of this document. —

# Wiring rules

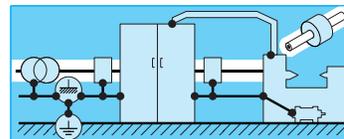

**4** Maximise the distance between cables carrying signals of different classes\*, especially sensitive signals (1-2) and interfering signals (3-4) - this is very effective and relatively inexpensive.


These values are for information only and assume that cables are mounted on an earth plane and are less than 30 m long.

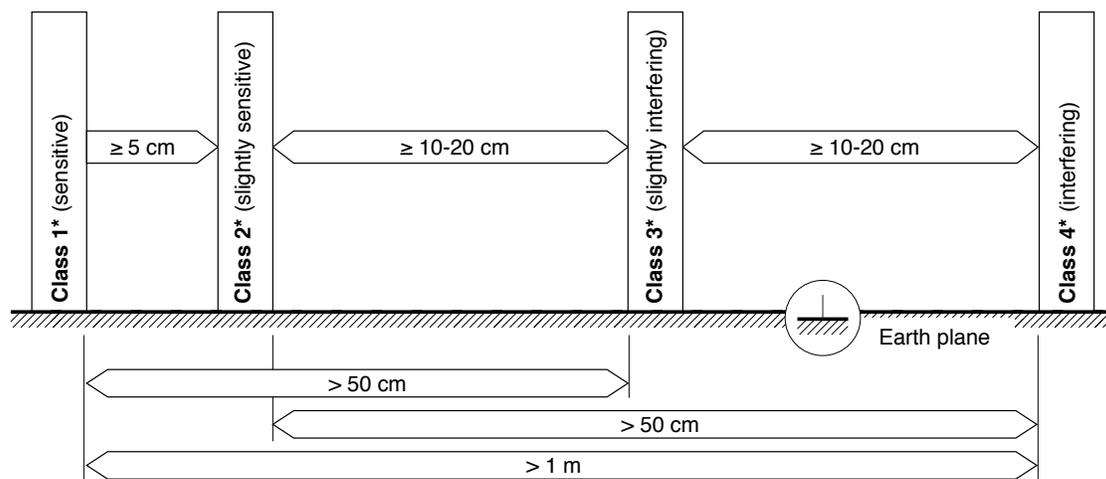


- 1
- 2
- 3

— \*Non-standardised term adopted for the purposes of this document. —

The longer the cable run, the greater the clearance required between cables.


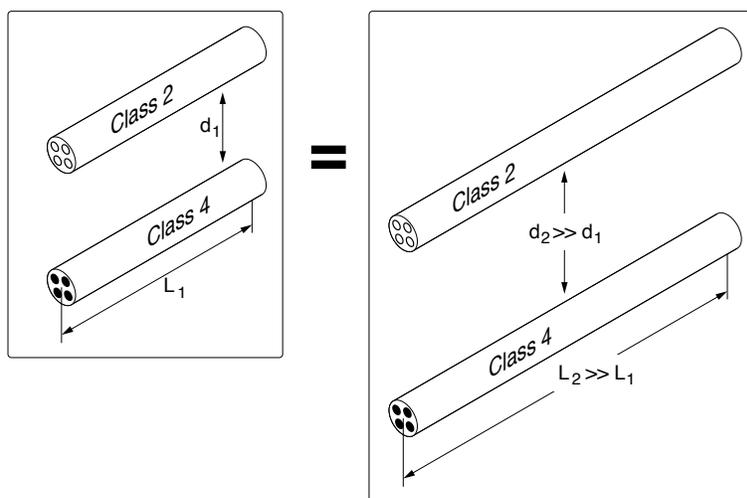






# Wiring rules

**5** Minimise the surface area of earth loops

- 1
- 2
- 3

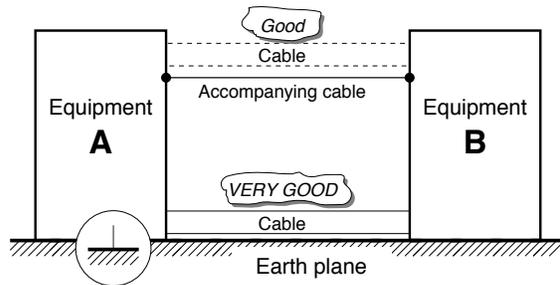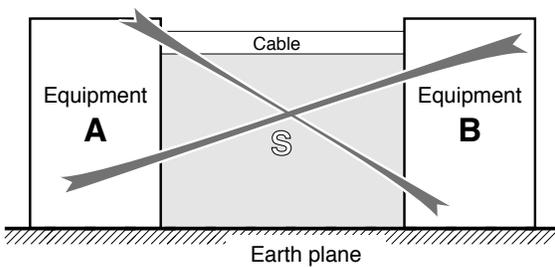


Ensure continuity of earth plane between 2 cabinets, machines, equipment items.

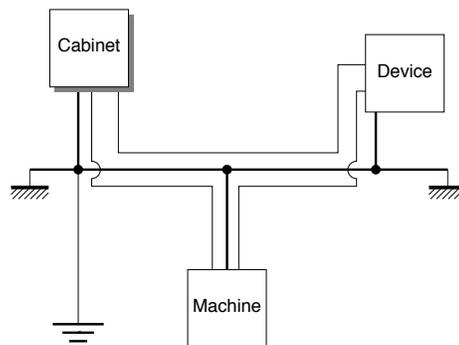
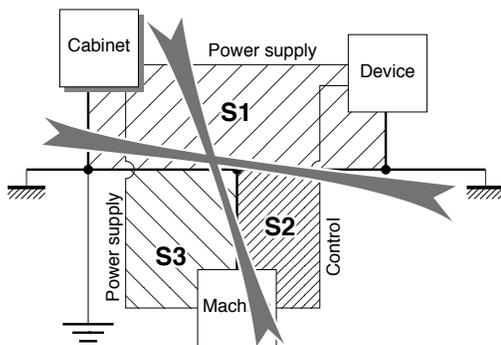


Place all conductors against the earth plane end to end (panel at bottom of cabinet, exposed conductive parts of metal enclosures, equipotential structures of machine or building, accompanying conductors, cable troughs, etc.).

# Wiring rules

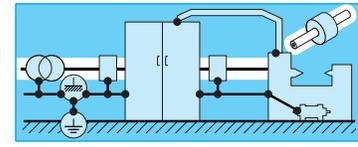


**6** The *OUTGOING* conductor must always be routed as close as possible to the *RETURN* conductor.

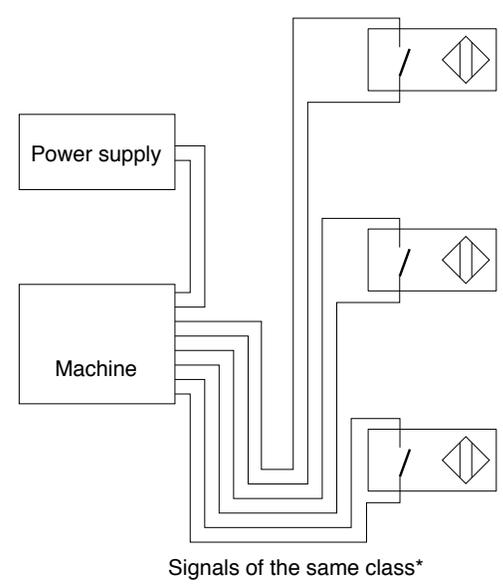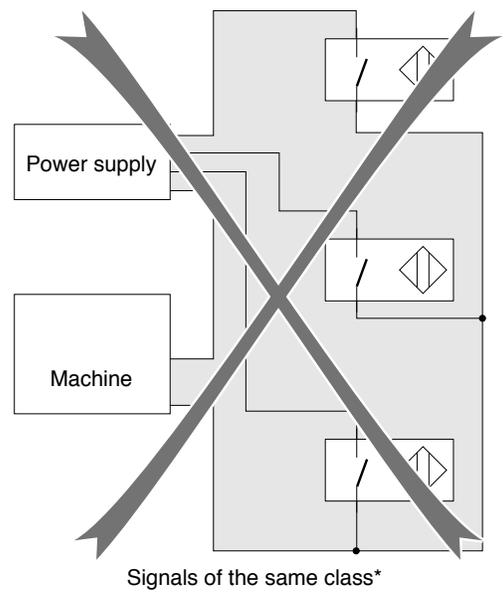

- 1
- 2
- 3

\* : low-level sensors ==> class 2

Using 2-wire (2 conductors) cables makes it possible to ensure that the *OUTGOING* conductor is alongside the *RETURN* conductor over its entire length.





# Wiring rules

**7** Using shielded cables makes it possible to co-locate cables carrying signals of different classes in a single cable trough.

1


2

3

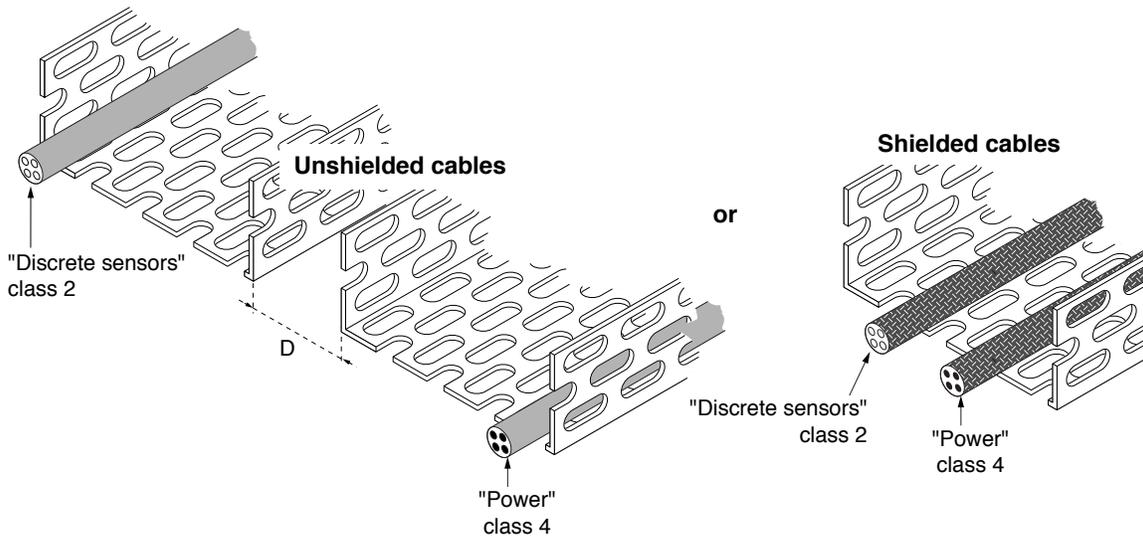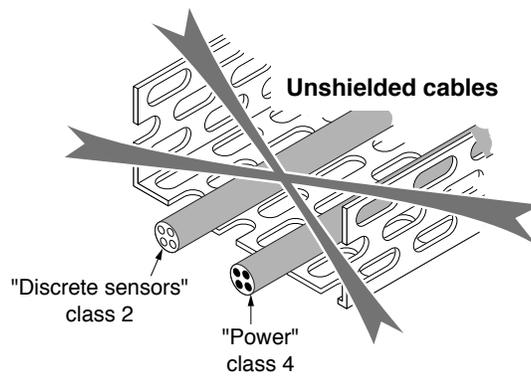

— \*Non-standardised term adopted for the purposes of this document. —

# Wiring rules

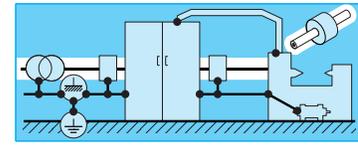

## 8 Connection of shielding

### Shielding connected at both ends


- Very effective against external disturbances (high frequency (HF), etc.),
- Very effective even at resonance frequency of cable,
- No potential difference between cable and frame connection,
- Makes it possible to co-locate cables carrying signals of different classes (assuming satisfactory connection (360°) and equipotential bonding of exposed conductive parts (interconnection, etc.),
- Very high reducing effect (high frequency (HF)) - is  $\approx 300$ ,
- In the case of extremely high-frequency (HF) signals, may induce leakage currents to earth for long cables  $> 50-100$  m.

1

2


3

**Very effective**  
*Because LF and HF equipotential bonding of the site is a golden rule in (EMC), shielding is best connected to frame earth at both ends.*

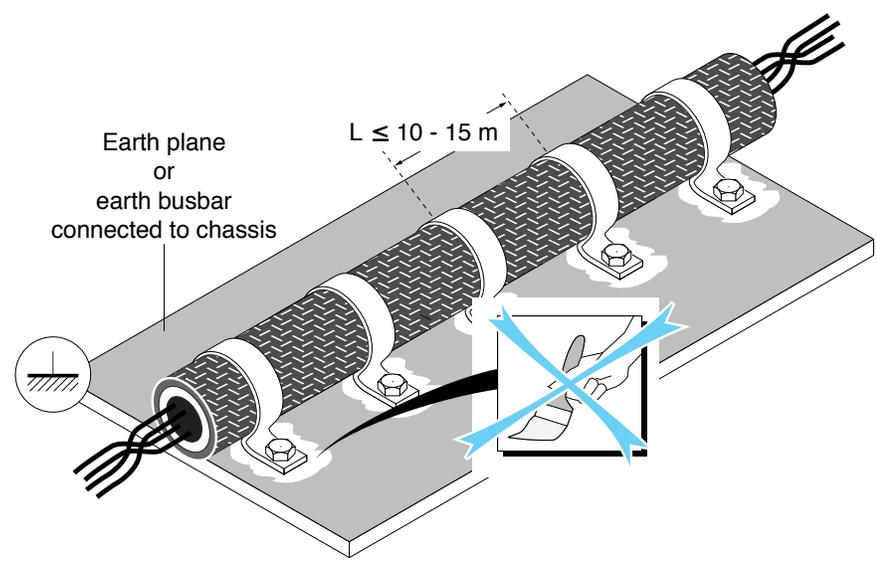

Shielding loses its effectiveness if the length of the cable is too long.

It is advisable to provide a large number of intermediate connections to frame earth.



# Wiring rules

## Shielding connected at one end only

- Ineffective against external disturbances in HF electric field,
- Can be used to protect an insulated link (sensor) against LF electric field,
- Shielding may act as antenna and become resonant  
 ==> *in this case interference is greater than without shielding!*
- Makes it possible to prevent (LF) buzz,  
 ==> *buzz is caused by flow of LF current in the shielding.*

1




**A large potential difference may exist at the end of the shielding that is not earthed.**

==> *this is dangerous and illegal - IEC 364*

Shielding must therefore be protected against direct contact..

Earth plane  
or  
earth busbar  
connected  
to chassis

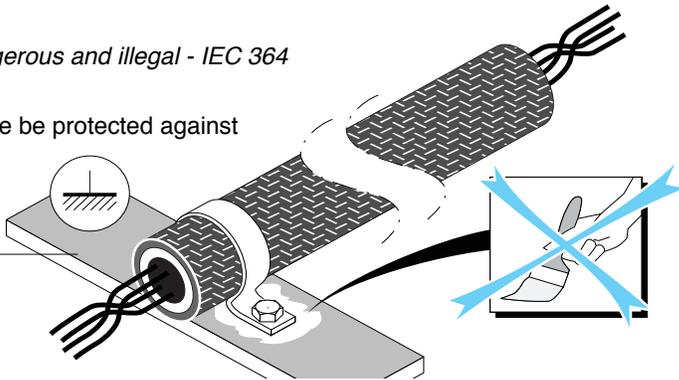

2

3


### Average effectiveness

*In absence of equipotential bonding of site (buzz), connection to one end only is a way of ensuring acceptable operation.*




**Shielding not connected to frame earth: prohibited if shielding is accessible to touch**

- Ineffective against external disturbances (HF) etc.,
- Ineffective against magnetic field,
- Limits capacitive crosstalk between conductors
- A large potential difference may exist between shielding and frame earth ==> this is dangerous and prohibited (IEC 364)

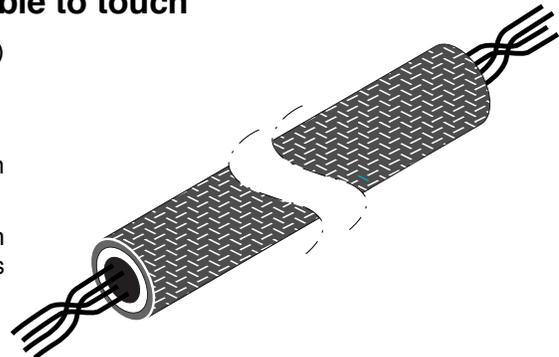


*Completely ineffective, especially when compared with capabilities of correctly fitted shielding and its cost.*

# Wiring rules

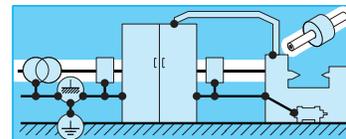

**9** Any conductor in a cable and which is spare or not used must always be earthed (chassis, cable trough, cabinet, etc.) at both ends


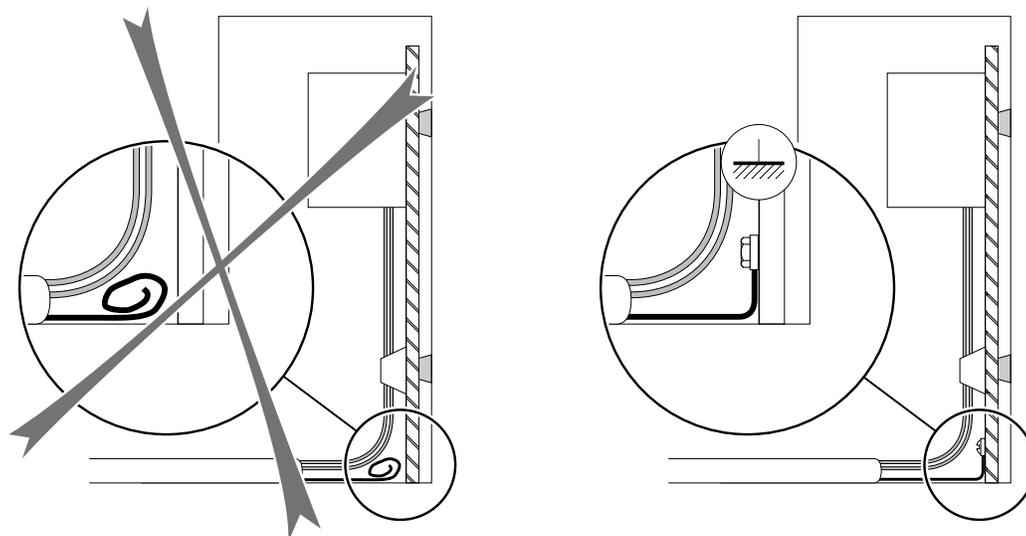



For class\* 1 signals, such connection may generate LF buzzing superimposed on the useful signal if the equipotential bonding of the exposed conductive parts of the installation is inadequate.

— \*Non-standardised term adopted for the purposes of this document. —

- 1
- 2
- 3

**10** Make sure conductors or cables carrying signals of different classes, especially sensitive signals (1-2) and interfering signals (3-4) cross each other at right angles

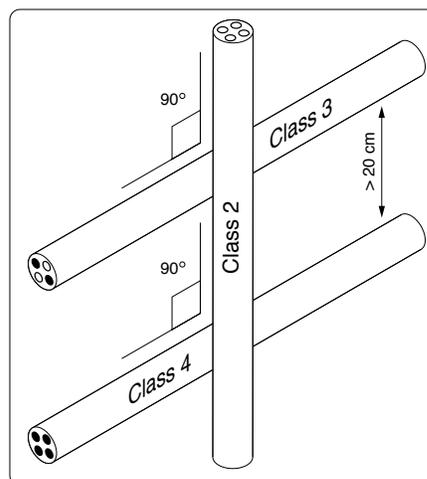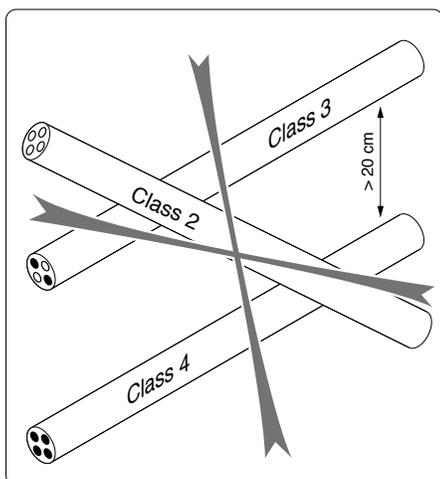




# Cable runs


## Cable troughs

Correctly connected metal cable troughs, conduits, etc. provide very effective overall shielding of cables.

- 1
- 2
- 3

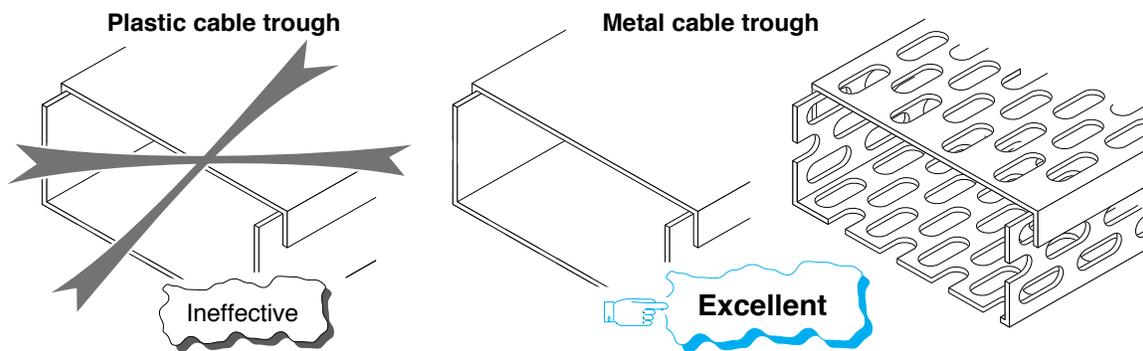

### Behaviour in presence of EM disturbances

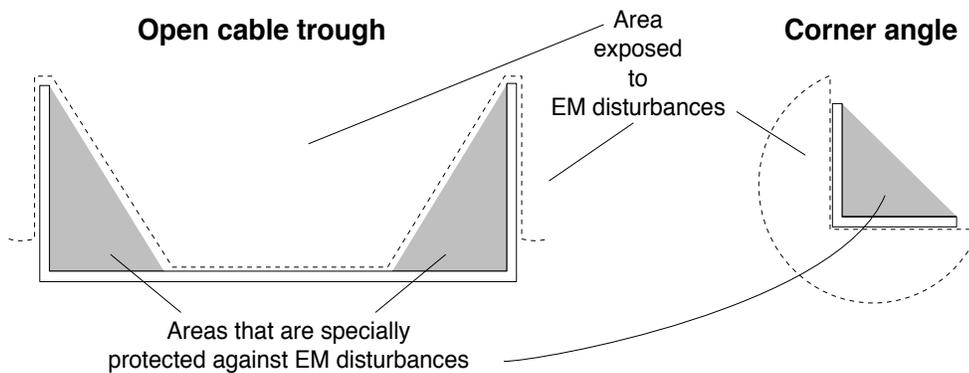


The shielding, protective or screening effect of a metal cable trough depends on the position of the cable.





**Even the best metal cable trough is ineffective if the end connections are of poor quality.**


# Cable runs

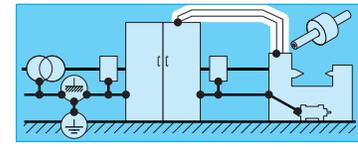

## Connection to cabinets

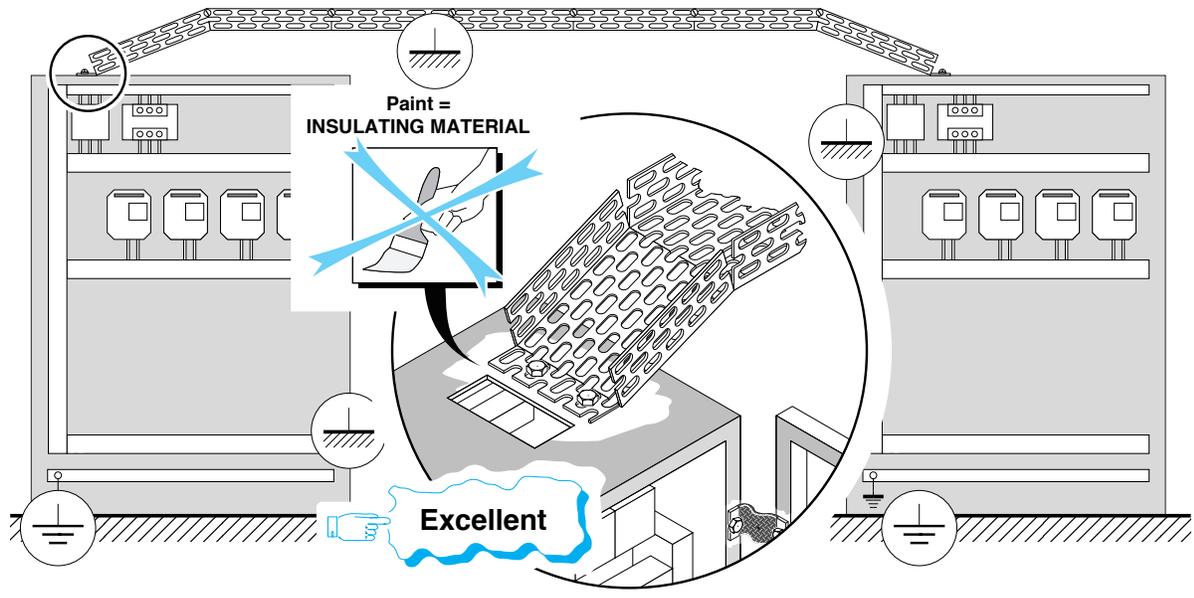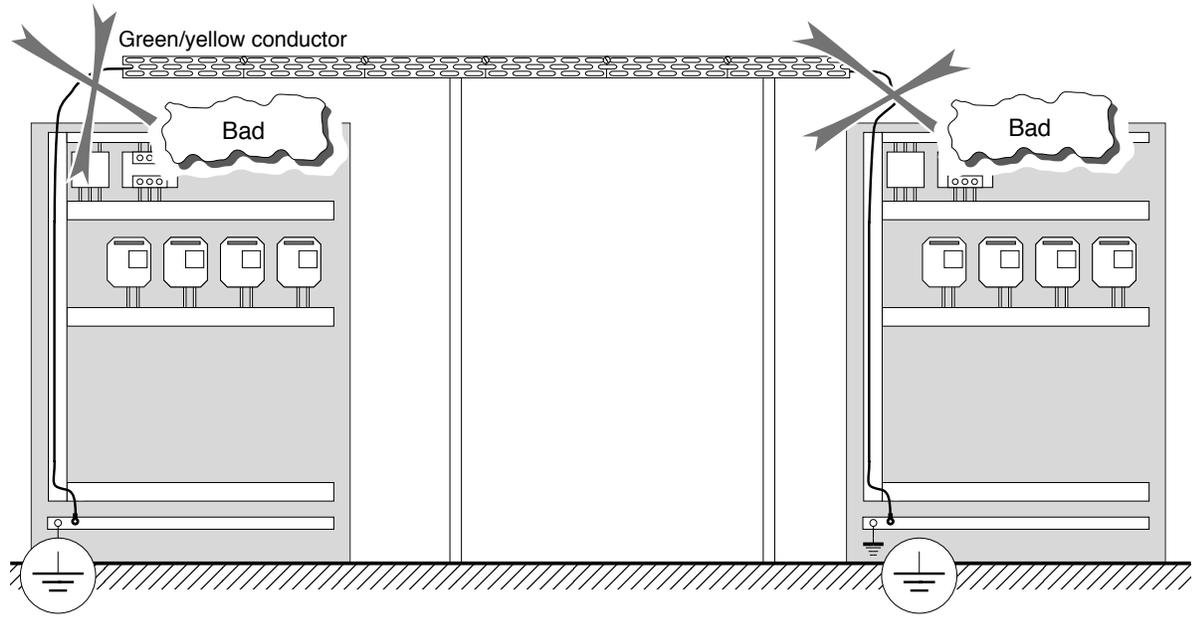

The ends of metal cable troughs, conduits, etc. must be bolted onto metal cabinets to ensure satisfactory connection.




# Cable runs

## Positioning of cables

1


2

3

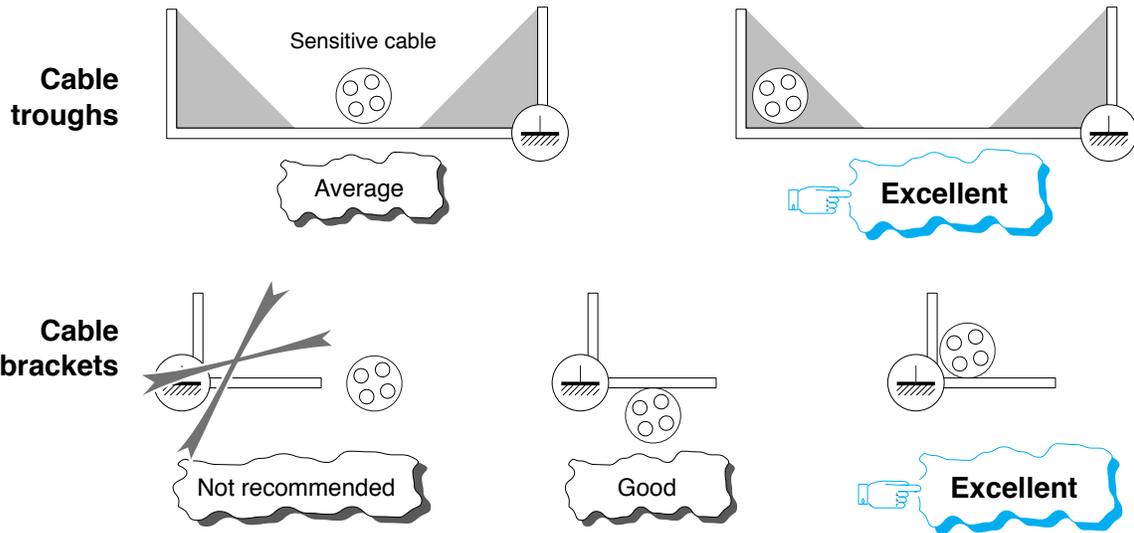

 **Even the best metal cable trough is ineffective if the end connections are of poor quality.**


# Cable runs

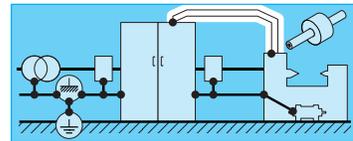


*Interfering and sensitive cables must be laid along separate cable routes.*




**For every new installation**

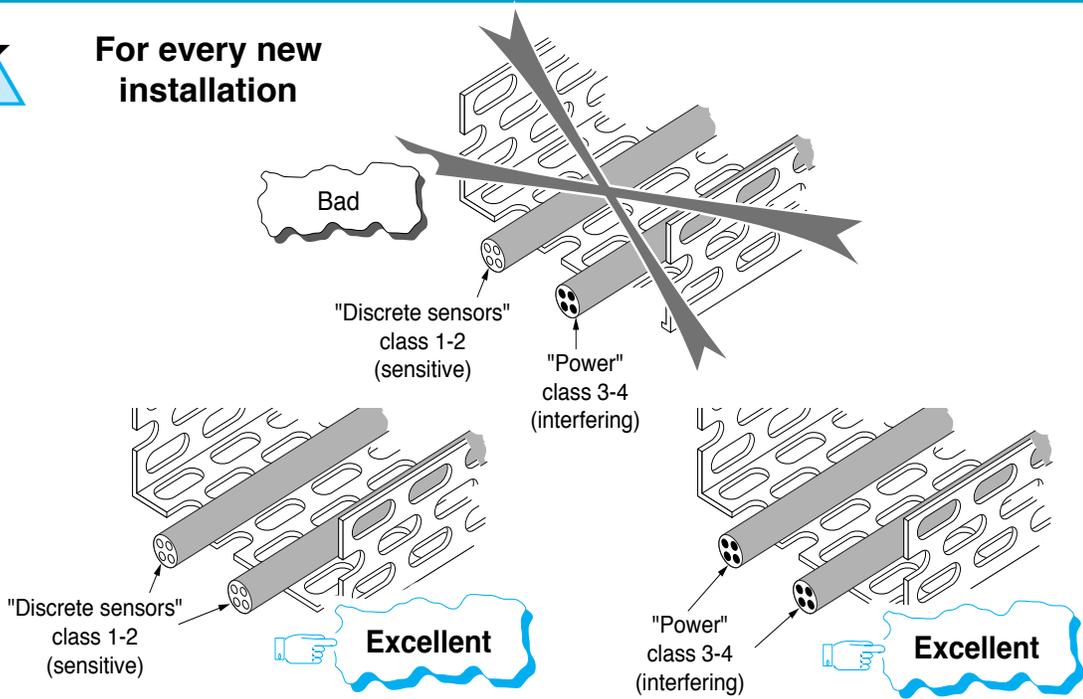

**For every existing installation**

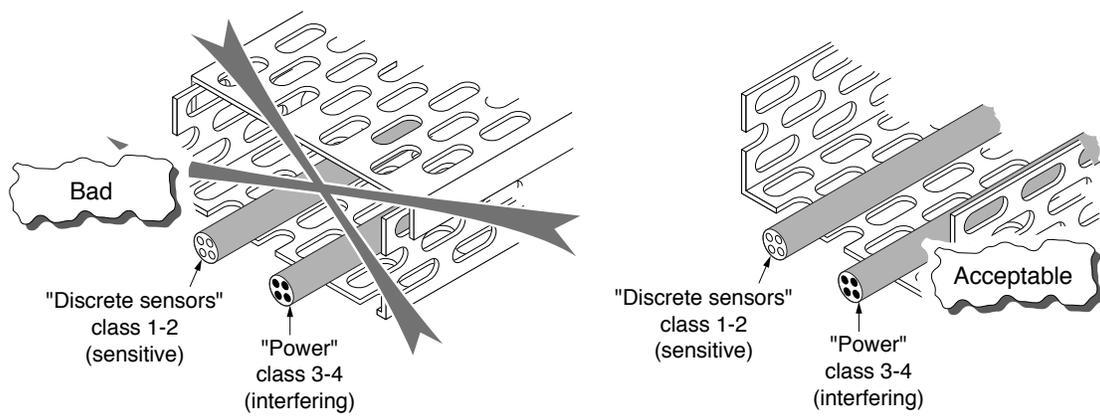

**If «sensitive» (class 1-2) and interfering (class 3-4) cables are laid in the same cable trough despite the fact that this is not at all recommended, it is then preferable to leave the cable trough open.**


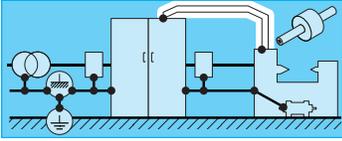


# Cable runs

## Connection of ends



The ends of metal cable troughs, conduits, etc. must overlap and be bolted together.

- 1
- 2
- 3

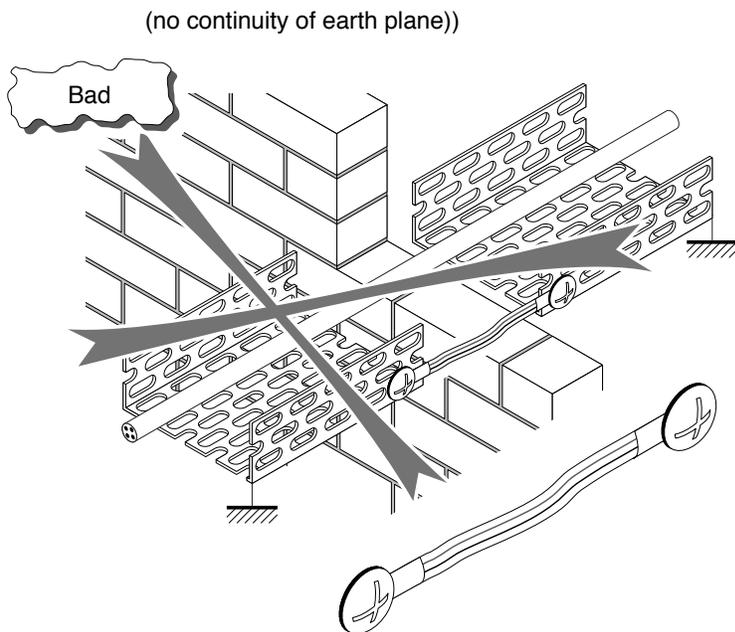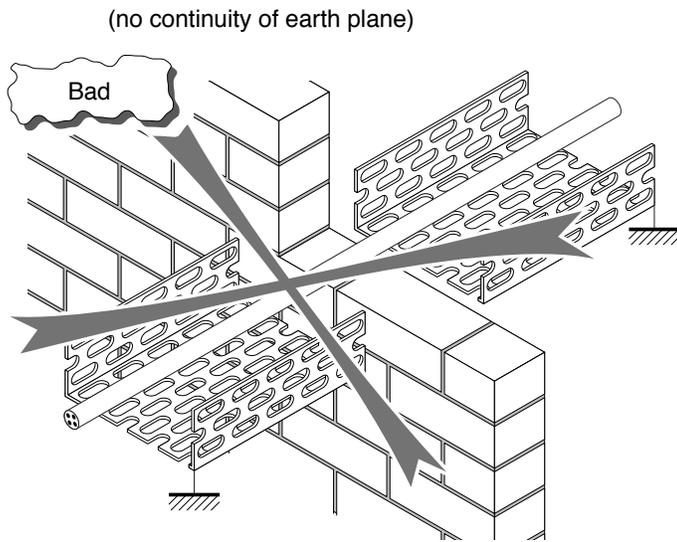

A conductor that is roughly 10 cm long reduces the effectiveness of a cable trough by a factor of 10.

# Cable runs

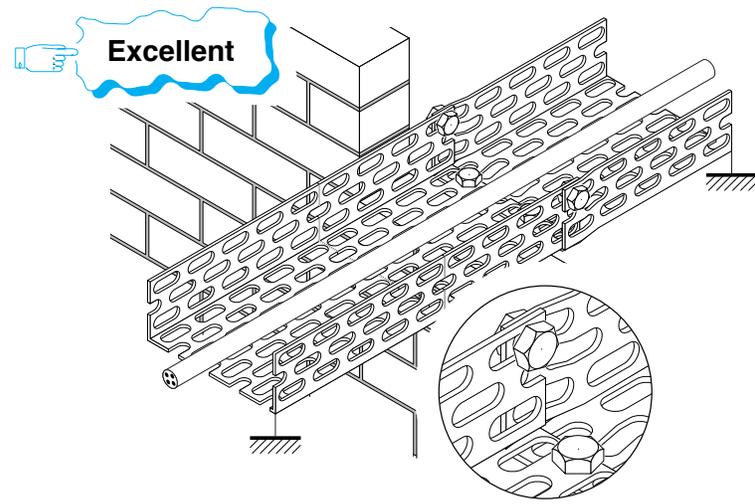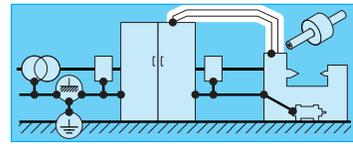


1

2


3

If it is not possible to overlap and bolt the ends of a cable trough:

==> *attach a short, wide braided strap under each conductor or cable.*

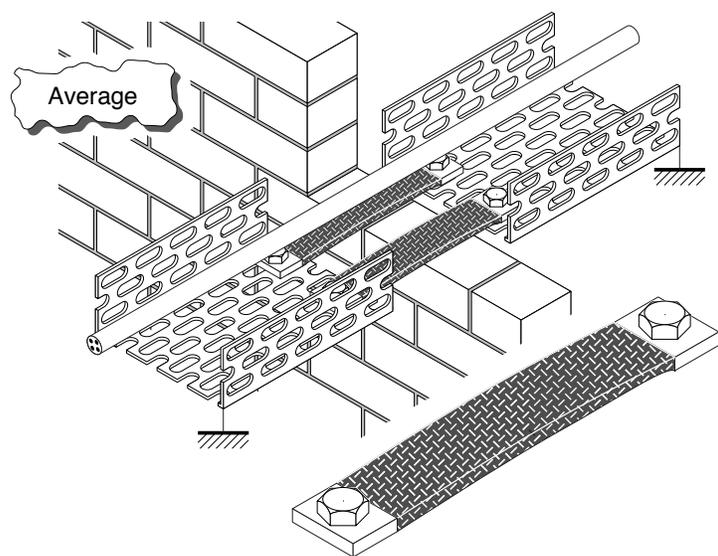

 **Even the best metal cable trough is ineffective if the end connections are of poor quality.**





# Cable runs

## Methods of cable laying not recommended

1


Structural void in partition wall




Ribbon cable, bus ...

2

Surface-mounted conduit




PVC conduit

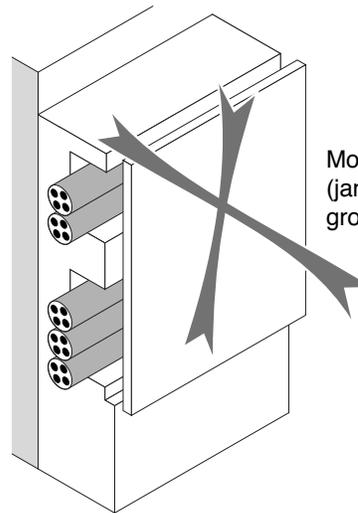


Moulding, skirting (jamb lining) with grooves

3


Buried conduit



Wall




Direct attachment to walls and ceilings using clips, ties, etc.




**Even the best metal cable trough is ineffective if the end connections are of poor quality.**


# Cable runs

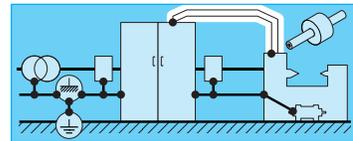

## Recommended methods of cable laying

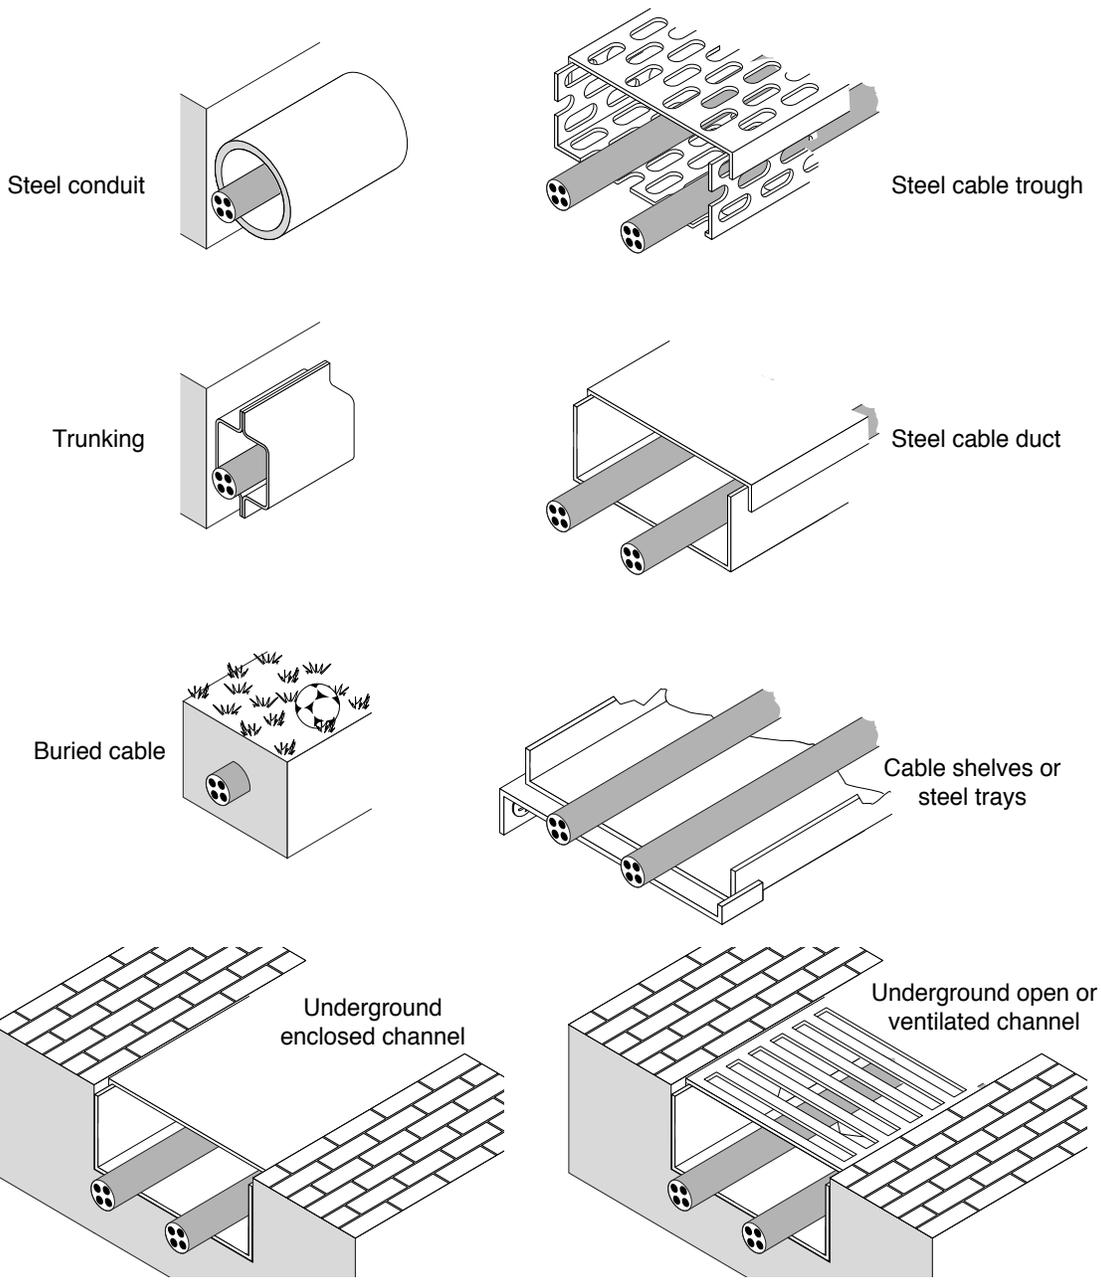

- 1
- 2
- 3

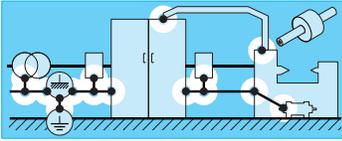

# Connections

**The quality of CONNECTIONS** is just as important as the best cable, shielding, earthing system

It is assumed that the reader is completely familiar with high-frequency (HF) phenomena, otherwise the reader should refer to Chapter I (especially the section entitled «Cables»).


1

## Type and length of connections

2

Frame earth connections, etc. must be as short and wide as possible in every case.


3

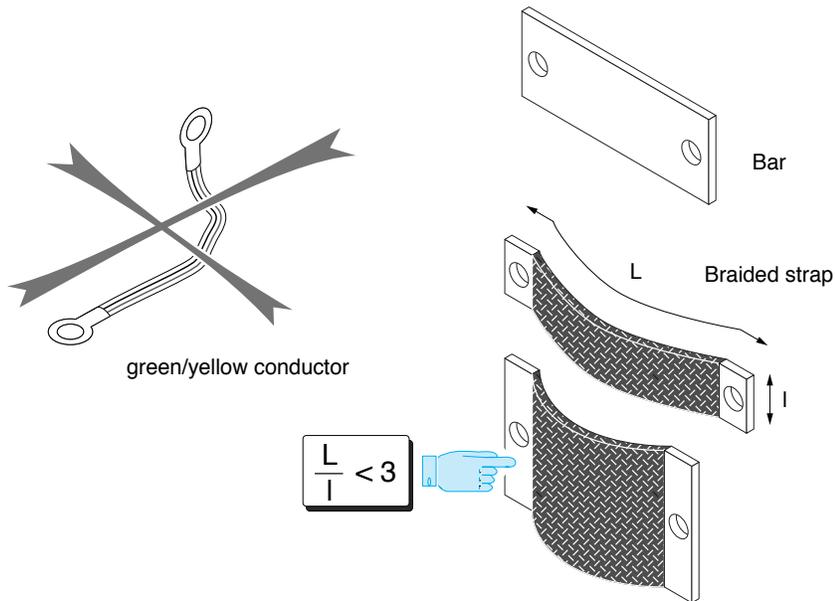

**Reminder :** at high frequency (HF), the length of the cable is the decisive factor ([see Chapter I](#))

**The quality of connections is a decisive factor in (EMC).**

# Connections

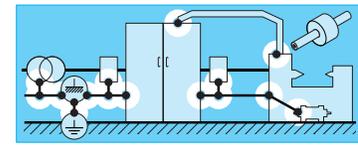

## Making a connection

It is crucially necessary to ensure «metal-to-metal» contact and a high contact pressure between conductive parts.

### Procedure :


- 1 - Painted sheet metal,
- 2 - Masking - removal of paint,
- 3 - Ensure adequate tightening by means of a nut and bolt system with washers for example,
- 4 - Ensure high-quality contact is maintained over time.

==> apply paint or grease to protect against corrosion after tightening.

1


2

3

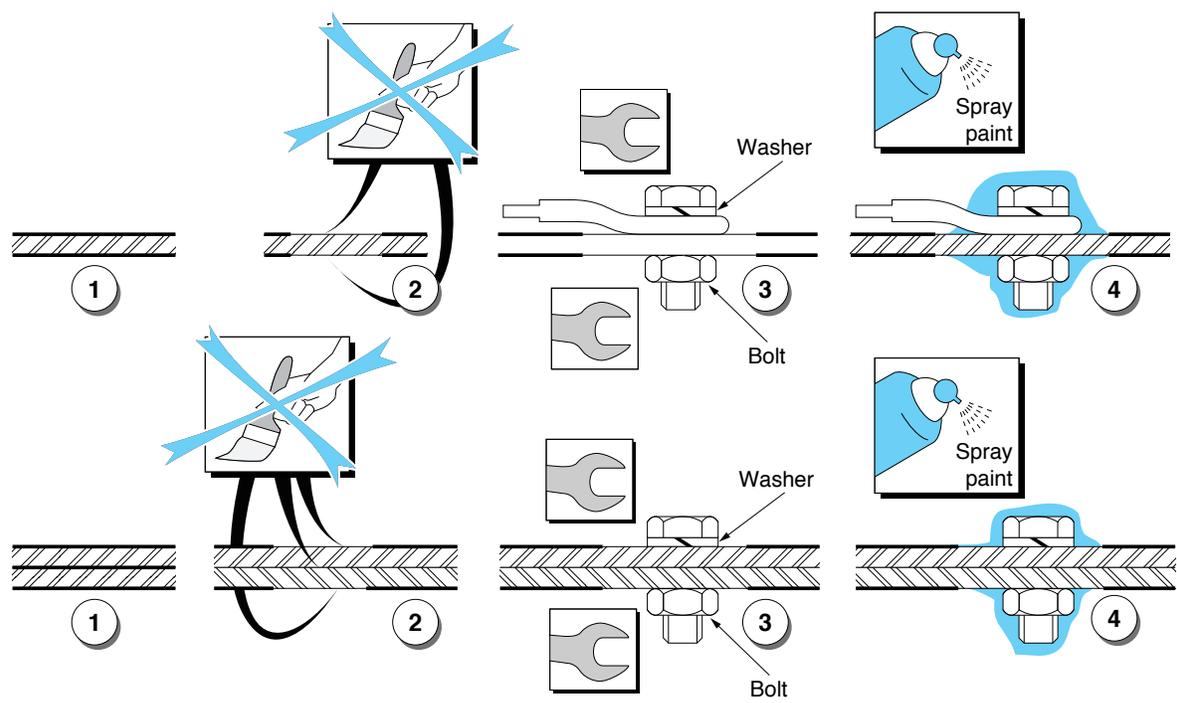

**Remove insulating coatings, paintwork, etc. between the surfaces in contact**

*The quality of connections is a decisive factor in (EMC).*

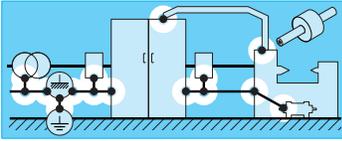


# Connections




## Pitfalls to avoid


1

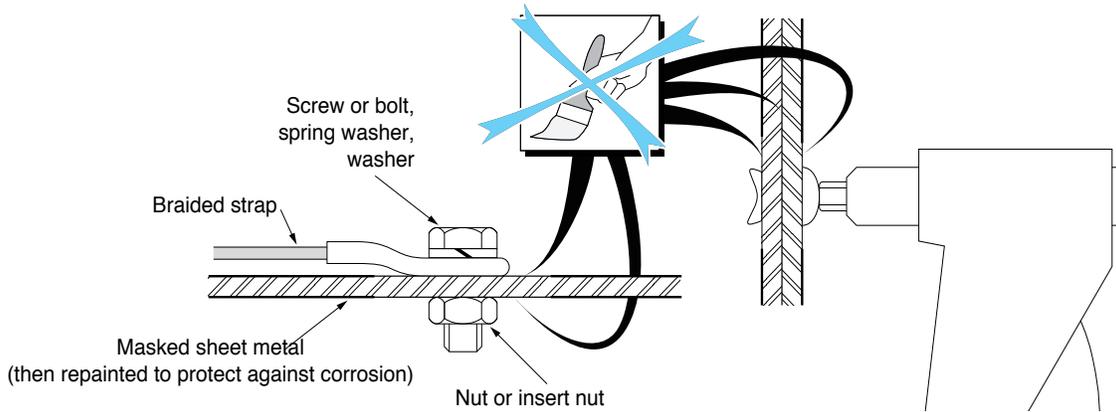


2

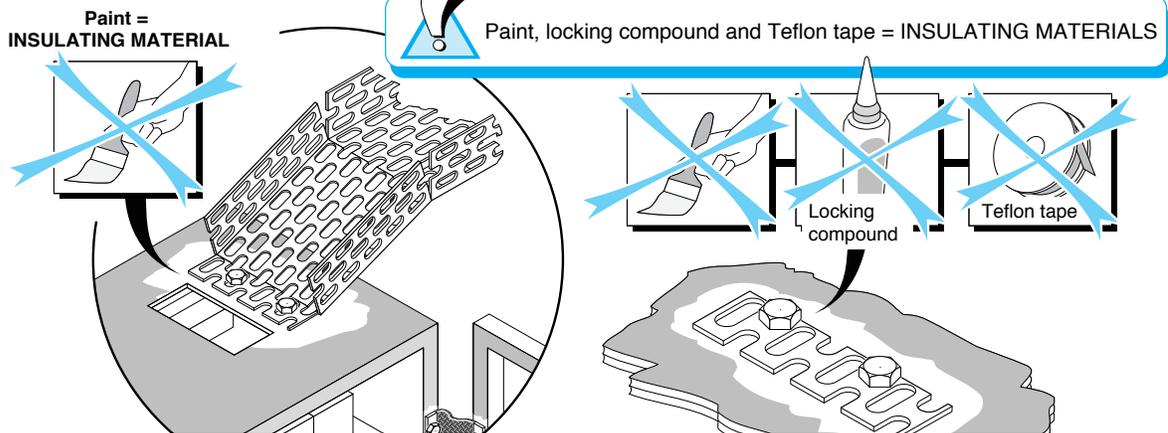



3

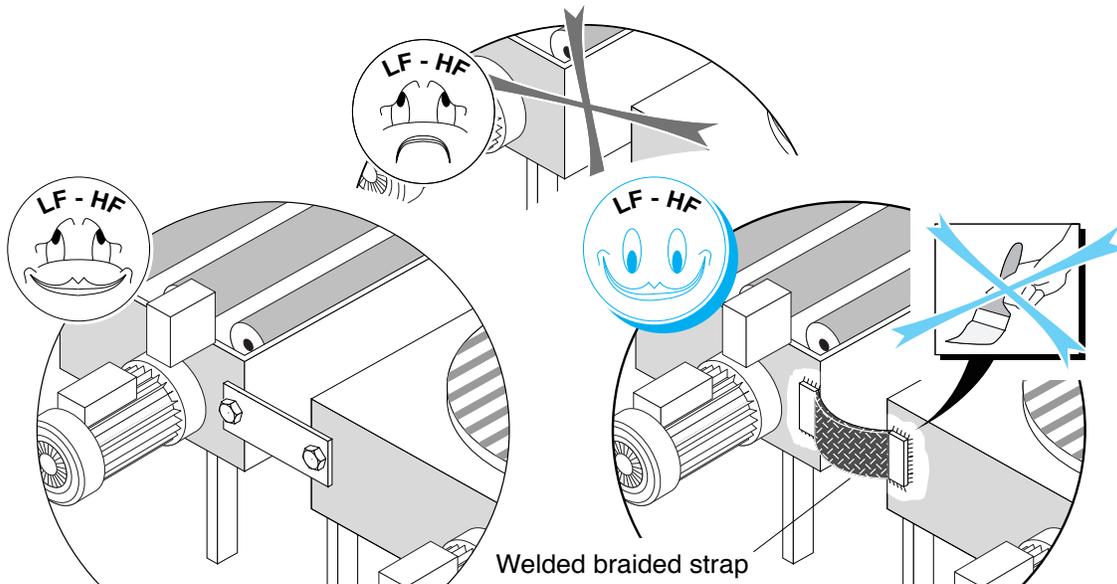

# Connections

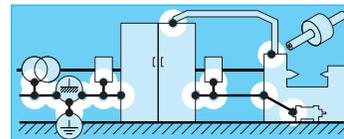

## Connection of shielding

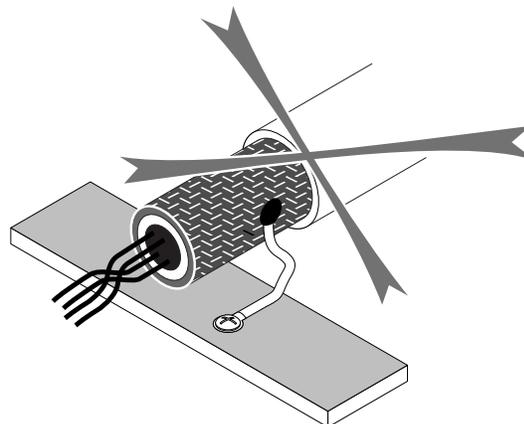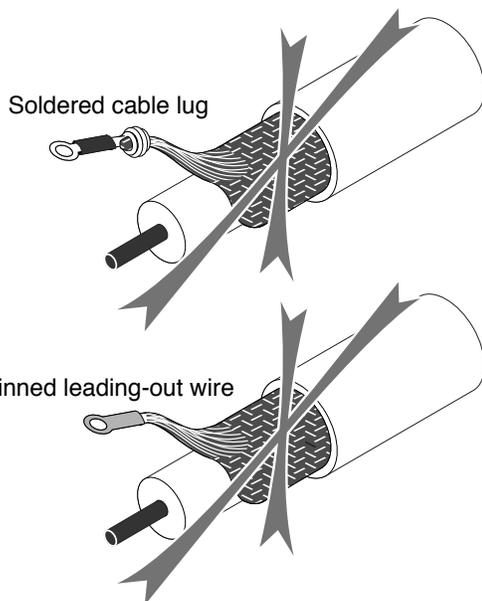


- 1
- 2
- 3

Earth plane  
or  
earth busbar  
connected to chassis


 **Ensure metal-to-metal contact**

Ideally: contact over 360°

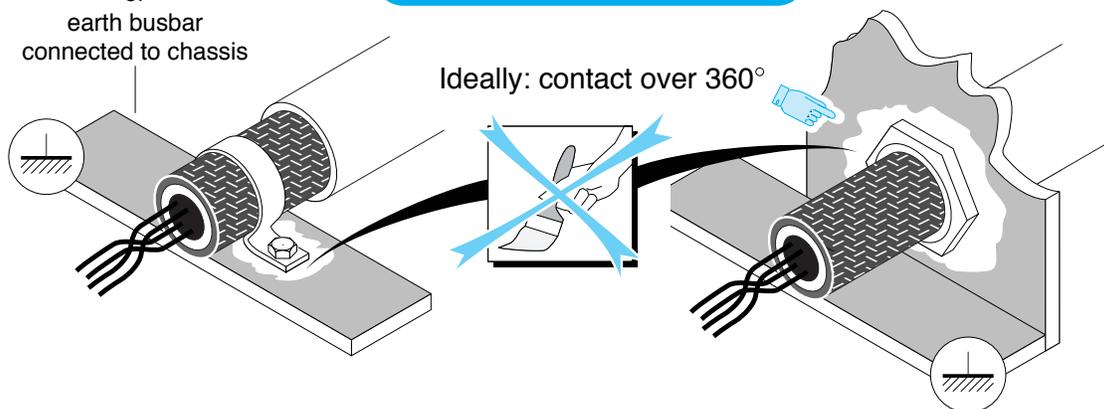

 **Watch out for insulating plastic tape between shielding and sheath**


*Connections at the end of shielding must provide metal-to-metal bond over 360°.*

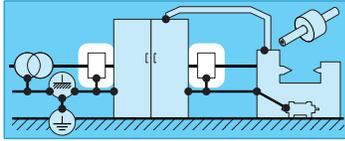


# Filters

## Layout in cabinet


- 1
- 2
- 3

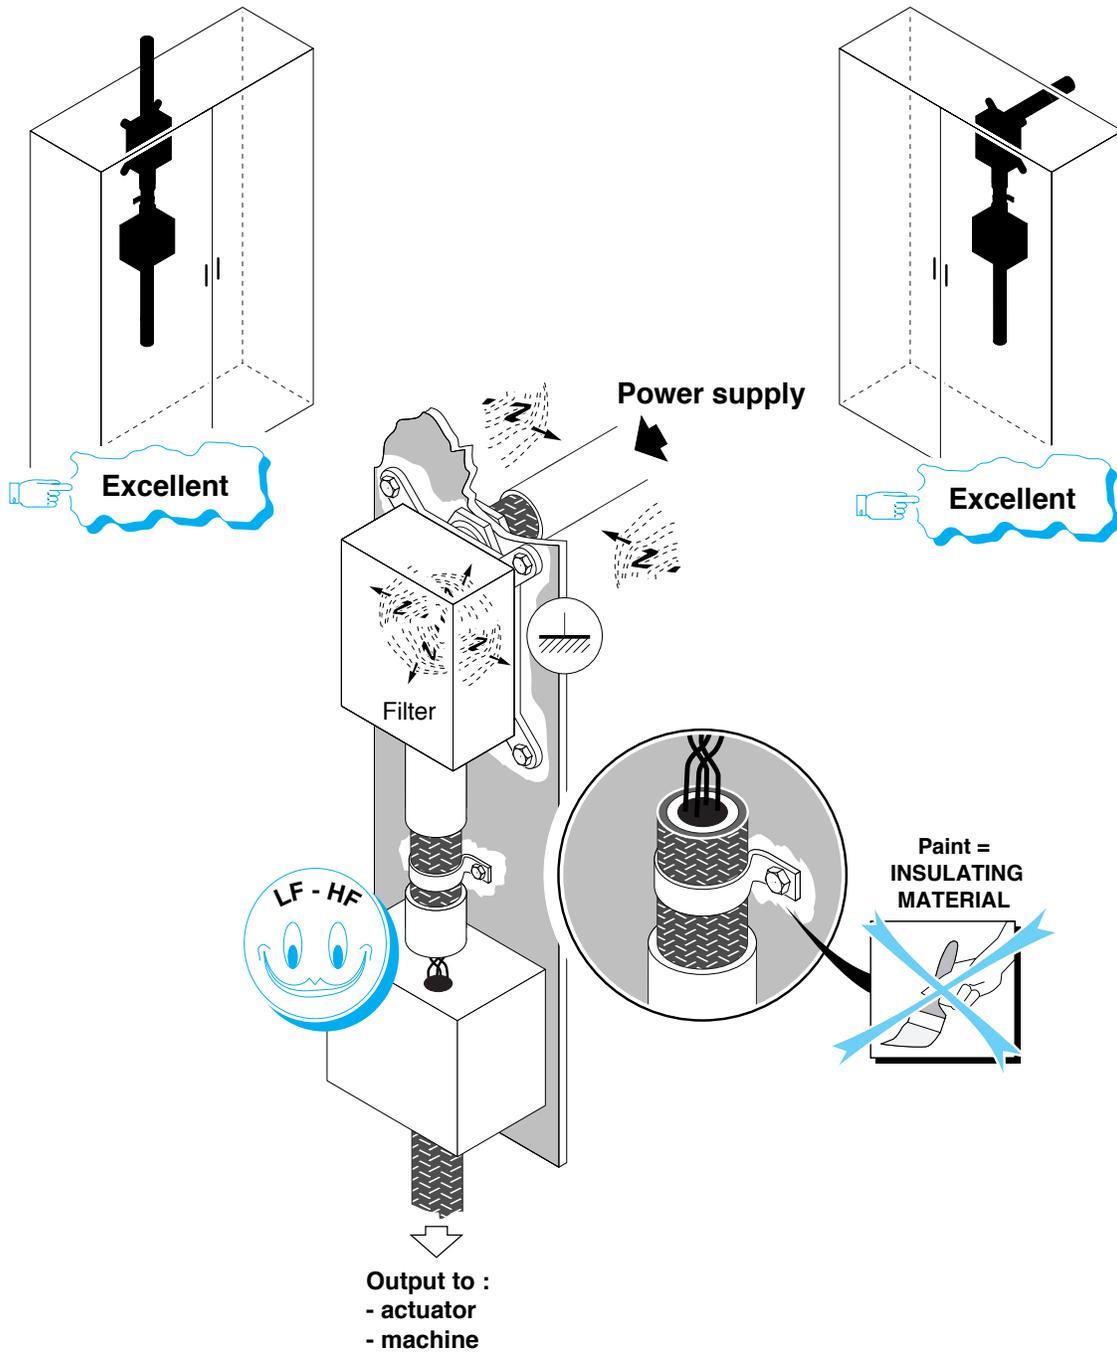


# Filters

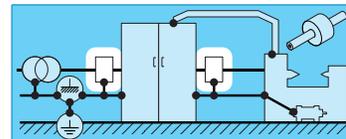

 **The input cable must not run alongside the output cable**

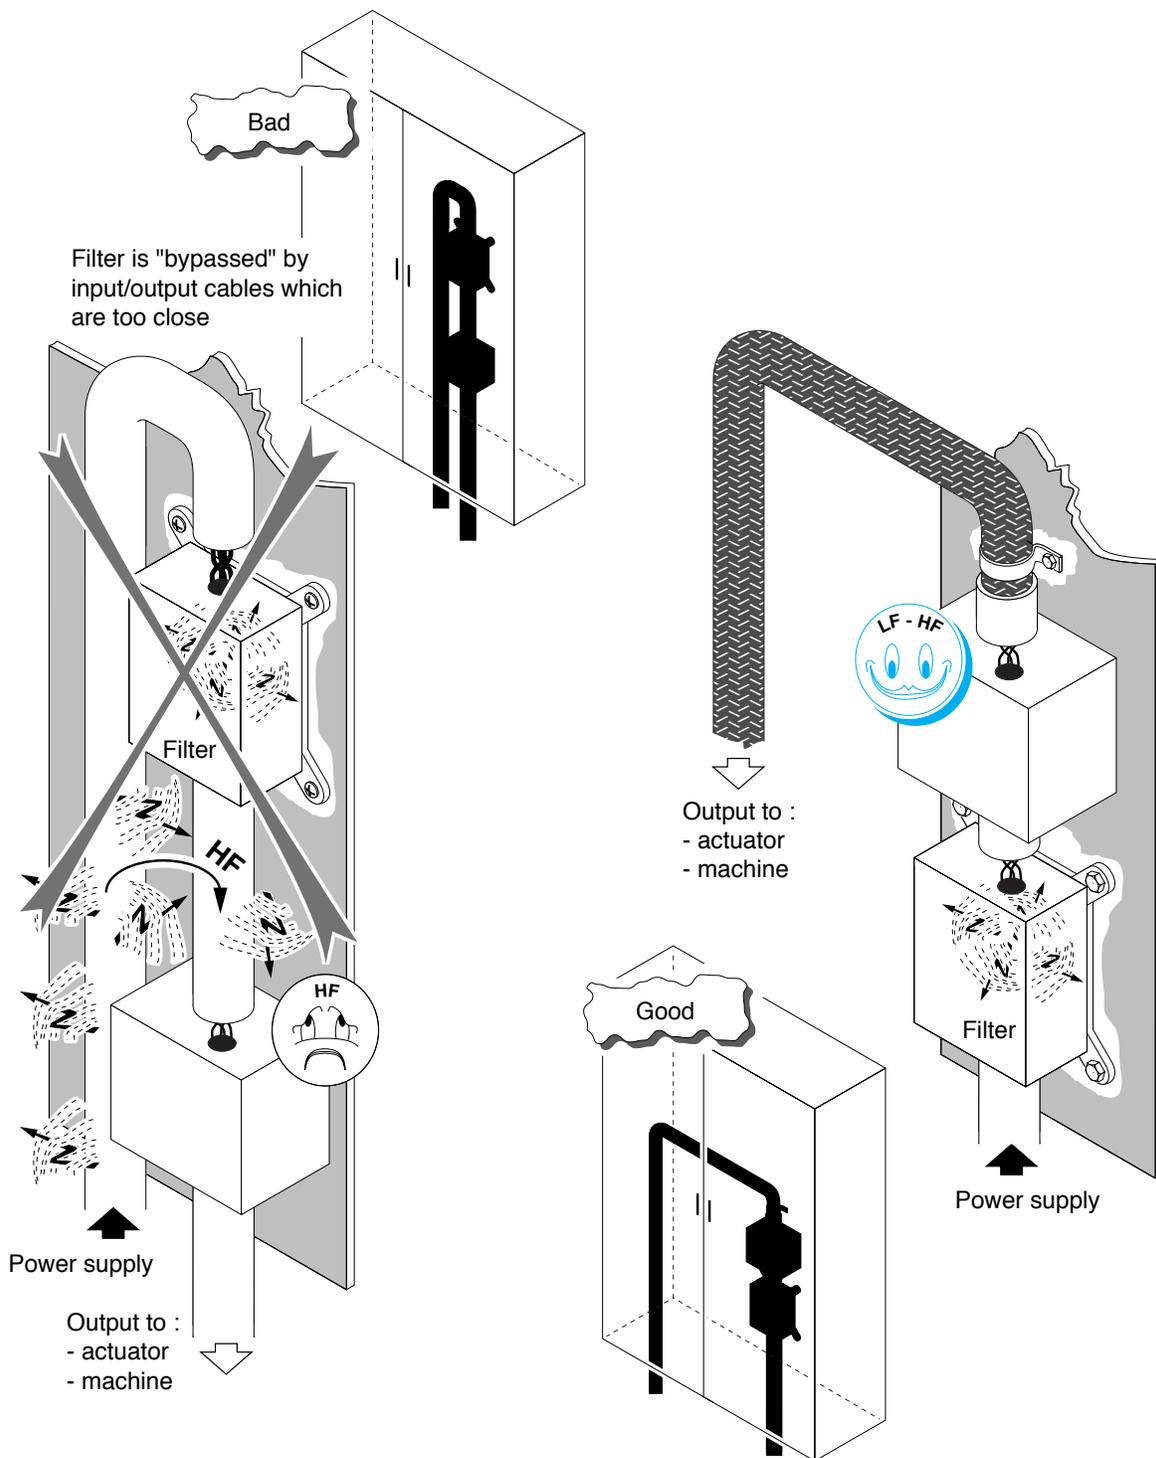


- 1
- 2
- 3




# Filters

## Mounting of filters

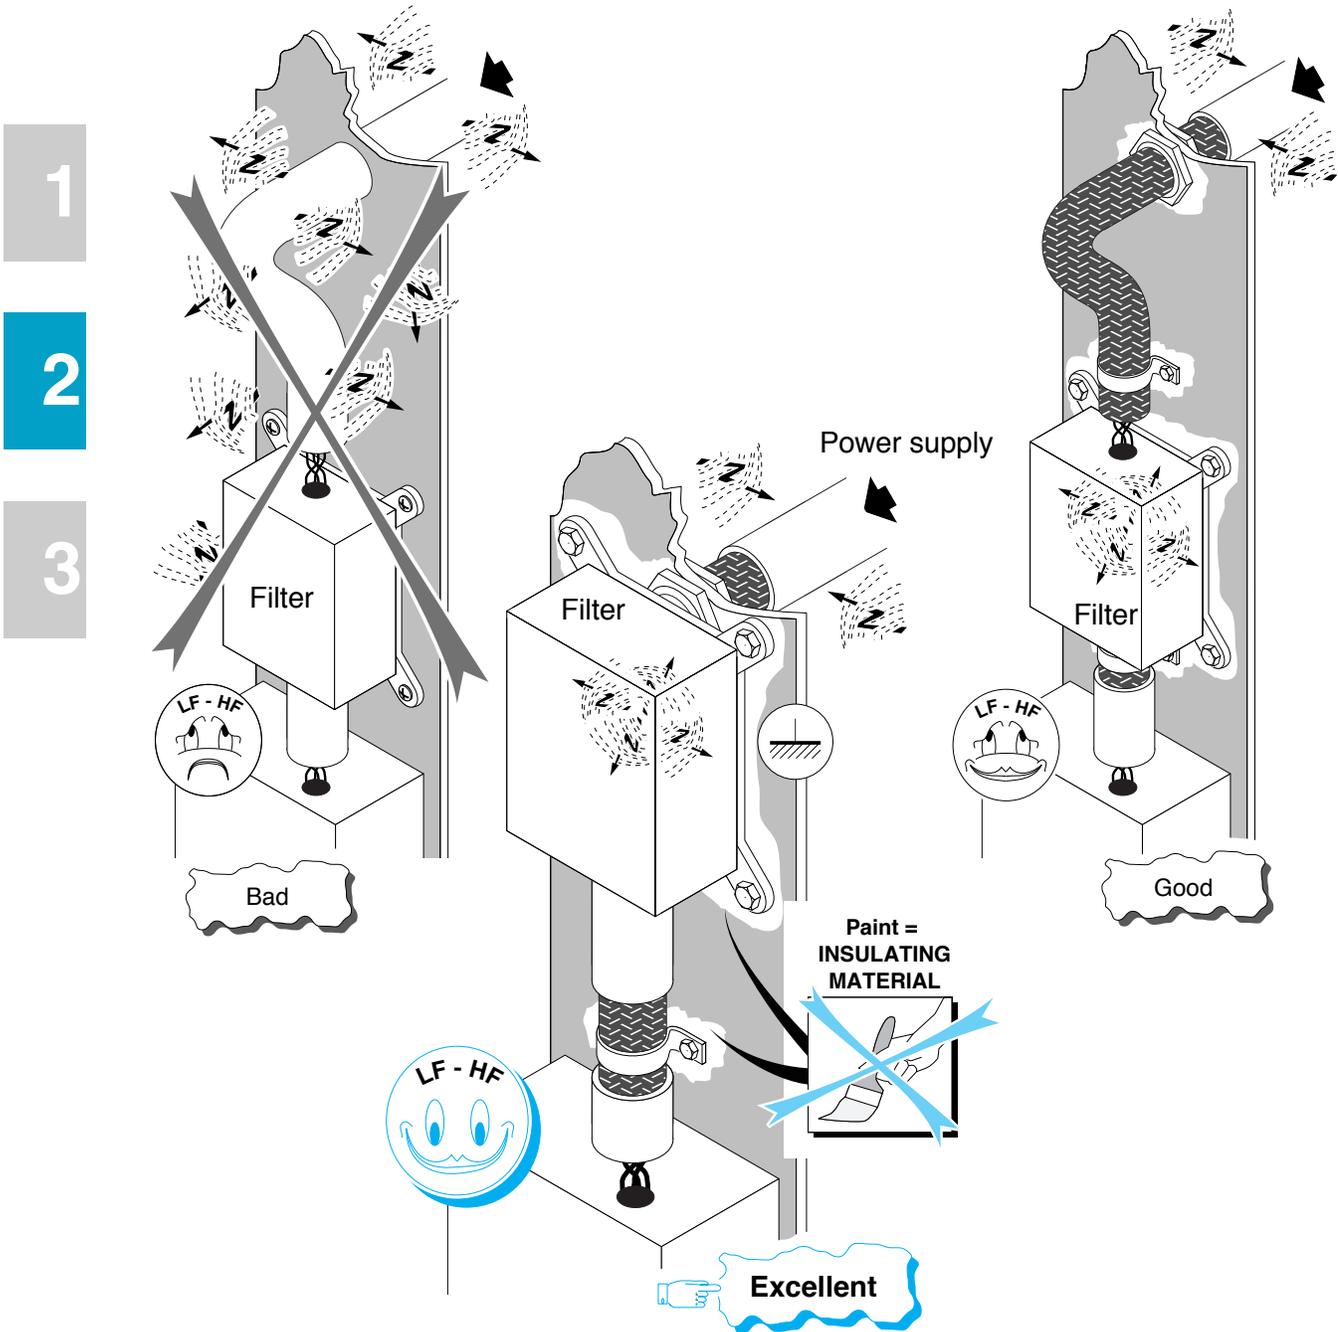


Filters must be fitted at the point where cable enters the cabinet cable and be bolted to the chassis or earth plane at the bottom of the cabinet

# Filters

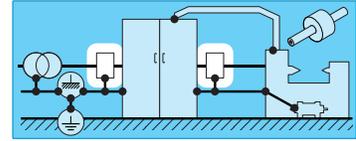


## Connections of filters

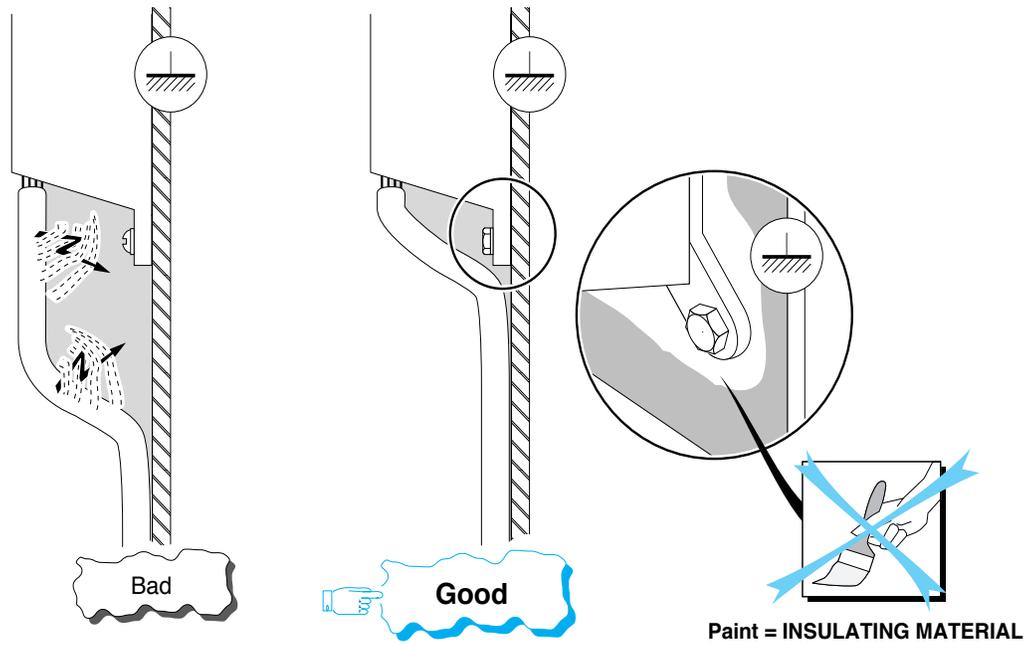

- 1
- 2
- 3

*Lay cables against earth reference plane at the bottom of the cabinet*

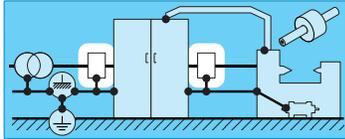

# Surge arresters

## Surge arresters or coil interference suppression modules : choice


- 1
- 2
- 3

The various devices listed below are intended to reduce:

- disconnection surges
- residual high frequency (HF) (level, quantity and slope of disruptive-breakdown wave fronts)

Oscillogram	Type of interference suppression	Circuit diagram	Overvoltage limiting	
	---		> 1 kv	No limiting. High overvoltage of up to several kV preceded by a train of breakdown impulses with steep wave fronts.
	R - C circuit The RC damps the wave front		$\approx 2U_c$	Good limiting: of the order of twice the control voltage $U_c$ .  (Variable depending on instant of disconnection, coil type and values of R and C).
	Varistor		$\approx 2U_c$ Predetermined	Limiting of overvoltage to a predetermined peak clipping value of the order of twice the maximum control voltage $U_c$ .
	Bidirectional clipper diode		$\approx 2U_c$ Predetermined	Limiting of overvoltage to a predetermined peak clipping value of the order of twice the maximum control voltage $U_c$ .
	"Freewheeling" diode		$U_c$ No overvoltage	Total elimination of overvoltage.


# Surge arresters

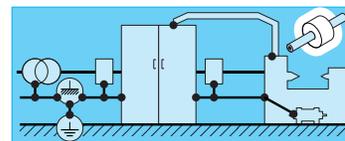

A combination of clipper diodes + RC combines the advantages of both circuits

Application	Fall time	Effect on function
<p>Typical overvoltage across the terminals of a coil disconnected by a dry contact.</p> <p>Example: contactor, 9 A rating.</p> <p><a href="#">For details, see Chapter 1.</a></p>	$Tr_1$	
<ul style="list-style-type: none"> <li>In conjunction with a.c. powered devices. Not widely used with d.c. (volume and cost of equalizer).</li> <li>Assists disconnection (reduced wear of control contact).</li> <li>Effect on high frequencies (HF) :                             <ul style="list-style-type: none"> <li>Eliminates steep wave fronts or disruptive breakdown (no flow of high-frequency (HF) currents in the control circuit).</li> <li>Only a damped low-frequency (LF) oscillating voltage waveform can be observed (order of magnitude <math>\simeq 100</math> Hz).</li> </ul> </li> </ul>	$Tr = 1$ to $2$  $Tr_1$	<ul style="list-style-type: none"> <li>Increase in fall time by a factor of the order of 1 to 2.</li> </ul> <p>(Generally acceptable given the large dispersion of fall times with a.c.)</p>
<ul style="list-style-type: none"> <li>In conjunction with a.c. or d.c. powered devices.</li> <li>Assists disconnection (reduced wear of control contact).</li> <li>Effect on high frequencies (HF) :                             <ul style="list-style-type: none"> <li>Before clipping threshold is reached, a train of short-duration breakdown pulses may occur depending on the type of contact and order of magnitude of UC.</li> <li>Possible flow of low-amplitude, short-duration high-frequency (HF) current in control circuit. courte durée possible dans le circuit de commande.</li> </ul> </li> <li>Capable of handling significant energy (more than RC).</li> </ul>	$Tr = 1,2$ to $2$  $Tr_1$	<ul style="list-style-type: none"> <li>Increase in fall time by a factor of the order of 1.2 to 2.</li> </ul>
<ul style="list-style-type: none"> <li>In conjunction with a.c. or d.c. powered devices (excluding unidirectional clipper diodes that have interference suppression).</li> <li>Assists disconnection (reduced wear of control contact).</li> <li>Effect on high frequencies (HF) :                             <ul style="list-style-type: none"> <li>Little residual HF (limited risk of breakdown) for low-level control voltages (UC).</li> <li>Possible flow of low-amplitude, very short-duration HF currents in control circuit for high control voltages <math>&gt; 200</math> V (HF performance similar to that of varistor).</li> </ul> </li> </ul>	$Tr = 1,2$ to $2$  $Tr_1$	<ul style="list-style-type: none"> <li>Increase in fall time by a factor of the order of 1.2 to 2.</li> </ul>
<ul style="list-style-type: none"> <li>In conjunction with d.c. powered devices (biased component).</li> <li>Assists disconnection (reduced wear of control contact).</li> <li>Effect on high frequencies (HF) :                             <ul style="list-style-type: none"> <li>On disconnection, the diode handles the energy restored by the inductor in the form of a current, the voltage across its terminals is almost zero and the voltage across the terminals of the control contact equals UC</li> </ul> </li> <li>No risk of breakdown and corresponding HF interference.</li> </ul>	$Tr = 4$ to $8$  $Tr_1$	<ul style="list-style-type: none"> <li>Increase in fall time by a factor of the order of 4 to 8.</li> </ul> <p>(Variable depending on type and size of electromagnet).</p>

- 1
- 2
- 3

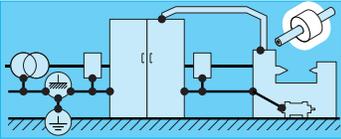


# Ferrite cores

**The «outgoing» and «return» conductors for the signal to be cleaned up must both pass through the ferrite core.**

1

2



3

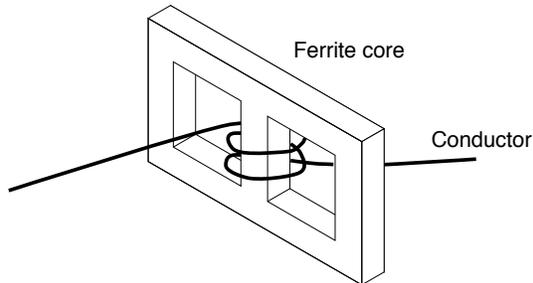

The number of turns increases the effectiveness but also creates stray capacitance between turns. The max. number of turns not to be exceeded depends on the :

- frequency of interference
- cable
- ferrite core

==> Experiment to find the optimum.

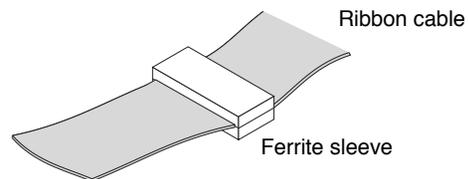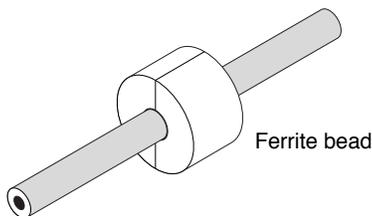

Half-shell ferrite sleeves are easier to install but less effective than solid (enclosed) ferrite sleeves.

-  Emission problem : ferrite sleeve must be located as close as possible to the interfering device.
-  Immunity problem : ferrite sleeve must be located as close as possible to the sensitive device only if the interfering equipment cannot be interference suppressed or it cannot be identified.



# CHAPTER 3

---

## (EMC) STANDARDS, FACILITIES AND TESTS

1

2

3

# Standards

---

## Introduction

A standard is a collection of rules, descriptions and methods that manufacturers can use as a reference when defining and testing one of their products.

1

### There are 3 types of (EMC) standards

2

#### *Basic publications or standards*

These are standards or guides that define, in general terms, requirements relating to (EMC) (phenomena, tests, etc.).

3

They are applicable to all products and are used as a reference, especially by committees who have to prepare specific standards.

Basic standards will not be harmonized at a European level.

#### *Generic (European) standards*

These standards define essential requirements in terms of levels that must be withstood by each product, type tests, etc. borrowed from basic standards.

If there is no product or product family standard, they apply to any product installed in a defined environment.

#### *Product or product family standards*

These standards define the applicable constructional provisions, characteristics, test methods and severity levels etc. applicable to given products or product families.

Where they exist, these standards take precedence over generic standards.

*Note: the type of standard is stated in the header of each publication.*



# Standards

## Standardising bodies

CISPR : International Special Committee on Radio Interference,  
IEC : International Electrotechnical Commission (Geneva),  
CENELEC : European Committee for Electrotechnical Standardisation (Brussels),  
Document references start with the letters EN, ENV, HD ...

1

UTE : Union Technique de l'Electricité en France  
(French Electrical Engineering Association),  
The UTE is the French member of CENELEC  
UTE document references start with the letters NF ...

2

3

## CISPR Publications

The first CISPR Publications were printed in 1934. They aim to protect the transmission and reception of radio waves.

They define, in particular, the test conditions and emission limits for electrical and electronic products.

# Standards

---

## Examples of CISPR Publications applicable to our products

1

CISPR 11-1990 Limits and methods of measuring the characteristics of electromagnetic interference produced by radiofrequency industrial, scientific and medical (ISM) devices.

2

CISPR 14-1993 Limits and methods of measuring the radiofrequency interference produced by domestic or similar electrical appliances having motors or thermal devices, electric tools and similar electrical appliances.

3

CISPR 16-1-1993 Specifications for methods and instruments for measuring radiofrequency interference and immunity to radiofrequency interference.

First part : Measuring instruments for radiofrequency interference and immunity to radiofrequency interference.

CISPR 17-1981 Méthodes de mesure des caractéristiques d'antiparasitage des éléments de réduction des perturbations radioélectriques et des filtres passifs.

CISPR 18-1-1982 Methods of measuring the interference suppression characteristics of components to reduce radiofrequency interference and of passive filters.

First part : Description of phenomena.

CISPR 22-1993 Limits and methods of measuring the characteristics of data processing equipment relating to radiofrequency interference.



# Standards

## IEC Publications

### *Standards in the IEC 801-X series*

Standards in the IEC 801-X series first appeared in the 1970's. They deal with the Electromagnetic Compatibility of industrial-process measurement and control equipment.

They are aimed at manufacturers and users of these types of equipment.

These standards are currently being superseded by standards in the IEC 1000-4-X series.

1

2

### *Standards in the IEC 1000-X-X series*

IEC 1000-X-X Publications are devoted entirely to Electromagnetic Compatibility and have incorporated all IEC standards relating to this area since 1991.

3



# Standards

Technische Universität München

9

Part	IEC	Current IEC Reference	Topic	EN/ENV equivalent	NF C Equivalent
General		IEC 1000-1-1 (1992)	Application and interpretation of fundamental definitions and terms.		
Environment		IEC 1000-2-1 (1990)	Electromagnetic environment for conducted low-frequency (LF) interference and the transmission of signals over public supply networks.		
		IEC 1000-2-2 (1990)	Compatibility levels for conducted low-frequency (LF) interference and the transmission of signals over low-voltage public supply networks.		
		IEC 1000-2-3 (1992)	Radiated phenomena and conducted phenomena at frequencies other than mains frequencies.		
		IEC 1000-2-4 (1994)	Compatibility levels in industrial installations for conducted low-frequency interference.		NF C 91-002-4 (1995-08)
		IEC 1000-2-5 (1995)	Classification of electromagnetic environments.		
Limits	555-2	IEC 1000-3-2(1995)	Limits for rated harmonic current < 16 A per phase emitted by appliances.	EN 61000-3-2 (1995)	NF C 91-003-2 (1995-08)
	555-3	IEC 1000-3-3 (1994)	Limitation of voltage fluctuations and flicker in low-voltage systems for equipment having a rated current ≤ 16 A.	EN 61000-3-3 (1995)	NF C 91-003-3 (1995-08)
		IEC 1000-3-5 (1994)	Limitation of voltage fluctuations and flicker in low-voltage systems for equipment having a rated current > 16 A.		
Test and measurement techniques	801-1	IEC 1000-4-1 (1992-12)	Overview of immunity tests. Basic (EMC) publication.	EN 61000-4 (1994-08)	NF EN 61000-4-1 NF C 91-004-1 (1995-01)
	801-2	IEC 1000-4-2 (1995-01)	Testing of immunity to electrostatic discharges. Basic (EMC) publication.	EN 61000-4-2 (not yet published)	NF C 91-004-2 (1995-06)

# Standards

Part	IEC	Current IEC Reference	Topic	EN/ENV Equivalent	NF C Equivalent
Test and measurement techniques (continued)	801-3	IEC 1000-4-3 (1995-02)	Testing of immunity to radiated radiofrequency electromagnetic fields.	ENV 50140 (1993)	
	801-4	IEC 1000-4-4 (1995-01)	Testing of immunity to high-speed burst transients. Basic (EMC) publication.	EN 61000-4-4 (not yet published)	NF C 91-004-4(1995-06)
	801-5	IEC 1000-4-5 (1995-02)	Testing of immunity to impulse waves.	EN 61000-4-5 (not yet published)	NF C 91-004-5 (1995-06)
		pr IEC 1000-4-6	Immunity to conducted interference induced by radiofrequency fields.	ENV 50141 (1993)	
		IEC 1000-4-7 (1991-07)	Guidance on measurement of harmonics and interharmonics and measuring apparatus applicable to power supply systems and devices connected to them.	EN 61000-4-7 (1993-03)	NF EN 61000-4-7 NF C 91-004-7 (1993-06)
		IEC 1000-4-8 (1993-06)	Testing of immunity to mains-frequency magnetic fields. Basic (EMC) publication.	EN 61000-4-8 (1993-09)	NF EN 61000-4-8 NF C 91-004-8 (1994-02)
		IEC 1000-4-9 (1993-06)	Testing of immunity to impulsive magnetic fields. Basic (EMC) publication.	EN 61000-4-9 (1993-09)	NF EN 61000-4-9 NF C 91-004-9 (1994-02)
		IEC 1000-4-10 (1993-06)	Testing of immunity to damped oscillating magnetic fields. Basic (EMC) publication.	EN 61000-4-10 (1993-09)	NF EN 61000-4-10 NF C 91-004-10 (1994-02)
		IEC 1000-4-11 (1994-06)	Testing of immunity to voltage dips, brief power failures and voltage variations.	EN 61000-4-11 (1994-09)	NF EN 61000-4-11 NF C 91-004-11 (1995-01)
		pr IEC 1000-4-12	Testing of immunity to damped oscillating waves. Basic (EMC) publication.		
Installation recommendations		IEC 1000-5-1	General considerations		
		IEC 1000-5-2	Earthing and wiring		
		IEC 1000-5-3	External influences		

# Standards

---

## CENELEC Publications

EN or ENV ... Publications lay down the standards that are applicable throughout the European Free Trade Area (EFTA).

1

They are currently being harmonised with the (EMC) Directive.

They generally reproduce existing international standards.

2

Examples: EN 55011 restates CISPR 11

EN 61000-4-1 restates IEC 1000-4-1

3

### ***Generic (European) standards***

In the absence of specific standards for products or product families, these generic standards are applicable within the European Free Trade Area (EFTA).

They are harmonised at a European level.

### ***Product or product family standards***

These standards are applicable to the products or product families concerned.

They lay down the applicable requirements and test severity levels.

Within Europe, if they exist and are harmonised, they take precedence over generic or basic standards.

Example : EN 60947-1 A11

Low-voltage switchgear and controlgear (general), Amendment A11 : Specific (EMC) details.



# (EMC) facilities and tests

## *National standards*

These are issued in France by the UTE.

The standards currently circulated in France generally restate European standards.

Example:       NF EN 60947-1 A11 (France)

                  DIN EN 60947-1 A11 (Germany)

These standards supersede existing national standards that deal with the same topics.

Example : VDE 871, 875 ...

1

2

3

## (EMC) facilities and tests

A distinction must be made between two types of tests that can be performed on a product by using appropriate means.

### *Type tests*

These are tests that the manufacturer performs to obtain qualification approval of products before they are put on sale.

### *On-site tests*

These are tests that are performed on the equipment that the product incorporates. They are performed under the customer's responsibility and are intended to validate an installation, equipment or machine.

### *Test facilities*

The facilities and arrangements for applying these tests are precisely described in the standards.

# Index

---

---

## A

Antena effect : 1- 52  
Arrangements : 2-20

---

---

## B

Building : 2-9

---

---

## C

Cabinet : 2-12, 2-26, 2-45  
Cable runs : 2-44  
Cable trough : 2-44  
Cables : 1- 49, 2-32  
Capacitance : 1- 4  
Class : 2-32  
Conductive : 1- 32  
Conductor : 1- 49  
Connection : 2-45, 2-48, 2-52  
Coupling : 1- 30, 1- 32, 1- 34  
Cross-sectional area : 1- 51

---

---

## D

Daisy-chained : 2-14  
Decoupling : 1- 38  
Discharges : 1- 16  
Designing : 2-4  
Distribution : 2-24

Disturbance : 1- 7  
Dry contacts : 1- 20

---

---

## E

Earth : 1- 40  
Earth connections : 1- 40  
Earthing interconnections : 2-13, 2-14,  
2-15, 2-16, 2-17  
Earthing plane: 2-28  
Earthing system : 2-8  
Electric motors : 1- 25  
Equipment : 2-11

---

---

## F

Ferrite cores : 1- 57, 2-62  
Filters : 1- 54, 2-56  
Fluorescent : 1- 27  
Frame connections : 1- 42  
Frequency : 1- 3, 1- 4, 1- 49

---

---

## G

Green/yellow : 1- 53

---

---

## H

Harmonics : 1- 10, 1- 12

# Index

---

---

## I

Implantation : 2-56  
Improving : 2-6  
Inductance : 1- 4  
Inductive : 1- 20, 1- 23  
Installation : 2-24  
Interconnection : 1- 53, 2-14  
Interference : 1- 9, 1- 18, 1- 20, 1- 29,  
1- 30, 1- 38  
Isolation : 2-19

---

## L

Liaisons : 2-13  
Lighting : 1- 27  
Loads : 1- 20, 1- 23  
Loops : 1- 46

---

## M

Machine : 2-11  
Maintaining : 2-5  
Montage : 2-58

---

## O

Origin : 1- 8

---

## P

Performances : 2-34  
Pitfalls : 2-54  
Plan : 2-28  
Positioning : 2-46  
Power supply : 2-18  
Procedure : 2-3

---

## R

Raccordement : 2-45, 2-55  
Radiation : 1- 34  
Rules : 2-36

---

## S

Safety : 1- 42  
Semiconductors : 1- 23  
Shielding : 2-55  
Signals : 2-32  
Source : 1- 20  
Spot welding : 1- 28  
Standards : 3-2  
Star configuration : 1- 48  
Surge arresters : 2-60

---

## T

Transients : 1- 14  
Transformer : 2-19, 2-25

# Index

Transmission : 1- 30

Type : 1- 7

---

---

## U

Upgrading : 2-5

---

---

## W

Welding : 1- 28

Wiring : 2-36



This working document is not contractually binding.  
In order to ensure that it evolves to better meet your requirements, please send your observations and comments to :

or to the following address : **your Telemecanique retailer**

**Schneider Electric SA**  
centre Telemecanique  
5, rue Nadar  
92566 Rueil-Malmaison Cedex - France  
tél: (33-1) 41 29 82 00 - Fax : (33-1) 47 51 80 20

**Schneider Electric** reserves the right to change the characteristics of its products and services at any time in order to incorporate the latest technological developments. The information contained in this document is therefore subject to change without notice.

© **Copyright Schneider Electric 1995.**

this document may not be reproduced or copied, in whole or in part, in any form or by any means, photographic, magnetic including photocopying, transcription or transfer to a data base

**Schneider Electric SA**    **Centre Telemecanique**  
5, rue Nadar  
92566 Rueil-Malmaison Cedex - France  
Tel: (33-1) 41 29 82 00

**Schneider Electric** reserves the right to change the characteristics of its products and services at any time in order to incorporate the latest technological developments. The information contained in this document is therefore subject to change without notice.

© **Copyright Schneider Electric 1995.**  
this document may not be reproduced or copied, in whole or in part, in any form or by any means, photographic, magnetic including photocopying, transcription or transfer to a data base

---

# Contents

---

## CHAPTER 4

### Installation analysis guide

<b>Contents</b> .....	<b>4-2</b>
<b>Environment</b> .....	<b>4-3</b>
Environment outside the site .....	4-3
Environment within the site .....	4-3
<b>Distribution network</b> .....	<b>4-4</b>
Internal power distribution diagram .....	4-4
General power supply .....	4-4
<b>Cabinet / equipment power supply</b> .....	<b>4-5</b>
Main power supply .....	4-5
Control power supply .....	4-5
<b>Type of cabinet / equipment components</b> .....	<b>4-6</b>
Low level electronics .....	4-6
Power equipment .....	4-6
Power circuit .....	4-7
Low level control circuit .....	4-7
Cable / conductor routing .....	4-8
Cables, wires, bunches, etc. ....	4-9
<b>Types of loads</b> .....	<b>4-10</b>
Motors .....	4-11

# Contents

---

## CHAPTER 5

### Solutions/ Malfunctions

<b>Malfunctions covered in this chapter .....</b>	<b>5-5</b>
INTERFERING equipment .....	5-5
Equipment AFFECTED BY INTERFERENCE.....	5-5
<b>Combating electromagnetic interference in an installation .....</b>	<b>5-6</b>
Common section.....	5-6
First sheet .....	5-9
Last sheet .....	5-48

---

# CHAPITRE 4

---

## INSTALLATION ANALYSIS GUIDE

1

2

3

4

5

QUALITY OF OUR SERVICE

=

QUALITY OF THE INFORMATION

=

QUALITY OF OUR RÉSPONSE

# Contents

---

1

Company: .....

Activity: .....

Contact name(s): .....

Position(s): .....

Company address: .....

Country: ..... Tel.: ..... Fax: .....

2

Branch: .....

Dealer: ..... Technical support: .....

3

**References of the equipment concerned:**

Interfering: ..... Affected by interference: .....

4

Description of the failure = (facts observed): .....

.....

.....

.....

5

Are any other equipment items or installations affected by interference ? (type, reference, process, etc.) .....

.....

.....

.....

Description of the process of the machine affected by interference:

.....

.....

.....

# Environment

## Environment outside the site

- Grid or region exposed to lightning? .....  yes  no
  
- Adjacent plant, installation or process identified as the interfering source (welding, electro-thermics, micro-wave drying).  
Specify: .....
  
- Adjacent radio-electric transmitters: civilian or military .....  yes  no  
(TV, radio airport, radar, etc.) .....  
Specify: .....
  
- HV line, SNCF (railway) power line. Specify: .....  yes  no

1

2

## Environment within the site

- Ambient process identified as the source of interference: .....  yes  no  
(e.g. welding, furnaces, electronic speed controller, etc.)
  
- Geographic position of the equipment affected by interference in the installation or process.

*Attach diagrams, photographs, advertising brochures, etc.*

3

4

5

# Distribution network

## Internal power distribution diagram

Attach diagrams (single-wire and developed)

1

2

## General power supply

3

4

5

Nominal power rating:	P =								
Estimated power consumption (steady state)	P =								
Short-circuit intensity:	I <sub>cc</sub> =								
Earthing arrangement:	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 25%;">TT</td> <td style="width: 25%;">IT</td> <td style="width: 25%;">TN-C</td> <td style="width: 25%;">TN-S</td> </tr> <tr> <td><input type="checkbox"/> Yes</td> <td><input type="checkbox"/> No</td> <td><input type="checkbox"/> Yes</td> <td><input type="checkbox"/> No</td> </tr> </table>	TT	IT	TN-C	TN-S	<input type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> Yes	<input type="checkbox"/> No
TT	IT	TN-C	TN-S						
<input type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> Yes	<input type="checkbox"/> No						
A single earth in the installation:	<input type="checkbox"/> Yes <input type="checkbox"/> No								
Bank of cos φ rectification capacitors:	<input type="checkbox"/> Yes <input type="checkbox"/> No								
Anti-harmonic filtering:	<input type="checkbox"/> No <input type="checkbox"/> Yes <input type="checkbox"/> Passive <input type="checkbox"/> Active <input type="checkbox"/> Mixed								
Differential protection:	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 50%;">Type =</td> <td style="width: 50%;">Rating =</td> </tr> </table>	Type =	Rating =						
Type =	Rating =								
Continuous Insulation Tester (CPI):	Type =								
<b>Public Network</b>									
Single-phase, voltage:	U =								
Three-phase, mesh voltage:	U =								
Other:	U =								
<b>Private Network = power distribution transformer</b>									
Primary voltage (1); secondary (2):	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 50%;">U1 =</td> <td style="width: 50%;">U2 =</td> </tr> </table>	U1 =	U2 =						
U1 =	U2 =								
Coupling (e.g. DYN11):									

QUALITY OF OUR SERVICE = QUALITY OF THE INFORMATION = QUALITY OF OUR RESPONSE

# Cabinet / equipment power supply

## Main power supply

Separate power supply (dedicated transformer) .....  yes  no

Transformer type (screen):	None	Single	Double
Coupling:			
Short-circuit intensity:	Icc =		
Primary voltage (1); secondary (2):	U1 =	U2 =	
Nominal power rating:	P =		
Earthing arrangement:	TT	IT	TN-C / TN-S
Differential protection:	Type :	Rating:	
Continuous insulation tester (CPI):	Type :		

1

2

## Control power supply

Separate power supply (dedicated transformer) .....  yes  no

Type / reference (specify): .....

.....

Transformer (screen):	None	Single	Double
Primary voltage (1); secondary (2):	U1 =	U2 =	
Nominal power rating:	P =		
Earthing arrangement:	TT	IT	TN-C / TN-S
Type of rectification:			

-- Specify the answer --

Type of filtering: .....

.....

Type of regulation: .....

.....

Nature and type of protection devices, rating: .....

.....

.....

3

4

5

# Type of cabinet / equipment components

## Low level electronics

Supervisors (type/quantity): .....

Controllers (type/quantity): .....

Bus: .....

Input/output boards (type, quantity): .....

Characteristics and immunity of inputs/outputs (attach manufacturer's documentation):  
 .....  
 .....

1

## Power equipment

### Electronic speed controllers

Type, characteristics: .....

Associated options (e.g. bus, braking resistance, etc.) .....

Upstream filter/inductance (type): .....  no  yes

Downstream filter/inductance (type): .....  no  yes

3

### Contactors / relays

Type, characteristics, quantity: .....

Interference suppression (type): .....  no  yes

Control device: ..... 

Relaying	Manuel switch	Sensors	Controller output
----------	---------------	---------	-------------------

4

### Other devices

Type(s), characteristic(s), etc ... ..

.....

.....

.....

.....

.....

.....

5

QUALITY OF OUR SERVICE = QUALITY OF THE INFORMATION = QUALITY OF OUR RESPONSE

# Wiring / Connection / Routing in the installation

## Power circuit

Type of devices powered: .....  
.....  
.....

Do the cables pass through intermediate terminals? .....  yes  no

Separation of cables in cabinet bottom (distance): .....  yes  no

1

## Low level control circuit

Type of devices powered: .....  
.....  
.....

Do the cables pass through intermediate terminals? .....  yes  no

Separation of cables in cabinet bottom (distance): .....  yes  no

2

3

4

5

# Wiring / Connection / Routing in the installation

**Cable / conductor routing:** (additional information)

- 1
- 2
- 3
- 4
- 5

<b>Overhead</b>						
Metal cable troughs	Plastic cable troughs	Metal tubes	Ladders	Other:		
<b>Underground</b>						
Cement channel	Metal duct/ tube	Plastic duct/ tube	Other:			
<b>Type of connection</b>						
Metal on metal	Painted coating	Locking compound	Teflon	Bolts	Screws	Other:
<b>Straight line</b>						
Bolted together	Placed on top of each other	Separate	Separate and connected by green/yellow conductor L =			Other:
<b>Bends, deviations, corners, etc.</b>						
Bolted together	Placed on top of each other	Separate	Separate and connected by green/yellow conductor L =			Other:
<b>Through partitions (walls, etc.)</b>						
Bolted together	Placed on top of each other	Separate	Separate and connected by green/yellow conductor L =			Other:
<b>Ends, cabinet lead-in, housing, etc.</b>						
Bolted together	Placed on top of each other	Separate	Separate and connected by green/yellow conductor L =			Other:

Separation of cable troughs, cables, etc.  
 according to wire signal classes .....  yes  no

Distance between cable troughs, cables ....:

Class 1-2/3-4 D ≥	Class 1/2 D ≥	Class 3/4 D ≥
----------------------	------------------	------------------

QUALITY OF OUR SERVICE = QUALITY OF THE INFORMATION = QUALITY OF OUR RESPONSE

# Wiring / Connection / Routing in the installation

## Cables, wires, bunches, etc.

### Class\* 1 (sensitive)

Length: .....	L ≈				
Type : .....	Standard	Twisted pair	Shielded	Non shielded	Armoured
Shielding connection to frame earth:.....	Not connected	1 end	2 ends	360°	"Pigtail" guide L ≈
Cable with unconnected wire (free) : .....	<input type="checkbox"/> no <input type="checkbox"/> yes		connected to frame earth at both ends		

--- Class\*: Non-standardised term adopted for the purposes of this document ([see chapters 1 and 2](#)) ---

### Class\* 2 (low sensitivity)

Length: .....	L ≈				
Type : .....	Standard	Twisted pair	Shielded	Non shielded	Armoured
Shielding connection to frame earth:.....	Not connected	1 end	2 ends	360°	"Pigtail" guide L ≈
Câble avec conducteur non raccordé (libre) : .....	<input type="checkbox"/> no <input type="checkbox"/> yes		connected to frame earth at both ends		

### Class\* 3 (low interference)

Length: .....	L ≈				
Type : .....	Standard	Twisted pair	Shielded	Non shielded	Armoured
Shielding connection to frame earth:.....	Not connected	1 end	2 ends	360°	"Pigtail" guide L ≈
Câble avec conducteur non raccordé (libre) : .....	<input type="checkbox"/> no <input type="checkbox"/> yes		connected to frame earth at both ends		

### Class\* 4 (interfering)

Length: .....	L ≈				
Type : .....	Standard	Twisted pair	Shielded	Non shielded	Armoured
Shielding connection to frame earth:.....	Not connected	1 end	2 ends	360°	"Pigtail" guide L ≈
Câble avec conducteur non raccordé (libre) : .....	<input type="checkbox"/> no <input type="checkbox"/> yes		connected to frame earth at both ends		

QUALITY OF OUR SERVICE = QUALITY OF THE INFORMATION = QUALITY OF OUR RESPONSE





# CHAPTER 5

## SOLUTIONS / MALFUNCTIONS

1


2

3

4

5

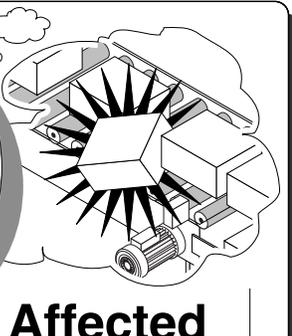


**Interfering**

**Affected**

Page 25

Experience base

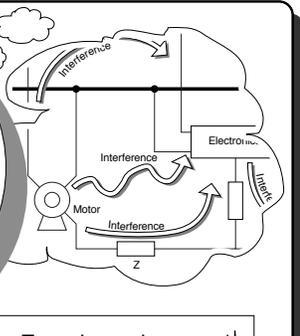
**Interfering**

**Affected**

**Malfunctions observed**

(SHEET) → Page 25

- 1
- 2
- 3
- 4
- 5

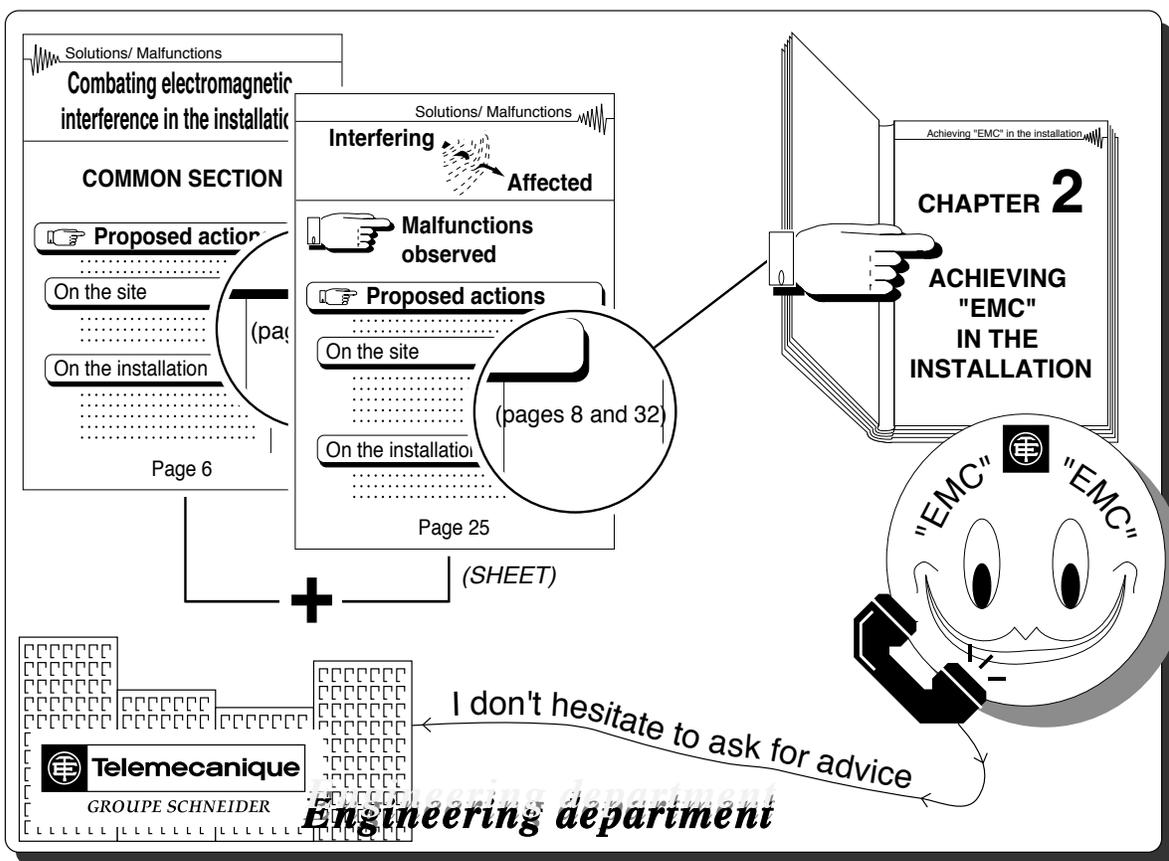

Solutions/ Malfunctions

Combating electromagnetic interference in the installation

COMMON SECTION

Proposed action

On the site

On the installation

Page 6

Interfering

Affected

Malfunctions observed

Proposed actions

On the site

On the installation

Page 25

(SHEET)

+

Achieving "EMC" in the installation

CHAPTER 2

ACHIEVING "EMC" IN THE INSTALLATION

"EMC" "EMC"

I don't hesitate to ask for advice

Engineering department


Telemecanique

GRUPE SCHNEIDER

1


2

3

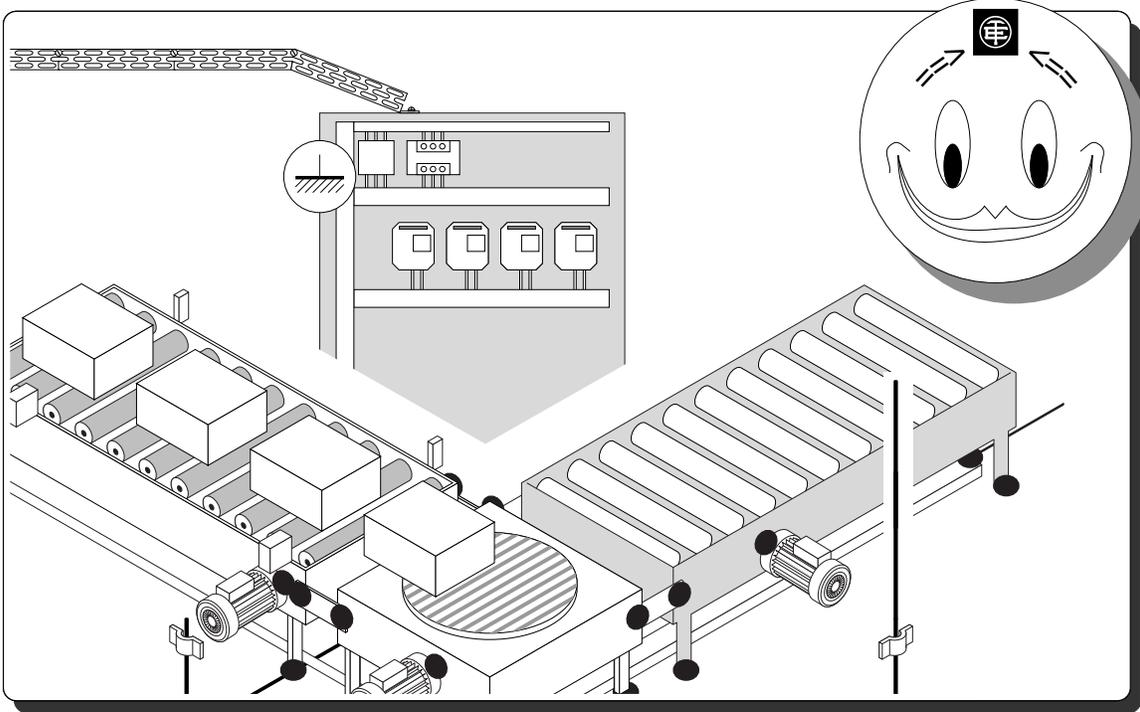

4

5

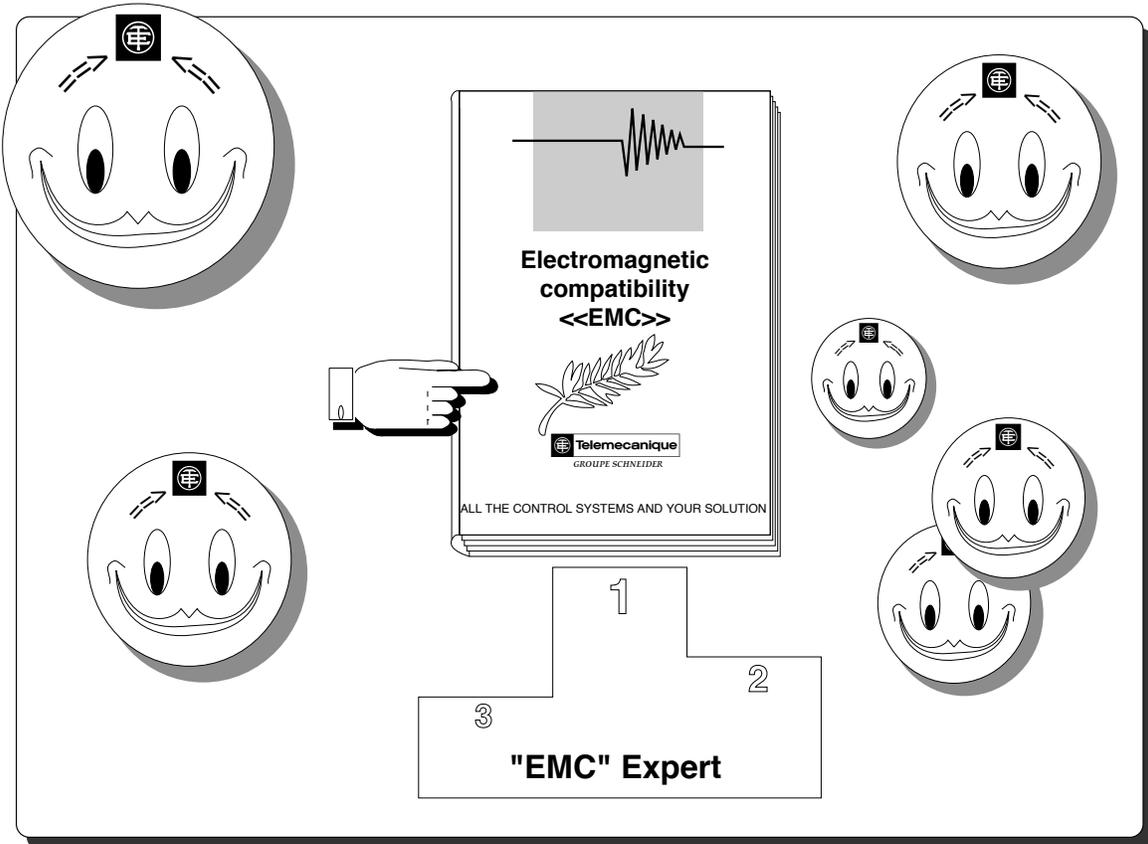

# MALFUNCTIONS COVERED IN THIS CHAPTER

## Equipment AFFECTED BY INTERFERENCE

**INTERFERING equipment**

 Common section <i>page 6</i>  <i>No. on the sheet's first page</i>	"Low level" sensors, instrumentation (measurement, regulation, computation, etc.).	Regulator analogue output	Telephone network - telephone	Differential protection devices	Radio receivers	Distribution transformers	Electronic speed controllers	Electronic measurement or control modules Static or converting interfaces Static contactors and relays Dimmers, starters and static brakes Electronic overload relays
Electronic speed controllers	<i>page 9</i>	<i>page 12</i>	<i>page 15</i>	<i>page 36</i>	<i>page 34</i>	<i>page 48</i>	---	---
Switching power supplies, DC/DC converter	<i>page 31</i>	---	---	---	---	---	---	---
Arc welding / spot welding system	<i>page 43</i>	---	---	---	---	---	<i>page 38</i>	---
Power surges, storms, etc.	<i>page 45</i>	---	---	---	---	---	---	---
Walkie-talkie, citizen band, portable telephone...	<i>page 40</i>	---	---	---	---	---	<i>page 47</i>	---
Switching of contactors, relays, solenoid valves, inductances. Starters and static brakes, waveform train dimmers.	<i>page 25</i>	---	---	---	<i>page 28</i>	---	---	---
Electromagnetic interference. Natural interference (lightning, etc.) Equipment or systems generating switching interference	---	---	---	---	---	---	---	<i>page 17</i>

- 1
- 2
- 3
- 4
- 5

--- : Not covered or not applicable.

# Combating electromagnetic interference in an installation



## OBSERVED MALFUNCTIONS

### Common section



#### PROPOSED ACTIONS

#### Recommended implementation

- Carry out the following corrective actions in succession until the problem is solved.

(See chapter 2)

1

#### On the SITE

- (1) Analyse the installation, identify and characterise equipment potentially affected by or causing interference.
- (2) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts
- (3) Avoid frame connection loops  
 ==> Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together

[\(p. 8 and 36\)](#)

2

3

#### On the INSTALLATION / CABINET

- (1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (2) Avoid frame connection loops  
 ==> Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.

[\(p. 32 and 36\)](#)

4

#### The power supplies

- (3) Actions on the interfering equipment  
 Avoid propagation of interference upstream of interfering equipment.  
 ==> Power interfering equipment using separate power supplies ensuring effective “HF” decoupling (double screen transformer, filters, etc.).  
 ==> Power the interfering equipment using separate power supply lines wired in a star configuration.

[\(p. 18, 32 and 36\)](#)

5

- (4) Actions on the equipment affected by interference.  
 Protect the equipment affected by interference from disturbances carried in the installation’s cables.  
 ==> Power equipment affected by interference using separate power supplies ensuring effective “HF” decoupling (double screen transformer, filters, etc.).  
 ==> Power the equipment affected by interference using separate power supply lines wired in a star configuration.

[\(p. 18, 32 and 36\)](#)

#### The cables

- (5) Cable actions.  
 ==> Move sensitive cables an adequate distance away from interfering equipment and cables.  
 ==> Use cables designed for the signals carried, i.e. according to the class of the relevant cable: standard conductors, twisted pairs, shielded twisted pairs, shielded cables, etc.

[\(p. 32 and 36\)](#)

 <b>PROPOSED ACTIONS (CONTINUED)</b>	<b>Recommended implementation (cont'd)</b>
<p>==&gt; Ensure the interfering cables (class* 3-4) and sensitive cables (class* 1-2) are routed in two different metal cable runs separated by an adequate gap.</p> <p style="text-align: center;"><b>The cable runs</b></p> <p>(6) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.</p> <p>(7) Cable run actions</p> <p style="padding-left: 20px;">==&gt; Use cable runs that ensure effective “HF” shielding (cable troughs or enclosed metal tubes ... correctly connected).</p> <p style="padding-left: 20px;">==&gt; Ensure the interfering cables (class* 3-4) and sensitive cables (class* 1-2) are routed in two different metal cable runs separated by an adequate gap.</p>	<p><a href="#">(See chapter 2)</a> <a href="#">(p. 32, 36, 44 and 52)</a></p> <p><a href="#">(p. 8)</a></p> <p><a href="#">(32, 36, 44 and 52)</a></p>
<b>On the equipment AFFECTED BY INTERFERENCE</b>	
<p>(1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.</p> <p>(2) Avoid frame connection loops</p> <p style="padding-left: 20px;">==&gt; Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.</p> <p style="text-align: center;"><b>The power supply</b></p> <p>(3) Actions on equipment affected by interference</p> <p>Protect the equipment affected by interference from disturbances carried in the installation’s cables.</p> <p style="padding-left: 20px;">==&gt; Power equipment affected by interference using separate power supplies ensuring effective “HF” decoupling (double screen transformer, filters, etc.).</p> <p style="padding-left: 20px;">==&gt; Power the equipment affected by interference using separate power supply lines wired in a star configuration.</p>	<p><a href="#">(p. 8, 32 and 36)</a></p> <p><a href="#">(p. 32, 36, 44 and 52)</a></p>
<p style="text-align: center;"><b>The equipment</b></p> <p>(4) Limit coupling of radiated disturbances on sensitive equipment.</p> <p style="padding-left: 20px;">==&gt; Move sensitive equipment an adequate distance away from all sources of interference (interfering switchgear, cables, etc.).</p> <p style="text-align: center;"><b>The associated cables</b></p> <p>(5) Protect sensitive equipment from the disturbances conducted by cables connected to such equipment.</p> <p style="padding-left: 20px;">==&gt; Insert suitable attenuators (ferrite core, filters, surge arresters, etc.) upstream and/or downstream of the device affected by interference (power supply/ies, input(s), output(s), etc.).</p>	<p><a href="#">(p. 56, 60, 62, 32, 36 and 52)</a></p>



 **PROPOSED ACTIONS (CONTINUED)** **Recommended implementation (cont'd)**

(See chapter 2)

**On the INTERFERING equipment**

- (1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.

[\(p. 8\)](#)

***The power supply***

- (2) Avoid propagation of interference upstream of interfering equipment.  
 ==> Use separate power supply lines and if necessary separate power sources to ensure effective “HF” decoupling (double screen transformer, filters, etc.).

[\(p. 18, 32 and 36\)](#)

***The equipment***

- (3) Limit radiation of interfering equipment.  
 ==> Assemble the equipment in housing(s) that provide(s) adequate shielding (cabinet, casing, etc.)

***The associated cables***

- (4) Avoid propagation of interference upstream and downstream of interfering equipment.

==> Insert an output filter or a ferrite core directly downstream of the interfering equipment on the cable(s) connected to it.

[\(p. 56, 60 and 62\)](#)

==> Insert an input filter or a ferrite core directly upstream of the interfering equipment on the cable(s) connected to it.

 Cables that in theory do not generate interference (class\* 1-2) carrying “low level” signals and connected to an interfering device may carry the generated interference in conducted form and become interfering cables.

Limit the radiation of cables carrying interfering signals: power/control cables (class\* 3-4).

==> Use twisted pairs, shielded twisted pairs, shielded cables, cable troughs or enclosed metal tubes ... correctly connected.

[\(32, 36, 44 and 52\)](#)

--- Class: non-standardised term adopted for the purposes of this document. ---

1

2

3

4

5

## Electronic speed controller



### “Low level” sensors



#### OBSERVED MALFUNCTIONS

- **Analogue devices**  
Instability, fluctuations, offsets, incorrect measurements, etc.
- **Digital devices, discrete output**  
Loss of data, untimely changes of sensor output state.



#### PROPOSED ACTIONS

#### Recommended implementation

- Carry out the following corrective actions in succession until the problem is solved. *(See chapter 2)*

#### On the SITE

- (1) Analyse the installation, identify and characterise equipment potentially affected by or causing interference.
- (2) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts (components, speed controllers, filters, motors, shielding, etc.). *(p. 8, 32 and 36)*
- (3) Avoid frame connection loops  
*==> Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together*

#### On the INSTALLATION / CABINET

- (1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts. *(p. 8, 32 and 36)*
- (2) Avoid frame connection loops  
*==> Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.*

#### **The power supplies**

- (3) Actions on the interfering equipment  
*==> See common section*
- (4) Actions on the equipment affected by interference.  
*==> See common section*

#### **The cables**

- (5) Limit coupling of disturbances radiated on the cables carrying sensitive signals (class\* 1-2)..  
*==> Move sensitive cables away from interfering equipment and cables.*  
*==> Use, twisted pairs, shielded twisted pairs, shielded cables, cable troughs or enclosed metal tubes ... correctly connected.* *(p. 32, 36, 44 and 52)*
- If interference is caused by the speed controller’s power supply cable: “power” cable (class\* 3-4):
- ==> Insert ferrite cores on the interfering cables (speed controller end).*
  - ==> Limit radiation of the cable using twisted pairs, shielded twisted pairs, shielded cables, cable troughs or enclosed metal tubes ... correctly connected.* *(p. 32, 36, 44, 52, 56, 60 and 62)*
  - ==> Insert an input filter directly upstream of the speed controller.*




**PROPOSED ACTIONS (CONTINUED)**
**Recommended implementation (cont'd)**

If interference is caused by the load's power supply cable: "power" cable (class\* 3-4):

==> *Limit radiation of the cable using a shielded cable, cable troughs or enclosed metal tubes ... correctly connected.*

==> *Insert an output filter directly downstream of the speed controller.*

See common section.

*(See chapter 2)*  
[\(p. 32, 36, 44, 52, 56 and 60\)](#)

**The cable runs**

(6) Ensure "LF" and "HF" equipotential bonding of exposed conductive parts.

(7) Cable run actions

==> *Ensure the "power" cables (class\* 3-4) and "low level sensor" cables (class\* 1-2) are routed in two different cable runs separated by an adequate gap.*

==> *See common section*

[\(p. 8, 32, 36, 44 and 52\)](#)

**On the equipment AFFECTED BY INTERFERENCE**
**Origin: radiated interference**

(1) Ensure "LF" and "HF" equipotential bonding of exposed conductive parts.

(2) Avoid frame connection loops

==> *Obtain careful interconnection of exposed conductive parts and route the "Outgoing" and "Return" power supply cables together.*

[\(p. 8, 32 and 36\)](#)

**The power supply**
**Origin: conducted interference**

(3) Protect the equipment affected by interference from disturbances carried in the installation's cables.

==> *Use separate power supply lines and if necessary separate power sources ensuring effective "HF" decoupling (double screen transformer, etc.).*

See common section.

[\(p. 18 and 52\)](#)

**The equipment**

(4) Limit coupling of radiated disturbances on sensitive equipment.

==> *Move sensitive equipment an adequate distance away from all sources of interference (interfering switchgear, cables, etc.).*

See common section.

**The associated cables**

(5) Protect sensitive equipment from the disturbances conducted by cables connected to such equipment.

==> *Insert suitable attenuators (ferrite core, filters, surge arresters, etc.) upstream and/ or downstream of the device affected by interference (power supply/ies, input(s),*

[\(p. 32, 36, 52, 56, 60 and 62\)](#)

1

2

3

4

5

 <b>PROPOSED ACTIONS (CONTINUED)</b>	<b>Recommended implementation (cont'd)</b>
	(See chapter 2)
<b>On the INTERFERING equipment</b>	
(1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.	<a href="#">(p. 8)</a>
<b>The power supply</b>	
(2) Avoid propagation of interference upstream of interfering equipment. <i>==&gt; Use separate power supply lines and if necessary separate power sources to ensure effective “HF” decoupling (double screen transformer, filters, etc.).</i> See common section.	<a href="#">(p. 18 and 52)</a>
<b>The equipment</b>	
(3) Limit the radiation of interfering equipment. <i>==&gt; Assemble the equipment in housing(s) that provide(s) adequate shielding (cabinet, casing, etc.)</i> See common section.	
<b>The associated cables</b>	
(4) Limit the flow of interference upstream of the installation: <i>==&gt; Set up decoupling systems (R, L, C), ferrite cores or suitable filters on the inputs and/or outputs of the devices.</i> See common section.	<a href="#">(p. 32, 36, 52, 56, 60 and 62)</a>
<p style="text-align: center;">--- Class: non-standardised term adopted for the purposes of this document. ---</p>	

- 1
- 2
- 3
- 4
- 5

## Electronic speed controller



## Regulator analogue output



### OBSERVED MALFUNCTIONS

- Instability, fluctuations, offsets, incorrect references, etc. at the output of the regulator supplying the reference value to the electronic speed controller.



### PROPOSED ACTIONS

### Recommended implementation

(See chapter 2)

- Carry out the following corrective actions in succession until the problem is solved.

#### On the SITE

- (1) Analyse the installation, identify and characterise equipment potentially affected by or causing interference.
- (2) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts (components, speed controllers, filters, motors, shielding, etc.).
- (3) Avoid frame connection loops  
 ==> *Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together*

[\(p. 8, 32 and 36\)](#)

#### On the INSTALLATION / CABINET

- (1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (2) Avoid frame connection loops  
 ==> *Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.*

[\(p. 8, 32 and 36\)](#)

#### The power supplies

- (3) Actions on the interfering equipment  
 ==> *See common section*
- (4) Actions on the equipment affected by interference.  
 ==> *See common section*

#### The cables

- (5) Protect the “low level” cables at the regulator output (class\* 1-2).  
 ==> *Use twisted pairs, shielded twisted pairs, shielded cables, cable troughs or enclosed metal tubes ... correctly connected.*

[\(p. 32, 36, 44 and 52\)](#)

Insert a ferrite core at the speed controller input on the regulator’s “low level” cable  
 If interference is caused by the speed controller’s power supply cable: “Power” cable (class\* 3-4).

[\(p. 32, 36, 52, 56, 60 and 62\)](#)

==> *Insert ferrite cores on the interfering cables (on the speed controller input).*

[\(p. 32, 36, 52, 56, 60 and 62\)](#)

==> *Limit the cable’s radiation using twisted pairs, shielded twisted pairs, shielded cables, cable troughs or enclosed metal tubes ... correctly connected.*

[\(p. 32, 36, 52, 56, 60 and 62\)](#)

==> *Insert an input filter directly upstream of the speed controller.*

1

2

3

4

5

 <b>PROPOSED ACTIONS (CONTINUED)</b>	<b>Recommended implementation (cont'd)</b>
<p>If interference is caused by the load's (motor's) power supply cable: "Power" cable (class* 3-4).</p> <p>==&gt; <i>Limit the cable's radiation using a shielded cable, cable troughs or enclosed metal tubes ... correctly connected.</i></p> <p>==&gt; <i>Insert an output filter directly downstream of the speed controller.</i></p> <p>See common section</p> <p style="text-align: center;"><b>The cable runs</b></p> <p>(6) Ensure "LF" and "HF" equipotential bonding of exposed conductive parts.</p> <p>(7) Cable run actions ==&gt; <i>See common section</i></p>	<p>(See chapter 2) <a href="#">(p. 32, 36, 52, 56, 60 and 62)</a></p> <p><a href="#">(p. 8)</a></p>
<b>On the equipment AFFECTED BY INTERFERENCE</b>	
<p>(1) Ensure "LF" and "HF" equipotential bonding of exposed conductive parts.</p> <p>(2) Avoid frame connection loops ==&gt; <i>Obtain careful interconnection of exposed conductive parts and route the "Outgoing" and "Return" power supply cables together.</i></p> <p style="text-align: center;"><b>The power supply</b></p> <p>(3) See common section</p> <p style="text-align: center;"><b>The equipment</b></p> <p>(4) See common section</p> <p style="text-align: center;"><b>The associated cable</b></p> <p><b>Origin: radiated interference</b></p> <p>(5) Ensure the "power" cables (class* 3-4) and "low-levels regulator" cables (class* 1-2) are routed in two different cable runs separated by an adequate gap. See common section</p>	<p><a href="#">(p. 8, 32 and 36)</a></p> <p><a href="#">(p. 32, 36, 44 and 52)</a></p>
<b>On the INTERFERING equipment</b>	
<p>(1) Ensure "LF" and "HF" equipotential bonding of exposed conductive parts.</p> <p style="text-align: center;"><b>The power supply</b></p> <p>(2) See common section</p> <p style="text-align: center;"><b>The equipment</b></p> <p>(3) See common section</p>	<p><a href="#">(p.8)</a></p>

1

2

3

4

5

 <b>PROPOSED ACTIONS (CONTINUED)</b>	<b>Recommended implementation (cont'd)</b>
<p style="text-align: center;"><i>The associated cable</i></p> <p><b>Origin: radiated interference</b></p> <p>(4) Ensure the “power” cables (class* 3-4) and “low-levels regulator” cables (class* 1-2) are routed in two different cable runs separated by an adequate gap. See common section</p> <p style="text-align: center;">--- *Non-standardised term adopted for the purposes of this document ---</p>	<p style="text-align: center;"><i>(See chapter 2)</i></p> <p><a href="#">(p. 32, 36, 44 and 52)</a></p>

1

2

3

4

5

## Electronic speed controller



## Telephone network - telephone



### OBSERVED MALFUNCTIONS

- Interference of telephone calls possibly causing the telephone to be activated (ringing, etc.)



### PROPOSED ACTIONS

### Recommended implementation

- Carry out the following corrective actions in succession until the problem is solved. *(See chapter 2)*

#### On the SITE

- (1) Analyse the installation, identify and characterise the equipment potentially affected by or causing interference.
- (2) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (3) Avoid frame connection loops  
 ==> *Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together*

[\(p. 8, 32 and 36\)](#)

#### On the INSTALLATION / CABINET

- (1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (2) Avoid frame connection loops  
 ==> *Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.*

[\(p. 8, 32 and 36\)](#)

#### **The power supplies**

- (3) Actions on the interfering equipment  
 ==> *See common section*
- (4) Actions on the equipment affected by interference  
 ==> *See common section*

#### **The cables**

- (5) If interference is caused by the speed controller’s power supply cable: “Power” cable (class\* 3-4).  
 ==> *Limit the cable’s radiation using twisted pairs, shielded twisted pairs, shielded cables, cable troughs or enclosed metal tubes ... correctly connected.*  
 ==> *Insert an input filter directly upstream of the speed controller.*  
 If interference is caused by the power supply cable of the load (motor): “Power” cable (class\* 3-4) and/or “low level” control power supply cables connected to the speed controller.  
 ==> *Limit the cable’s radiation using a shielded cable, cable troughs or enclosed metal tubes ... correctly connected.*  
 ==> *Insert an output filter directly downstream of the speed controller.*  
 See common section

[\(p. 32, 36, 44 and 52\)](#)

[\(p. 56, 60 and 62\)](#)

[\(p. 32, 36, 44 and 52\)](#)

[\(p. 32, 36, 52, 56, 60 and 62\)](#)





**PROPOSED ACTIONS (CONTINUED)**

**Recommended implementation (cont'd)**

***The cable runs***

- (6) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (7) Cable run actions

**Origin: radiated interference**

==> *Ensure the “power” cables (class\* 3-4) and “low-level telephone line” cables (class\* 1-2) are routed in two different cable runs separated by an adequate gap.*

See common section

*(See chapter 2)*

[\(p. 8, 44 and 52\)](#)

1

**On the equipment AFFECTED BY INTERFERENCE**

- (1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (2) Avoid frame connection loops

==> *Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.*

[\(p. 8, 32 and 36\)](#)

2

***The power supply***

- (3) See common section

3

***The equipment***

- (4) Limit the coupling of radiated disturbances on sensitive equipment

==> *Move sensitive equipment a sufficient distance away from any sources of interference (interfering switchgear, cables, etc.).*

[\(p. 32 and 36\)](#)

4

***The associated cable***

- (5) See common section

5

**On the INTERFERING equipment**

- (1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.

[\(p. 8\)](#)

***The power supply***

- (4) See common section

***The equipment***

- (3) See common section

***The associated cable***

- (4) See common section

--- *Class: non-standardised term adopted for the purposes of this document* ---

**Electromagnetic interference**  
**Natural interference (lightning, etc.)**  
**Equipment or systems generating switching interference**



Electronic measurement or control modules  
 Static or converting interfaces  
 Static contactors and relays.  
 Dimmers, starters and static brakes  
 Electronic overload relays



**OBSERVED MALFUNCTIONS**

- Signalling or display errors
  - Untimely changes in state
  - Loss of data
- Measurement errors
  - Etc.

**PROPOSED ACTIONS** **Recommended implementation**

- Carry out the following corrective actions in succession until the problem is solved. (See chapter 2)

**On the SITE**

- (1) Analyse the installation, identify and characterise the equipment potentially affected by or causing interference.
- (2) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (3) Avoid frame connection loops  
 ==> *Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together*

[\(p. 8, 32 and 36\)](#)

**Origin: power line disturbance**

**On the INSTALLATION / CABINET**

- (1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (2) Avoid frame connection loops  
 ==> *Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.*

[\(p. 8, 32 and 36\)](#)

**The power supplies**

- (3) Actions on the interfering equipment  
 ==> *See common section*
- (4) Actions on the equipment affected by interference.  
 ==> *Use of backed-up power supplies or supplies with an energy reserve.*

**The cables**

- (5) See common section

**The cable runs**

- (6) See common section

**On the equipment AFFECTED BY INTERFERENCE**

- (1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (2) Avoid frame connection loops  
 ==> *Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.*

[\(p. 8, 32 and 36\)](#)



- 1
- 2
- 3
- 4
- 5

 <b>PROPOSED ACTIONS (CONTINUED)</b>	<b>Recommended implementation (cont'd)</b>
<p style="text-align: center;"><b><i>The power supply</i></b></p> <p>(2) Use of backed-up power supplies or power supplies with an energy reserve.</p> <p>(3) Protect the equipment affected by interference carried by the installation's cables.            ==&gt; <i>Separate power supplies ensuring effective "HF" decoupling (double screen transformer, filters, etc.).</i>            ==&gt; <i>Power the equipment affected by interference using separate power supply lines wired in a star configuration.</i></p> <p style="text-align: center;"><b><i>The equipment</i></b></p> <p>(4) See common section</p> <p style="text-align: center;"><b><i>The associated cable</i></b></p> <p>(5) See common section</p>	<p>(See chapter 2)</p> <p><a href="#">(p. 18)</a></p>
<b>On the INTERFERING equipment</b>	
<p>As far as possible, eliminate the interference from source.</p> <p>(1) Ensure "LF" and "HF" equipotential bonding of exposed conductive parts.</p> <p style="text-align: center;"><b><i>The power supply</i></b></p> <p>(2) See common section</p> <p style="text-align: center;"><b><i>The equipment</i></b></p> <p>(3) See common section</p> <p style="text-align: center;"><b><i>The associated cable</i></b></p> <p>(4) See common section</p>	<p><a href="#">(p. 8)</a></p>
<b>Origin: operating surges or lightning</b>	
<b>On the INSTALLATION / CABINET</b>	
<p>(1) Ensure "LF" and "HF" equipotential bonding of exposed conductive parts.</p> <p>(2) Avoid frame connection loops            ==&gt; <i>Obtain careful interconnection of exposed conductive parts and route the "Outgoing" and "Return" power supply cables together.</i></p> <p style="text-align: center;"><b><i>The power supplies</i></b></p> <p>(3) Actions on the interfering equipment            ==&gt; <i>Decouple the mains power supply.</i>  <i>Insert isolation transformers ensuring effective "HF" decoupling.</i></p>	<p><a href="#">(p.8, 18, 32 and 36)</a></p> <p><a href="#">(p. 18)</a></p>

 <b>PROPOSED ACTIONS (CONTINUED)</b>	<b>Recommended implementation (cont'd)</b>
<p>==&gt; See common section</p> <p>(4) Actions on the equipment affected by interference.            ==&gt; <i>Install protection against lightning</i>            ==&gt; <i>See common section</i></p> <p style="text-align: center;"><b>The cables</b></p> <p>(5) See common section</p> <p style="text-align: center;"><b>The cable runs</b></p> <p>(6) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.            (7) Cable run actions            ==&gt; <i>Ensure the “power” cables (class* 3-4) and “low-level” cables (class* 1-2) are routed in two different cable runs separated by an adequate gap.</i></p>	<p>(See chapter 2)</p> <p><a href="#">(p. 8, 32, 36, 44 and 52)</a></p>
<b>On the equipment AFFECTED BY INTERFERENCE</b>	
<p>(1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.            (2) Avoid frame connection loops            ==&gt; <i>Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.</i></p> <p style="text-align: center;"><b>The power supply</b></p> <p>(3) Install protection against lightning            See common section</p> <p style="text-align: center;"><b>The equipment</b></p> <p>(4) See common section</p> <p style="text-align: center;"><b>The associated cable</b></p> <p>(5) Limit coupling of the radiated disturbances on the cables.            ==&gt; <i>Use twisted pairs, shielded twisted pairs, shielded cables, cable channels or enclosed metal tubes ... correctly connected..</i></p>	<p><a href="#">(p. 8, 32 and 36)</a></p> <p><a href="#">(p. 32, 36, 44 and 52)</a></p>
<b>On the INTERFERING equipment</b>	
<p>(1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.</p> <p style="text-align: center;"><b>The power supply</b></p> <p>(2) See common section</p>	<p><a href="#">(p. 8)</a></p>



- 1
- 2
- 3
- 4
- 5

	 <b>PROPOSED ACTIONS (CONTINUED)</b>	<b>Recommended implementation (cont'd)</b>
	<b>The equipment</b>	<i>(See chapter 2)</i>
	(3) Limit surges across the equipment's terminals <i>==&gt; Use of limiters with/without resistor or buffer-inductance.</i>	<a href="#">(p. 32, 36, 52, 56 and 60)</a>
	<b>The associated cable</b>	
	(4) See common section	
	<b>Origin: rapid transients</b>	
	<b>On the INSTALLATION / CABINET</b>	
	(1) Ensure "LF" and "HF" equipotential bonding of exposed conductive parts.	<a href="#">(p. 8, 18, 32 and 36)</a>
	(2) Avoid frame connection loops <i>==&gt; Obtain careful interconnection of exposed conductive parts and route the "Outgoing" and "Return" power supply cables together.</i>	
	<b>The power supplies</b>	
	(3) Actions on the interfering equipment <i>==&gt; See common section</i>	
	(4) Actions on the equipment affected by interference. <i>==&gt; See common section</i>	
	<b>The cables</b>	
	(5) See common section	
	<b>The cable runs</b>	
	(6) Ensure "LF" and "HF" equipotential bonding of exposed conductive parts.	<a href="#">(p. 8)</a>
	(7) Cable run actions <i>==&gt; Ensure the interfering cables (class* 3-4) and sensitive cables (class* 1-2) are routed in two different cable runs separated by an adequate gap.</i>	<a href="#">(p. 32, 36, 44 and 52)</a>
	<b>On the equipment AFFECTED BY INTERFERENCE</b>	
	(1) Ensure "LF" and "HF" equipotential bonding of exposed conductive parts.	<a href="#">(p. 8, 18, 32 and 36)</a>
	(2) Avoid frame connection loops <i>==&gt; Obtain careful interconnection of exposed conductive parts and route the "Outgoing" and "Return" power supply cables together.</i>	

 <b>PROPOSED ACTIONS (CONTINUED)</b>	<b>Recommended implementation (cont'd)</b>
<p style="text-align: center;"><b>The power supply</b></p> <p>(3) Protect the equipment affected by interference carried in the installation cables                      ==&gt; <i>Use separate power supply lines and if necessary separate power supplies to ensure effective "HF" decoupling (double screen transformer, etc.)</i>                      See common section</p>	<p>(See chapter 2)</p> <p><a href="#">(p. 18)</a></p>
<p style="text-align: center;"><b>The equipment</b></p> <p>(4) Use of decouplers (R, C) across the terminals of the affected products or (L) in series.</p> <p>(5) Protect the equipment affected by interference carried in the installation cables                      ==&gt; <i>Insert suitable attenuators (ferrite cores, filters, etc.) upstream and/or downstream of the device affected by interference (power supply/ies, input(s), output(s), etc.).</i>                      See common section</p>	<p><a href="#">(p. 32, 36, 52, 56 and 60)</a></p> <p><a href="#">(p. 32, 36, 52, 56, 60 and 62)</a></p>
<p style="text-align: center;"><b>The associated cable</b></p> <p>(5) Limit coupling of the radiated disturbances on the cables carrying sensitive signals (class* 1-2).                      ==&gt; <i>Move sensitive cables away from interfering equipment and cables.</i>                      See common section</p>	
<b>On the INTERFERING equipment</b>	
<p>(1) Ensure "LF" and "HF" equipotential bonding of exposed conductive parts.</p>	<p><a href="#">(p. 8)</a></p>
<p style="text-align: center;"><b>The power supply</b></p> <p>(2) See common section</p>	
<p style="text-align: center;"><b>The equipment</b></p> <p>(3) Use surge arresters connected directly to the terminals of the inductances in question (contactor coils, relays, solenoid valves, etc.).                      See common section</p>	<p><a href="#">(p. 32, 36, 52, 56 and 60)</a></p>
<p style="text-align: center;"><b>The associated cable</b></p> <p>(4) Limit the radiation of cables carrying interfering signals: power/control cables (class* 3-4).                      ==&gt; <i>Use twisted pairs, shielded twisted pairs, shielded cables, cable channels or enclosed metal tubes ... correctly connected.</i>                      ==&gt; <i>Comply with the recommended cable lengths.</i>                      See common section</p>	<p><a href="#">(p.32, 36, 44, and 52)</a></p>





**PROPOSED ACTIONS (CONTINUED)**

**Recommended implementation (cont'd)**

*(See chapter 2)*

**Origin: electrostatic discharges**

**On the INSTALLATION / CABINET**

- (1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (2) Avoid frame connection loops  
 ==> *Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.*
- (3) Use metal cabinets or specific adapted screens.

[\(p. 8, 32 and 36\)](#)

***The power supplies***

- (3) Actions on the interfering equipment  
 ==> *See common section*
- (4) Actions on the equipment affected by interference.  
 ==> *See common section*

***The cables***

- (5) See common section

***The cable runs***

- (6) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (7) Cable run actions  
 ==> *See common section*

[\(p. 8\)](#)

**On the equipment AFFECTED BY INTERFERENCE**

- (1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (2) Avoid frame connection loops  
 ==> *Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.*

[\(p. 8, 18, 32 and 36\)](#)

***The power supply***

- (3) See common section

***The equipment***

- (4) See common section

***The associated cable***

- (5) See common section

1

2

3

4

5

 <b>PROPOSED ACTIONS (CONTINUED)</b>	<b>Recommended implementation (cont'd)</b>
<p style="text-align: right;"><i>(See chapter 2)</i></p> <p><b>On the INTERFERING equipment</b></p> <p>(1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.</p> <p style="text-align: center;"><b>The power supply</b></p> <p>(2) See common section</p> <p style="text-align: center;"><b>The equipment</b></p> <p>(3) See common section</p> <p style="text-align: center;"><b>The associated cable</b></p> <p>(4) See common section</p>	<p><a href="#">(p. 8)</a></p>
<b>Origin: electromagnetic interference</b>	
<p><b>On the INSTALLATION / CABINET</b></p> <p>(1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.</p> <p>(2) Avoid frame connection loops  <i>==&gt; Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together</i></p> <p style="text-align: center;"><b>The power supplies</b></p> <p>(3) Actions on the interfering equipment  <i>==&gt; See common section</i></p> <p>(4) Actions on the equipment affected by interference  <i>==&gt; See common section</i></p> <p style="text-align: center;"><b>The cables</b></p> <p>(5) See common section</p> <p style="text-align: center;"><b>The cable runs</b></p> <p>(6) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.</p> <p>(7) Cable run actions  <i>==&gt; See common section</i></p>	<p><a href="#">(p. 8, 18, 32 and 36)</a></p> <p><a href="#">(p. 8)</a></p>
<p><b>On the equipment AFFECTED BY INTERFERENCE</b></p> <p>(1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.</p> <p>(2) Avoid frame connection loops  <i>==&gt; Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.</i></p>	<p><a href="#">(p. 8, 32 and 36)</a></p>





- 1. Switching of contactors, relays, solenoid valves, inductances
- 2. Static brakes and starters, waveform train dimmers.



“Low level” sensors, instrumentation (measurement, adjustment, calculation...)



### OBSERVED MALFUNCTIONS

- **Analogue devices**  
Instability, fluctuations, offsets, incorrect measurements, etc.
- **Digital devices, discrete output**  
Loss of data, untimely changes of state.

	<b>PROPOSED ACTIONS</b>	<b>Recommended implementation</b>
---	-------------------------	-----------------------------------

- Carry out the following corrective actions in succession until the problem is solved. (See chapter 2)

#### On the SITE

- (1) Analyse the installation, identify and characterise the equipment potentially affected by or causing interference.
- (2) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (3) Avoid frame connection loops  
==> Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together

[\(p. 8, 32 and 36\)](#)

#### On the INSTALLATION / CABINET

- (1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (2) Avoid frame connection loops  
==> Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.

[\(p. 8, 32 and 36\)](#)

#### **The power supplies**

- (3) Actions on the interfering equipment  
==> See common section
- (4) Actions on the equipment affected by interference  
==> See common section

#### **The cables**

- (5) See common section

#### **The cable runs**

- (6) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (7) Cable run actions  
==> Ensure the “power” cables (class\* 3-4) and “low-level” cables (class\* 1-2) are routed in two different cable runs separated by an adequate gap.  
==> See common section

[\(p. 8\)](#)  
[\(p. 32, 36, 44 and 52\)](#)





**PROPOSED ACTIONS (CONTINUED)**

**Recommended implementation (cont'd)**

(See chapter 2)

**On the equipment AFFECTED BY INTERFERENCE**

- (1) Ensure "LF" and "HF" equipotential bonding of exposed conductive parts.
- (2) Avoid frame connection loops  
 ==> *Obtain careful interconnection of exposed conductive parts and route the "Outgoing" and "Return" power supply cables together.*

(p. 8)  
(p. 32 and 36)

**The power supply**

- (3) Protect equipment affected by interference carried by the installation's cables.  
 ==> *Use separate power supply lines and if necessary separate power supplies to ensure effective "HF" decoupling (double screen transformer, etc.).*  
 See common section

(p. 18 and 52)

**The equipment**

- (4) Protect equipment affected by interference carried by the installation's cables.  
 ==> *Insert suitable attenuators (ferrite cores, filters, etc.) upstream and/or downstream of the device affected by interference (power supply/ies, input(s), output(s), etc.).*  
 Limit the coupling of radiated disturbances on sensitive equipment.  
 ==> *Move the "low level" processing equipment away from interfering switchgear and cables.*  
 See common section

(p. 32, 36, 52, 56, 60 and 62)

**The associated cable**

- (5) Limit coupling of radiated disturbances on cables carrying sensitive signals. (class\* 1-2).  
 ==> *Move sensitive cables away from interfering equipment and cables.*  
 See common section

**On the INTERFERING equipment**

- (1) Ensure "LF" and "HF" equipotential bonding of exposed conductive parts.

(p. 8)

**The power supply**

- (2) Avoid the propagation of interference upstream of the interfering equipment.  
 ==> *Use separate power supply lines and if necessary separate power supplies to ensure effective "HF" decoupling (double screen transformer, etc.).*  
 ==> *Set up adapted filters on the power supply for the equipment or the machine.*  
 See common section

(p. 18 and 52)  
(p. 52)



 <b>PROPOSED ACTIONS (CONTINUED)</b>	<b>Recommended implementation (cont'd)</b>
<p style="text-align: center;"><b>The equipment</b></p> <p>(3) Limit the emission and flow of conducted interference.</p> <p><b>Type (1) devices</b>            Set up surge arresters across the load terminals .            ==&gt; EN = : R, C circuits            ==&gt; EN = : free wheel diodes</p> <p><b>Type (2) devices</b>            Set up decoupling (R, L, C), ferrite cores or suitable filters on the input and/or output power connections of the devices.            Limit the radiation of interfering equipment.            ==&gt; Assemble the equipment in a housing that provides adequate shielding (cabinet, case, etc.).            See common section</p>	<p>(See chapter 2)</p> <p><a href="#">(p. 52, 56, 60 and 62)</a></p> <p><a href="#">(p. 52, 56, 60 and 62)</a></p>
<p style="text-align: center;"><b>The associated cable</b></p> <p>(4) Limit the radiation of the cables carrying interfering signals: power/control cables (class* 3-4).            ==&gt; Use twisted pairs, shielded twisted pairs, shielded cables, cable troughs or enclosed metal tubes correctly connected.            See common section</p>	<p><a href="#">(p. 32, 36, 44 and 52)</a></p>
<p>--- Class: non-standardised term adopted for the purposes of this document. ---</p>	

1

2

3

4

5

1. Switching of contactors, relays, solenoid valves, inductances
2. Static brakes and starters, waveform train dimmers



## Radiofrequency receivers



### OBSERVED MALFUNCTIONS

- **Interference in reception manifested by:**
  - Audible breakdowns (arc, etc.) or transient interference on screens.
  - Temporary or permanent increase of background noise, etc.



### PROPOSED ACTIONS

### Recommended implementation

- Carry out the following corrective actions in succession until the problem is solved. (See chapter 2)

#### On the SITE

- (1) Analyse the installation, identify and characterise the equipment potentially affected by or causing interference.
- (2) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (3) Avoid frame connection loops  
 ==> *Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together*

[\(p. 8, 32 and 36\)](#)

#### On the INSTALLATION / CABINET

- (1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (2) Avoid frame connection loops  
 ==> *Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.*

[\(p. 8, 32 and 36\)](#)

#### **The power supplies**

- (3) Actions on the interfering equipment  
 ==> *See common section*
- (4) Actions on the equipment affected by interference  
 ==> *See common section*

#### **The cables**

- (5) See common section

#### **The cable runs**

- (6) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (7) Cable run actions  
 ==> *Ensure the “power” cables (class\* 3-4) and the cables supplying power to the radiofrequency receiver (class\* 1-2) are routed in two different cable runs separated by an adequate gap.*

[\(p. 8\)](#)

[\(p. 32, 36, 44 and 52\)](#)

1

2

3

4

5

 <b>PROPOSED ACTIONS (CONTINUED)</b>	<b>Recommended implementation (cont'd)</b>
(See chapter 2)	
<b>On the equipment AFFECTED BY INTERFERENCE</b>	
<p>(1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.</p> <p>(2) Avoid frame connection loops  <i>==&gt; Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.</i></p>	<p><a href="#">(p. 8, 32 and 36)</a></p>
<b>The power supply</b>	
<p>(3) Protect the power supply to the radiofrequency receiver from interference carried by the installation’s cables.  <i>==&gt; Replace the receiver’s mains power supply with an autonomous power supply (battery, accu, etc.)</i>  <i>==&gt; Insert suitable attenuators (ferrite core, filter, etc.) at the radiofrequency receiver’s power input.</i>  <i>==&gt; Use separate power supply lines and if necessary separate power supplies to ensure effective “HF” decoupling (double screen transformer, etc.).</i></p> <p>See common section</p>	<p><a href="#">(p. 52, 56, 60 and 62)</a>  <a href="#">(p. 18 and 52)</a></p>
<b>The equipment</b>	
<p>(4) Protect the receiver ... from radiated interference.  <i>==&gt; Ensure maximal distance between the receiver and the interfering equipment.</i></p> <p>See common section</p>	
<b>The associated cable</b>	
<p>(5) Limit coupling of radiated disturbances on the radiofrequency receiver’s power supply cable and also on the antenna, etc.  <i>==&gt; Move the power supply cable, antenna, etc. away from all sources of interference.</i></p> <p>See common section</p>	
<b>On the INTERFERING equipment</b>	
<p>(1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.</p>	<p><a href="#">(p. 8)</a></p>
<b>The power supply</b>	
<p>(2) Separate the power supplies:  <i>==&gt; Use a separate power supply line and if necessary a separate power supply to ensure effective “HF” decoupling (double screen transformer, etc.).</i></p>	<p><a href="#">(p. 18)</a></p>
<p>Limit the flow of interference upstream of the installation:  <i>==&gt; Set up adapted filters on the power supply for the equipment or the machine.</i></p> <p>See common section</p>	<p><a href="#">(p. 52, 56, 60 and 62)</a></p>



- 1
- 2
- 3
- 4
- 5

 <b>PROPOSED ACTIONS (CONTINUED)</b>	<b>Recommended implementation (cont'd)</b>
<p style="text-align: center;"><b>The equipment</b></p> <p>(3) Limit the emission and flow of conducted interference.            Type (1) devices.            Set up surge arresters across the terminals of the loads.              ==&gt; EN ~: R, C circuits              ==&gt; EN = : free wheel diodes            Type (2) devices            Set up decoupling (R, L, C), ferrite cores or suitable filters on the input and/or output power connections of the devices.            Limit the radiation of interfering equipment.              ==&gt; Assemble the equipment in a housing that provides adequate shielding (cabinet, case, etc.).            See common section</p>	<p style="text-align: right;">(See chapter 2)</p> <p style="text-align: right;"><a href="#">(p. 52, 56 and 60)</a></p> <p style="text-align: right;"><a href="#">(p. 52, 56, 60 and 62)</a></p>
<p style="text-align: center;"><b>The associated cable</b></p> <p>(4) Limit the radiation of the cables that carry interfering signals: power/control cable (class* 3-4).              ==&gt; Use twisted pairs, shielded twisted pairs, shielded cables, cable troughs or enclosed metal tubes correctly connected            See common section</p>	<p style="text-align: right;"><a href="#">(p. 32, 36, 44 and 52)</a></p>
<p style="text-align: center;">--- Class: non-standardised term adopted for the purposes of this document ---</p>	

**Decoupling power supplies**  
**DC/DC Converter**



**“Low level” sensors**



**OBSERVED MALFUNCTIONS**

- **Analogue devices**  
Instability, fluctuations, offsets, incorrect measurements
- **Digital devices, discrete output**  
Loss of data, untimely changes in sensor output state

**PROPOSED ACTIONS** **Recommended implementation**

- Carry out the following corrective actions in succession until the problem is solved. (See chapter 2)

**On the SITE**

- (1) Analyse the installation, identify and characterise the equipment potentially affected by or causing interference.
- (2) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts. [\(p. 8, 32 and 36\)](#)
- (3) Avoid frame connection loops  
=> *Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together*

**On the INSTALLATION / CABINET**

- (1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts. [\(p. 8, 32 and 36\)](#)
- (2) Avoid frame connection loops  
=> *Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.*

**The power supplies**

- (3) Actions on the interfering equipment  
=> *Use power supplies complying with legislation (EMC Directive, etc.)*  
=> *See common section*
- (4) Actions on the equipment affected by interference.  
=> *Use power supplies complying with legislation (EMC Directive, etc.)*  
=> *See common section*

**The cables**

- (5) See common section

**The cable runs**

- (6) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts. [\(p. 8\)](#)
- (7) Cable run actions  
=> *Ensure the “power” cables (class\* 3-4) and the “low level sensor” cables (class\* 1-2) are routed in two different cable runs separated by an adequate gap.* [\(p. 32, 36, 44 and 52\)](#)





**PROPOSED ACTIONS (CONTINUED)**

**Recommended implementation (cont'd)**

*(See chapter 2)*

**On the equipment AFFECTED BY INTERFERENCE**

- (1) Ensure "LF" and "HF" equipotential bonding of exposed conductive parts.
- (2) Avoid frame connection loops

[\(p. 8\)](#)

==> *Obtain careful interconnection of exposed conductive parts and route the "Outgoing" and "Return" power supply cables together.*

[\(p. 32 and 36\)](#)

***The power supply***

- (3) Protect the equipment affected by interference carried in the installation's cables.
- ==> *Use separate power supply lines and if necessary separate power supplies to ensure effective "HF" decoupling (double screen transformer, etc.)*

[\(p. 18, 32, 36 and 52\)](#)

See common section

***The equipment***

- (4) Protect the equipment affected by interference carried in the installation's cables.
- ==> *Insert suitable attenuators (ferrite core, filter, etc.) upstream and/or downstream of the device affected by interference (power supply/ies, input(s), output(s) etc.*

[\(p. 52, 56, 60 and 62\)](#)

Limit coupling of radiated disturbances on the sensitive equipment.

==> *Move "low level" processing equipment away from interfering switchgear and cables.*

See common section

***The associated cable***

- (5) Limit coupling of radiated disturbances on the cables carrying sensitive signals (class\* 1-2).

==> *Move the sensitive cables away from interfering equipment and cables.*

==> *Use twisted pairs, shielded twisted pairs, shielded cables, cable troughs or enclosed metal tubes correctly connected.*

[\(p. 32, 36, 44 and 52\)](#)

See common section

**On the INTERFERING equipment**

- (1) Ensure "LF" and "HF" equipotential bonding of exposed conductive parts.

[\(p. 8\)](#)

***The power supply***

- (2) Separate the power supplies:

==> *Use a separate power supply line and if necessary a separate power supply to ensure effective "HF" decoupling (double screen transformer, etc.).*

[\(p. 18 and 52\)](#)

See common section



 <b>PROPOSED ACTIONS (CONTINUED)</b>	<b>Recommended implementation (cont'd)</b>
<p style="text-align: center;"><b>The equipment</b></p> <p>(3) Limit the flow of interference upstream of the installation:            ==&gt; <i>Set up decoupling (R, L, C) systems, ferrite cores or suitable filters on the input and/or output power connections of the devices.</i>            See common section</p> <p style="text-align: center;"><b>The associated cable</b></p> <p>(4) If interference is caused by the speed controller's power supply cable: "power" cable (class* 3-4):            ==&gt; <i>Insert ferrite cores on the interfering cables (on the speed controller side).</i>            ==&gt; <i>Limit radiation of the cables by using twisted pairs, shielded twisted pairs, shielded cables, cable troughs or enclosed metal tubes ... correctly connected.</i>            ==&gt; <i>Insert an input filter directly upstream of the speed controller.</i>            If interference is caused by the load's (motor's) power supply cable: "power" cable (class* 3-4):            ==&gt; <i>Limit radiation of the cable using a shielded cable, cable troughs or enclosed metal tubes ... correctly.</i>            ==&gt; <i>Insert an output filter directly downstream of the speed controller.</i>            See common section</p> <p style="text-align: center;">--- Class: non-standardised term adopted for the purposes of this document. ---</p>	<p style="text-align: center;">(See chapter 2)</p> <p><a href="#">(p. 52, 56, 60 and 62)</a></p> <p><a href="#">(p. 8)</a></p> <p><a href="#">(p. 32, 36, 44 and 52)</a></p>



## Electronic speed controller



## Radiofrequency receivers



### OBSERVED MALFUNCTIONS

- Radio interference in AM (amplitude modulation) GO - PO



### PROPOSED ACTIONS

### Recommended implementation

- Carry out the following corrective actions in succession until the problem is solved.

(See chapter 2)

#### On the SITE

- (1) Analyse the installation, identify and characterise the equipment potentially affected by or causing interference.
- (2) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (3) Avoid frame connection loops  
 ==> Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together

(p. 8, 32 and 36)

#### On the INSTALLATION / CABINET

- (1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (2) Avoid frame connection loops  
 ==> Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.

(p. 8, 32 and 36)

#### The power supplies

- (3) Actions on the interfering equipment  
 ==> See common section
- (4) Actions on the equipment affected by interference  
 ==> See common section

#### The cables

- (5) See common section

#### The cable runs

- (6) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (7) Cable run actions

(p. 8)

#### On the equipment AFFECTED BY INTERFERENCE

- (1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (2) Avoid frame connection loops  
 ==> Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.

(p. 8, 32 and 36)

1

2

3

4

5

 <b>PROPOSED ACTIONS (CONTINUED)</b>	<b>Recommended implementation (cont'd)</b>
<p style="text-align: center;"><b>The power supply</b></p> <p>(3) See common section</p> <p style="text-align: center;"><b>The equipment</b></p> <p>(4) See common section</p> <p style="text-align: center;"><b>The associated cable</b></p> <p>(5) See common section</p>	<p>(See chapter 2)</p>
<b>On the INTERFERING equipment</b>	
<p>(1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.</p>	<p><a href="#">(p. 8)</a></p>
<p style="text-align: center;"><b>The power supply</b></p> <p>(2) See common section</p>	
<p style="text-align: center;"><b>The equipment</b></p> <p>(3) If interference is caused by the load’s (motor’s) power supply cable: “power” cable (class* 3-4) and/or “low level” control power cables connected to the speed controller:  <i>==&gt; Insert an output filter directly downstream of the speed controller.</i>                      See common section</p>	<p><a href="#">(p. 56)</a></p>
<p style="text-align: center;"><b>The associated cable</b></p> <p>(4) Limit the radiation of interfering cables.  <i>==&gt; Use twisted pairs, shielded twisted pairs, shielded cables, cable troughs or enclosed metal tubes ... correctly connected.</i>                      If interference is caused by the speed controller’s power supply cable: “power” cable (class* 3-4):  <i>==&gt; Insert an input filter directly upstream of the speed controller.</i>                      If interference is caused by the load’s (motor’s) power supply cable: “power” cable (class* 3-4) and/or “low level” control power cables connected to the speed controller:  <i>==&gt; Limit radiation of the cables using a shielded cable, cable troughs or enclosed metal tubes ... correctly.</i>  <i>==&gt; See common section</i></p>	<p><a href="#">(p. 32, 36, 44 and 52)</a>  <a href="#">(p. 56)</a>  <a href="#">(p. 32, 36, 44 and 52)</a></p>
<p>--- Class: non-standardised term adopted for the purposes of this document. ---</p>	



## Electronic speed controller



## Differential protections



### OBSERVED MALFUNCTIONS

Origin: "HF" frequency leak currents to earth  
 . Tripping of the differential protection



### PROPOSED ACTIONS

### Recommended implementation

- Carry out the following corrective actions in succession until the problem is solved.

(See chapter 2)

#### On the SITE

- (1) Analyse the installation, identify and characterise the equipment potentially affected by or causing interference.
- (2) Ensure "LF" and "HF" equipotential bonding of exposed conductive parts.
- (3) Avoid frame connection loops  
 ==> Obtain careful interconnection of exposed conductive parts and route the "Outgoing" and "Return" power supply cables together

(p. 8, 32 and 36)

#### On the INSTALLATION / CABINET

- (1) Ensure "LF" and "HF" equipotential bonding of exposed conductive parts.
- (2) Avoid frame connection loops  
 ==> Obtain careful interconnection of exposed conductive parts and route the "Outgoing" and "Return" power supply cables together.

(p. 8, 32 and 36)

#### The power supplies

- (3) Actions on the interfering equipment  
 ==> See common section
- (4) Actions on the equipment affected by interference  
 ==> See common section

#### The cables

- (5) See common section

#### The cable runs

- (6) Ensure "LF" and "HF" equipotential bonding of exposed conductive parts.
- (7) Cable run actions

(p. 8)

#### On the equipment AFFECTED BY INTERFERENCE

- (1) Ensure "LF" and "HF" equipotential bonding of exposed conductive parts.
- (2) Avoid frame connection loops  
 ==> Obtain careful interconnection of exposed conductive parts and route the "Outgoing" and "Return" power supply cables together.

(p. 8, 32 and 36)



 <b>PROPOSED ACTIONS (CONTINUED)</b>	<b>Recommended implementation (cont'd)</b>
<p style="text-align: center;"><b><i>The power supply</i></b></p> <p>(3) See common section</p> <p style="text-align: center;"><b><i>The equipment</i></b></p> <p>(4) Isolate the differential protection devices See common section</p> <p style="text-align: center;"><b><i>The associated cable</i></b></p> <p>(5) See common section</p>	<p>(See chapter 2)</p>
<b>On the INTERFERING equipment</b>	
<p>(1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.</p> <p style="text-align: center;"><b><i>The power supply</i></b></p> <p>(2) Isolate the electronic speed controllers <i>==&gt; separate power supplies ensuring effective “HF” decoupling (double screen transformer, etc.) + dedicated differential protection devices</i> See common section</p> <p style="text-align: center;"><b><i>The equipment</i></b></p> <p>(3) Use “immunised” differential protection devices. Insert an output filter directly downstream of the speed controller. See common section</p> <p style="text-align: center;"><b><i>The associated cable</i></b></p> <p>(4) Reduce the length of speed controller/motor cables as far as possible. See common section</p>	<p>(p. 8)</p> <p><a href="#">See Merlin Génin documentation and equipment.</a> <a href="#">Inductance, LC filter.</a> <a href="#">Sine Filter</a></p>
<p style="text-align: center;">--- Class: non-standardised term adopted for the purposes of this document ---</p>	

1

2

3

4

5

# System for arc welding / spot welding ...

## Electronic speed controllers



### OBSERVED MALFUNCTIONS

- Malfunctioning of the electronic speed controller (incoherent display data, disturbance of control possibly leading to destruction of the speed controller, etc.)



### PROPOSED ACTIONS

### Recommended implementation

- Carry out the following corrective actions in succession until the problem is solved. *(See chapter 2)*

1

#### On the SITE

- (1) It is absolutely vital to avoid welding in proximity to the electronic speed controller and its associated cables.
- (2) Analyse the installation, identify and characterise the equipment potentially affected by or causing interference.
- (3) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (4) Avoid frame connection loops  
*==> Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together*

[\(p. 8, 32 and 36\)](#)

2

3

#### On the INSTALLATION / CABINET

- (1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (2) Avoid frame connection loops  
*==> Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.*

[\(p. 8, 32 and 36\)](#)

4

#### **The power supplies**

- (3) Actions on the interfering equipment  
*==> See common section*
- (4) Actions on the equipment affected by interference  
*==> See common section*

#### **The cables**

- (5) See common section

#### **The cable runs**

- (6) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (7) Cable run actions

[\(p. 8\)](#)

5

 <b>PROPOSED ACTIONS (CONTINUED)</b>	<b>Recommended implementation (cont'd)</b>
<i>(See chapter 2)</i>	
<b>On the equipment AFFECTED BY INTERFERENCE</b>	
<p>(1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.</p> <p>(2) Avoid frame connection loops  <i>==&gt; Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.</i></p>	<p><a href="#">(p. 8, 32 and 36)</a></p>
<p><b><i>The power supply</i></b></p>	
<p>(3) Stop the installation’s speed controller and isolate it.  <i>==&gt; Open the isolators, disconnect the power supply, remove the equipment’s wires. All the cables are concerned and are likely to form an antenna.</i></p> <p> Insert an input filter directly upstream of the speed controller.            See common section</p>	<p><a href="#">(p. 56)</a></p>
<p><b><i>The equipment</i></b></p>	
<p>(4) See common section</p>	
<p><b><i>The associated cable</i></b></p>	
<p>(5) Limit the coupling of radiated disturbances on all the cables.  <i>==&gt; Use twisted pairs, shielded twisted pairs, shielded cables, cable troughs or enclosed metal tubes ... correctly connected.</i></p> <p>See common section</p>	<p><a href="#">(p. 32, 36, 44 and 52)</a></p>
<b>On the INTERFERING equipment</b>	
<p>(1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.</p>	<p><a href="#">(p. 8)</a></p>
<p><b><i>The power supply</i></b></p>	
<p>(2) Power the welding equipment separately using a power supply that ensures effective “HF” decoupling (double screen transformer, etc.)            See common section</p>	<p><a href="#">(p. 18)</a></p>
<p><b><i>The equipment</i></b></p>	
<p>(3) See common section</p>	
<p><b><i>The associated cable</i></b></p>	
<p>(4) See common section</p>	
<p>--- Class: non-standardised term adopted for the purposes of this document ---</p>	

1

2

3

4

5

## Walkie-talkie, Citizen band Portable telephones



### “Low level” sensors



#### OBSERVED MALFUNCTIONS

- **Analogue devices**  
Instability, fluctuations, offset, incorrect measurements
- **Digital devices, discrete output**  
Loss of data, untimely changes in sensor output state



#### PROPOSED ACTIONS

#### Recommended implementation

- Carry out the following corrective actions in succession until the problem is solved. (See chapter 2)

#### On the SITE

- (1) Move all sources of radiofrequency emissions away from sensitive equipment and associated cables.  
==> See example at end of the section.
- (2) Analyse the installation, identify and characterise the equipment potentially affected by or causing interference.
- (3) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts. (p. 8, 32 and 36)
- (4) Avoid frame connection loops  
==> Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together

#### On the INSTALLATION / CABINET

- (1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts. (p. 8, 32 and 36)
- (2) Avoid frame connection loops  
==> Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.

#### *The power supplies*

- (3) Actions on the interfering equipment  
==> See common section
- (4) Actions on the equipment affected by interference  
==> See common section

#### *The cables*

- (5) See common section

#### *The cable runs*

- (6) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts. (p. 8)
- (7) Cable run actions  
==> See common section

1

2

3

4

5

 <b>PROPOSED ACTIONS (CONTINUED)</b>	<b>Recommended implementation (cont'd)</b>
<i>(See chapter 2)</i>	
<b>On the equipment AFFECTED BY INTERFERENCE</b>	
(1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts. (2) Avoid frame connection loops ==> <i>Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.</i>	<a href="#">(p. 8, 32 and 36)</a>
<b><i>The power supply</i></b>	
(3) See common section	
<b><i>The equipment</i></b>	
(4) See common section	
<b><i>The associated cable</i></b>	
(5) Limit the coupling of radiated disturbances on the power supply cables to sensors, and other cables carrying sensitive signals (class* 1-2). ==> Move sensitive cables away from interfering equipment. ==> Use twisted pairs, shielded twisted pairs, shielded cables, cable troughs or enclosed metal tubes ... correctly connected. ==> Make sure the sensors’ metal casings are earthed. See common section	<a href="#">(p. 32, 36, 44 and 52)</a>
<b>On the INTERFERING equipment</b>	
(1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.	<a href="#">(p. 8)</a>
<b><i>The power supply</i></b>	
(2) See common section	
<b><i>The equipment</i></b>	
(3) See common section	
<b><i>The associated cable</i></b>	
(4) See common section	
--- <i>Class: non-standardised term adopted for the purposes of this document.</i> ---	
Walkie-talkie with power P = 4w	

1

2

3

4

5


**EXAMPLE**

Electronic device with resistance level 3 (10 V/m)  
 We assume the field is uniform.  
 Standardised resistance level of electronic devices (IEC 1000-4-3)

Level	Test field value
1	1 V/m
2	3 V/m
3	10 V/m

If  $d = 0.25$  m, the field radiated by the WT on the device is  $E = 24$  V/m.  
 ( $d$  = distance between the antenna and the device).

*==> The device is affected by interference*

To ensure the device functions correctly, the WT must be moved away.

Device resistance level	Distance between device and WT
level 2	2 m
level 3	0.6 m

**Comment:**

This information is given as an indication only, since installation conditions may considerably modify behaviour concerning resistance to “HF” radiation (wave reflection).

1

2


3

4

5

# System for arc welding / spot welding ...

## “Low level” sensors



### OBSERVED MALFUNCTIONS

(Likely to appear during welding operations)

- **Analogue devices**  
Instability, fluctuations, offset, incorrect measurements
- **Digital devices, discrete output**  
Loss of data, untimely changes in sensor output state

	<b>PROPOSED ACTIONS</b>	<b>Recommended implementation</b>
---	-------------------------	-----------------------------------

- Origin: saturation of the inductive detector’s magnetic core.**
- Carry out the following corrective actions in succession until the problem is solved.
    - (1) It is absolutely vital to avoid welding near all sensitive equipment, power supplies and associated cables.
    - (2) Use “Welding field applications” special variant equipment.

(See chapter 2)

1

### On the SITE

- (1) Analyse the installation, identify and characterise the equipment potentially affected by or causing interference.
- (2) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (3) Avoid frame connection loops  
==> Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together

[\(p. 8, 32 and 36\)](#)

2

3

### On the INSTALLATION / CABINET

- (1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (2) Avoid frame connection loops  
==> Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.

[\(p. 8, 32 and 36\)](#)

4

#### ***The power supplies***

- (3) Actions on the interfering equipment  
==> *See common section*
- (4) Actions on the equipment affected by interference  
==> *See common section*

5

#### ***The cables***

- (5) See common section

#### ***The cable runs***

- (6) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (7) Cable run actions  
==> See common section

[\(p. 8\)](#)



**PROPOSED ACTIONS (CONTINUED)**

**Recommended implementation (cont'd)**

(See chapter 2)

**On the equipment AFFECTED BY INTERFERENCE**

- (1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (2) Avoid frame connection loops  
 ==> Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.

[\(p. 8, 32 and 36\)](#)

***The power supply***

- (3) Stop the installation’s sensitive equipment and isolate it.  
 ==> Open the isolators, disconnect the power supply, remove the equipment’s wires. All the cables are concerned and are likely to form an antenna.



Avoid frame connection loops.

- ==> Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.

[\(p. 8, 32 and 36\)](#)

See common section

***The equipment***

- (4) Use “Welding field applications” special variant products  
 ==> *See common section*

***The associated cable***

- (5) Limit the coupling of radiated disturbances on all the cables.  
 ==> Use twisted pairs, shielded twisted pairs, shielded cables, cable troughs or enclosed metal tubes ... correctly connected.

[\(p. 32, 36, 44 and 52\).](#)

See common section

**On the INTERFERING equipment**

- (1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.

[\(p. 8\)](#)

***The power supply***

- (2) Power the welding equipment separately using a power supply that ensures effective “HF” decoupling (double screen transformer, etc.)  
 See common section.

[\(p. 18\)](#)

***The equipment***

- (3) Move all sources of radiofrequency emission (magnetic field) away from sensitive equipment and associated cables.  
 See common section

***The associated cable***

- (4) See common section

1

2

3

4

5

Power surges,  
lightning ... 

“Low level” sensors



**OBSERVED MALFUNCTIONS**

- Destruction of devices

**PROPOSED ACTIONS** **Recommended implementation**

- Carry out the following corrective actions in succession until the problem is solved. (See chapter 2)

**On the SITE**

- (1) Analyse the installation, identify and characterise the equipment potentially affected by or causing interference. (p. 8, 32 and 36)
- (2) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts. (p. 8, 32 and 36)
- (3) Avoid frame connection loops  
 ==> Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together

**On the INSTALLATION / CABINET**

- (1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts. (p. 8, 32 and 36)
- (2) Avoid frame connection loops  
 ==> Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.

**The power supplies**

- (3) Actions on the interfering equipment  
 ==> See common section (p. 18, 32 and 36)
- (4) Actions on the equipment affected by interference  
 ==> Check that the voltage delivered by the power supply is compatible with the characteristics of the powered equipment.  
 ==> Voltage amplitude (be careful with rectified power supplies), inversion rate, frequency, etc.  
 ==> Protection against mains interference, overloads, etc.  
 See common section

**The cables**

- (5) See common section

**The cable runs**

- (6) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts. (p. 32 and 36)
- (7) Cable run actions





**PROPOSED ACTIONS (CONTINUED)**

**Recommended implementation (cont'd)**

(See chapter 2)

**On the equipment AFFECTED BY INTERFERENCE**

- (1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.
- (2) Avoid frame connection loops

[\(p. 8, 32 and 36\)](#)

==> *Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.*

**The power supply**

- (3) Avoid frame connection loops

[\(p. 8, 32 and 36\)](#)

==> *Obtain careful interconnection of exposed conductive parts and route the “Outgoing” and “Return” power supply cables together.*

**Origin: storms**

Stop the installation’s sensitive equipment during storms and isolate it.

==> *Open the isolators, disconnect the power supply, remove the equipment’s wires. All the cables are concerned and are likely to form an antenna.*

See common section

**The equipment**

**Origin: mains surges**

- (4) Install suitable protection devices on the power supplies to sensitive equipment such as sensors, etc.

==> *Limiters such as, GMOV, Transils, Zener diodes, etc.*

==> *Ensure that triggering of protection devices will not cause malfunctioning in the installation.*

See common section

**The associated cable**

- (5) Limit the coupling of radiated disturbances on all the cables.

[\(p. 32, 36, 44 and 52\)](#)

==> *Use twisted pairs, shielded twisted pairs, shielded cables, cable troughs or enclosed metal tubes ... correctly connected.*

See common section

**On the INTERFERING equipment**

- (1) Ensure “LF” and “HF” equipotential bonding of exposed conductive parts.

[\(p. 8\)](#)

**The power supply**

- (2) See common section

**The equipment**

- (3) See common section

**The associated cable**

- (4) See common section

1

2

3

4

5

**Walkie-talkie, Citizen band  
Portable telephones**



**Electronic speed controllers**



**OBSERVED MALFUNCTIONS**

- Malfunctioning of the electronic speed controller possibly resulting in its destruction.

**PROPOSED ACTIONS** **Recommended implementation**

**Origin: radiated interference**

- (1) Move these sources of intentional radiofrequency emissions as far away as possible from all “sensitive” systems or devices.

(See chapter 2)

**Example :**

Walkie-talkie with power  $P = 4w$   
 Electronic device with resistance level 3 (10 V/m)  
 We assume the field is uniform.  
 Standardised resistance level of electronic devices (IEC 1000-4-3)

Level	Test field value
1	1 V/m
2	3 V/m
3	10 V/m

If  $d = 0.25$  m, the field radiated by the WT on the device is  $E = 24$  V/m.  
 ( $d$  = distance between the antenna and the device).

==> The device is affected by interference  
 To ensure the device functions correctly, the WT must be moved away.

Device resistance level	Distance between device and WT
level 2	2 m
level 3	0.6 m

**Comment:**

This information is given as an indication only, since installation conditions may considerably modify behaviour concerning resistance to “HF” radiation (wave reflection).



## Electronic speed controller



## Distribution transformer



### OBSERVED MALFUNCTIONS

- Heating of the distribution transformer possibly resulting in its destruction.



### PROPOSED ACTIONS

### Recommended implementation

**Origin: conducted interference, harmonic currents**

- (1) Design the transformer to take account of the RMS currents consumed by all devices that generate harmonic currents (electronic speed controllers, etc.) instead of the nominal load currents (motors, etc.).
- (2) Insert line inductances on the speed controller input (upstream)
- (3) Insert an anti-harmonic filter at the line head (downstream of the transformer).

*(See chapter 2)*

[\(p. 56\)](#)

1

2

3

4

5

# Index

---

---

## A

Affected by interference: 5-5  
Arc welding: 5-38, 5-43

---

---

## B

Bunches: 4-9

---

---

## C

Cabinet: 4-6  
Cable runs: 4-8  
Cables: 4-9  
Citizen band: 5-40, 5-47  
Common section: 5-6  
Components: 4-6  
Conductors: 4-8, 4-9  
Connection: 4-7  
Control module: 5-17  
Control: 4-7  
Control: 4-7

---

---

## D

DC/DC converter: 5-31  
Diagram: 4-4  
Differential protection: 5-36  
Dimmer: 5-17, 5-25, 5-28

Distribution system: 4-4  
Distribution transformer: 5-48

---

---

## E

Electromagnetic interference: 5-17  
Environment: 4-3  
Equipment: 4-6

---

---

## I

Instrumentation: 5-25  
Interference: 5-6  
Interfering: 5-5  
Internal distribution: 4-4

---

---

## L

Loads: 4-10  
Low level: 4-6, 4-7

---

---

## M

Malfunctions: 5-5  
Measurement module: 5-17  
Motors: 4-10

# Index

---

---

---

## N

Natural interference: 5-17

---

---

## O

Overload relay: 5-17

---

---

## P

Portable telephone: 5-40, 5-47

Power supply: 4-4, 4-5

Power surge: 5-45

Power: 4-5, 4-6, 4-7

---

---

## R

Radiofrequency receiver: 5-28, 5-34

Regulator: 5-12

Routing: 4-7

---

---

## S

Sensor: 5-9, 5-25, 5-31, 5-40, 5-43, 5-45

Speed controller: 4-6, 5-9, 5-12, 5-15, 5-34,  
5-36, 5-38, 5-47, 5-48

Spot welding: 5-38, 5-43

Starter: 5-17

Static brake: 5-25, 5-28

Static contactor: 5-17

Static relay: 5-17

Static starter: 5-25, 5-28

Storm: 5-45

Switching of contactors: 5-25, 5-28

Switching of inductances: 5-25, 5-28

Switching of relays: 5-25, 5-28

Switching of solenoid valves: 5-25, 5-28

Switching power supply: 5-31

---

---

## T

Telephone: 5-15

---

---

## W

Walkie-talkie: 5-40, 5-47

Wiring: 4-7